
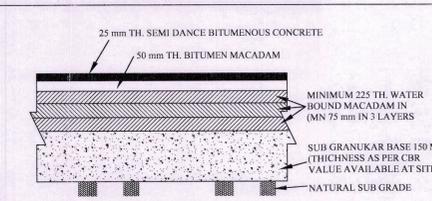








- NOTES:**
- STORM WATER OF OUR BUILDING WILL NOT DISTURB THE ROAD.
 - 1.00 M. WIDE SLAB CULVERT WILL BE PROVIDED BY US.
 - LEVEL OF BUILDING WILL BE KEPT 2% BELOW THE ROAD
 - WE SHALL NOT DEMAND ANY GAP IN VERGE IN FRONT OF BUILDING
 - THE MORTH INSTRUCTIONS SHALL NOT BE VIOLATED.
 - CERTIFIED THAT ALL MORTH CONDITIONS HAVE BEEN SPECIFIED.
 - CERTIFIED THAT WE WILL APPLY THE CASE FOR RENEWAL AS PER NORMS
 - WE WILL PAY THE NECESSARY RENT FOR THE USE OF ROAD LAND
- NOTES:**
- ORAL MARKINGS SHALL BE DONE AS PER DIRECTIONS OF P.W.D. NORTH AUTHORITY AS PER IRC-67.
 - ALL DIMENSION ARE IN METER/ MM UNLESS SPECIFIED.

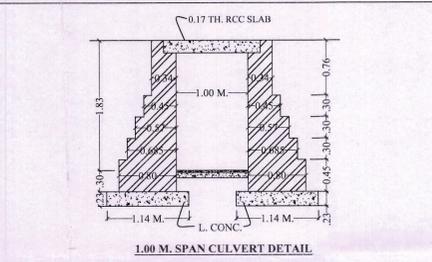

REV. NO.	DESCRIPTION OF FACILITIES	DATE



REVISE DRAWING

- REFERENCE:-**
- F : Tank Fill Point
 - S : Tank Suction Point
 - V : Tank Vent Point
 - D : Tank Dip Point
 - EFP : Extended Fill Pipe
 - EVP : Extended Vent Pipe
 - SAP : Single Arm Pole
 - DAP : Double Arm Pole

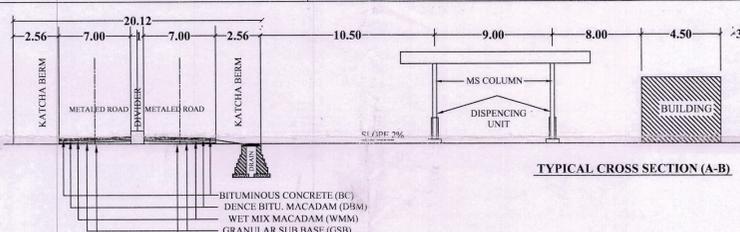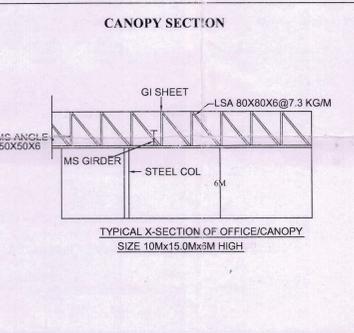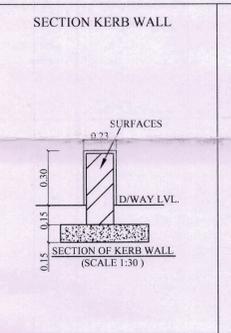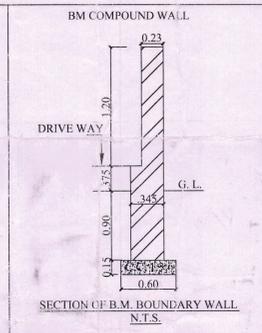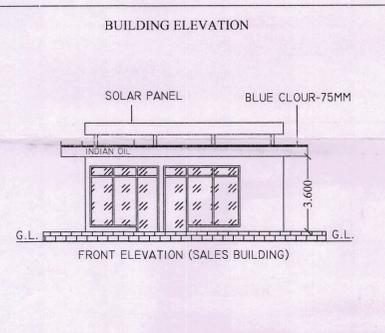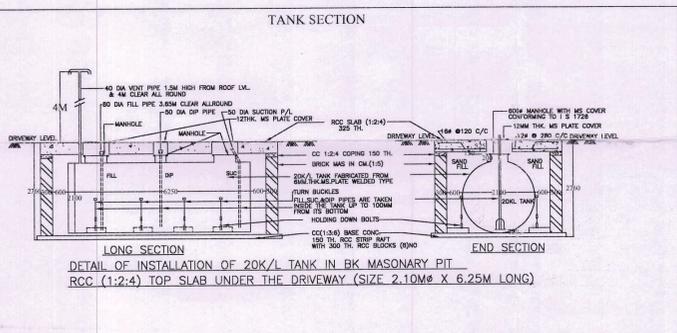

- GENERAL NOTES:**
- NO ROAD CROSSING WITHIN 100.00 M ON EITHER SIDE OF THE PLOT.
 - NO DRAIN SEWER OR STRUCTURE WITHIN 1.50 M FROM THE UNDER GROUND TANKS.
 - SUCTION, FILL & VENT PIPES UNDER THE DRIVEWAY TO BE HOUSED UNDER PIPE SLEEVES.
 - VENT PIPES 40 MM DIA 4.00 M HIGH FROM THE GROUND LEVEL AND 4.00 M CLEAR AROUND WITHIN THE PLOT FILLED WITH INVERTED 'U' TYPE VENT HOOD COVERED WITH TWO LAYERS OF NON CORRODABLE MATTEL WIRE GAUZE OF 11 MESH PER LINEAR CENTIMETER AT ITS OPEN ENDS.
 - D.P.S. BOARD FIXED ON THE WALL OF DEALER ROOM 1.500 M HIGH FROM ITS FLOOR LEVEL AND SHALL NOT BE KEPT UNDER LOCK AND KEY.
 - FILL POINTS ARE KEPT 3.650 M CLEAR AROUND.
 - "NO SMOKING" SIGN SHALL BE DISPLAYED AT THE PETROL PUMP.
 - 2 NOS. DCP TYPE FIRE EXTINGUISHERS AND DRY SAND BUCKET OF CAPACITY 10 KG FOR EACH DISPENSING PUMP. 2 NOS. CO2 TYPE FIRE EXTINGUISHERS OF CAPACITY 4.50 KG EACH FOR ELECTRIC FIRE SHALL BE PROVIDED AT THE PUMP.
 - TANKS FED BY TANK LORRY.
 - BOTH THE TANKS SHALL NOT BE REPLENISHED AT THE SAME TIME.
 - FILL PIPES AND DIP PIPES ARE FITTED WITH LOCKING ARRANGEMENT.
 - ALL ELECTRIC FITTINGS SHALL CONFORM TO IS 2148 OR EQUIVALENT ISI SPECIFICATIONS.
 - NO HIT LINE PASSING OVER KSK/RO LAND

- SPECIFICATIONS:-**
- CERTIFIED THAT UNDERGROUND MS TANKS SHALL BE FABRICATED AND INSTALLED AS APPROVED BY COOE NAGPUR, VIDE LETTER NO. P-6 (3) 51 DATED 23.01.07.
- NOTES:-**
- CERTIFIED THAT THIS IS A NEW KSK/RO.
 - CERTIFIED THAT ALL THE CLEARANCES/APPROVALS FROM OTHER RELEVANT GOVT. DEPTT. SHALL BE OBTAINED.
 - CERTIFIED THAT M.S. CANOPY SHALL CONFIRM TO SOUND ENGG. SPEC. AND THERE IS NO CHANCE OF ITS EVER CAVING-IN UNDER NORMAL CIRCUMSTANCES.
 - CERTIFIED THAT ALL FACILITIES AS SHOWN IN THE DRAWING SHALL BE INSTALLED/PROVIDED AT ABOVE KSK/RO.
 - ALL DIMENSION IN METER OTHERWISE SPECIFIED.

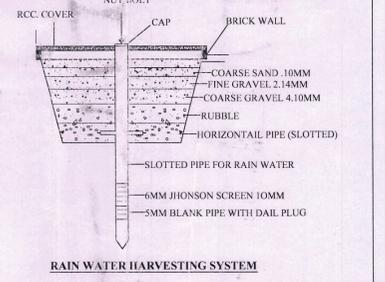

- LEGEND**
- | | |
|------------------------|----------------------------------|
| (A) FUEL STATION AHEAD | (E) NO ENTRY |
| (B) FUEL STATION | (F) FUEL STATION BOARD |
| (C) GIVEWAY | (G) COMPULSORY DIRECTION CONTROL |
| (D) ONE WAY | (H) NO RIGHT TURN |

TANK DATA CHART

TANK	SIZE OF TANK	MS PLATES SHELL	MS PLATES END	NO OF H.D.B. DIA.	VENT PIPE DIA.	SLAB TH. IN MM	TANK & PUMP MS	TANK & PUMP HSD
20 KL	2.1M X 6.25M. LONG	6mm	8mm	8	40	325	1+1	1+1

SITE DATA CHART

LOCATION	RATHDHANA
KHASRA NO.	120/17/1/2
KHEWAT NO.	218
KHATON NO.	233
POLICE ST.	SONIPAT
RAILWAY ST.	SONIPAT
TEHSIL	SONIPAT
DISTT.	SONIPAT
STATE	HARYANA
PIN CODE	131001

INDIAN OIL CORPORATION LIMITED, MARKETING DIVISION, PANIPAT DIVISIONAL OFFICE, PANIPAT.

TITLE:- SITE/LAYOUT PLAN OF IOCL RETAIL OUTLET RATHDHANA AND AKBARPUR BAROTA/NARELA, WML SONIPAT ROAD (ODR), RD 8.000 (LHS), AT VILLAGE RATHDHANA, TEHSIL & DISTT. SONIPAT (HARYANA).

DRG. NO. PDO/RO/RATHDHANA

DATE 17-01-2020

DRAWN BY:- DEV SHREE TRADERS

CHECKED BY

APPROVED BY

GATI BISH JAUHAL
Chief Div. Retail Sales Mgr.
Indian Oil Corporation Ltd.
Regional Office
Panipat Refinery
Panipat-132140