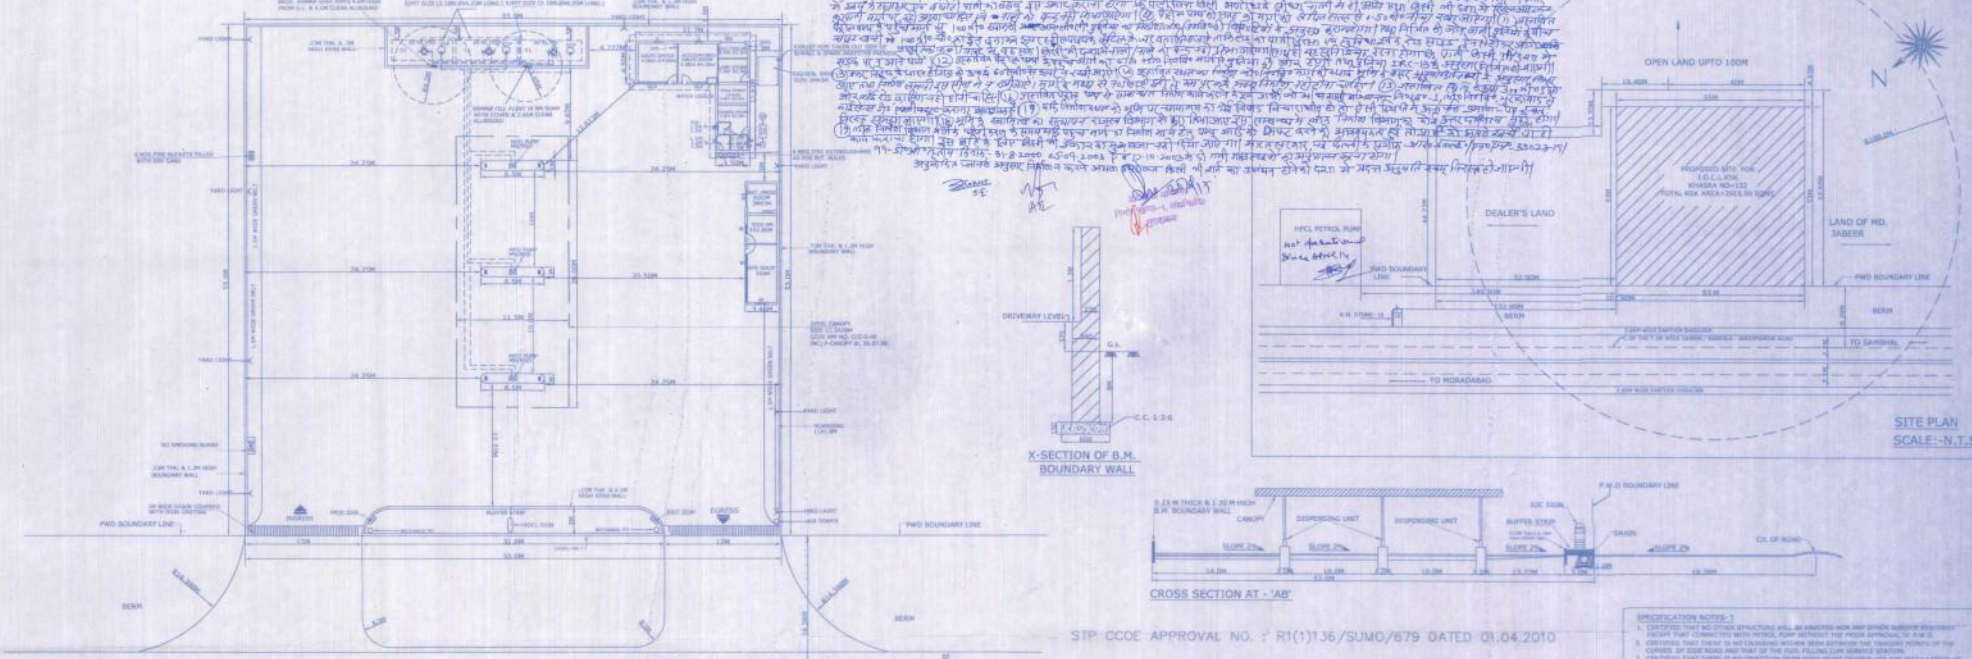

TANK SCHEDULE :-

TANK NO.	PRODUCT	CAPACITY
T1	MS	20KL
T2	HSD	20KL
T3	HSD	20KL

PUMP SCHEDULE :-

PRODUCT	NO.OF PUMP	NO.OF NOZZLE
MS	1	6
HSD	2	6

SITE INFORMATION

GATA NO.	132
VILLAGE	NASEERPUR KUNDARKI
ROAD	MORADABAD -SAMBHAL ROAD
TEHSIL	BILARI
DISTT.	MORADABAD
STATE	U.P.
POLICE STATION	MAINATHER
RAILWAY STATION	MORADABAD
PINCODE	244301

SPECIFICATION NOTES-:

1. CERTIFIED THAT NO OTHER STRUCTURE WILL BE ERECTED NOW AND OTHER SURROUNDING HIGHWAY THAN CONNECTED WITH PETROL PUMP WITHOUT THE PRIOR APPROVAL OF R.M.D.
2. CERTIFIED THAT THERE IS NO CROSSING WITHIN 30M BETWEEN THE TANGENT POINTS OF THE CURVES, BY SIDE ROAD AND THAT OF THE FUEL FILLING CUM SERVICE STATION.
3. CERTIFIED THAT THERE IS NO OBJECTION FROM ROAD POINT OF VIEW FOR THE INSTALLATION OF THIS PUMP. THE PROPOSAL WILL NOT AFFECT THE FUTURE IMPROVEMENT OF THE ROAD.
4. CERTIFIED THAT NO OTHER PETROL PUMP EXISTS WITHIN THE DISTANCE OF 300M ON EITHER SIDE OF THE PLOT.
5. CERTIFIED THAT ALL CONDITIONS LAID DOWN BY THE SDM/ DM UNDA AND ERC FROM TIME TO TIME WITH REGARD TO THE LOCATION OF ROAD SIDE FUEL FILLING CUM SERVICE STATIONS SHALL BE COMPLIED WITH & ENTIRE CONSTRUCTION WILL BE ON CORPORATION LAND.
6. NO DRAIN, SEWER OR STRUCTURE WITHIN 1.5M FROM UNDER GROUND TANKS.
7. SUCTION PIPES, UNDER DRIVEWAY HOUSED IN PIPE SLEEVES.
8. ELECTRIC FITTINGS CONFORM TO IS CODE NO-2148 FOR DISPENSING PUMP ONLY.
9. DPS BOARD IS FIXED 1.5M HIGH FROM FLOOR LEVEL AND WILL NOT BE KEPT UNDER LOCK AND KEY.
10. HOSING HEAT PIPES, 4M HIGH FROM GROUND LEVEL AND 4M CLEAR ALROUND. THE OPEN END OF HEAT PIPE COVERED WITH TWO LAYERS OF NOAH CONSIDERLE METAL WIRE GAUGE OF 0.0813 PER LINEAR CM.
11. BORING FILL PIPES, TO BE PROVIDED 3.05M CLEAR ALL ROUND.
12. FIRE FIGHTING EQUIPMENT:
   a. ROS 10KGM TYPE OF FIRE EXTINGUISHERS OF CAPACITY 5KG EACH FOR INFLAMMABLE FIRE, IRCS CODE TYPE FIRE EXTINGUISHERS OF CAPACITY OF 5KG EACH FOR FIGHTING ELECTRICAL FIRE AND SAND, OF FIRE BUCKETS FILLED WITH DRY SAND SHALL BE PROVIDED AT THE RETAIL PUMP.
13. CERTIFIED THAT THERE WILL NOT BE ANY HOUSEHOLDS FROM OVER HEAD HT LINES.
14. CERTIFIED THAT THE SURPLUS WATER WILL NOT BE DISPOSED OFF ON T.W.S.LAND.
15. CERTIFIED THAT ALL THE CONDITIONS OF INCI/ MB/CCOE SHALL BE COMPLIED WITH.

IMPORTANT NOTES-:

1. CERTIFIED THAT THIS IS A NEW RETAIL OUTLET.
2. CERTIFIED THAT NO COURT CASE IS PENDING IN ANY COURT OF INDIA AGAINST THIS SITE/DEALERSHIP.
3. CERTIFIED THAT ALL THE CLEARANCES/APPROVALS FROM MOEF AND OTHER RELEVANT DEPT. DEPTT. SHALL BE OBTAINED.
4. CERTIFIED THAT ALL FACILITIES AS SHOWN IN THE DRAWING SHALL BE INSTALLED/PROVIDED AT ABOVE R/D.
5. STEEL CANOPY APPROVAL NO. CCE G-46 (NC) P-CANOPY dt. 26.07.99.

SPECIFICATIONS FOR TANKS:-

1. MS TANK OF 20KL CAPACITY FABRICATED AS PER DRG. APPROVED BY CCE VIDE LETTER NO. P-4(3) 53 DATED 23.01.2007.

LOI NO.- NOOI17P0001010UP0080013/1300/00003 DATED:- 12/05/2017
NAME OF LOI HOLDER- MOHD NAIM S/O SH. KALLU HUSSAIN
LOCATION - NASEERPUR KUNDARKI , MORADABAD TYPE OF RO - NEW KSK

REV. NO.	DESCRIPTION	DATE	REV. BY	APP. BY

IndianOil

INDIAN OIL CORPORATION LTD.
(MARKETING DIVISION)
MORADABAD DIVISIONAL OFFICE

PROJECT:- PROPOSED KISAN SEWA KENDRA AT VILL.-NASEERPUR KUNDARKI, ON MORADABAD - SAMBHAL ROAD, DIST:T - MORADABAD (U.P.)

TITLE:- SITE & LAYOUT PLAN OF RETAIL OUTLET

DRAWN BY:- QASIM | DRG NO.:- KSK/MOD/NASEERPUR
SCALE:- AS SHOWN | DATE:-
CHKD BY:- | CHKD BY:-
RECOMND BY:- | APPRD BY:-
CONSULTANT:- M/S ARAVALI PMC (CONSULTING) NEW DELHI PH. 011-40307408,+91-8527337362