



Punjab State Power Corporation Limited

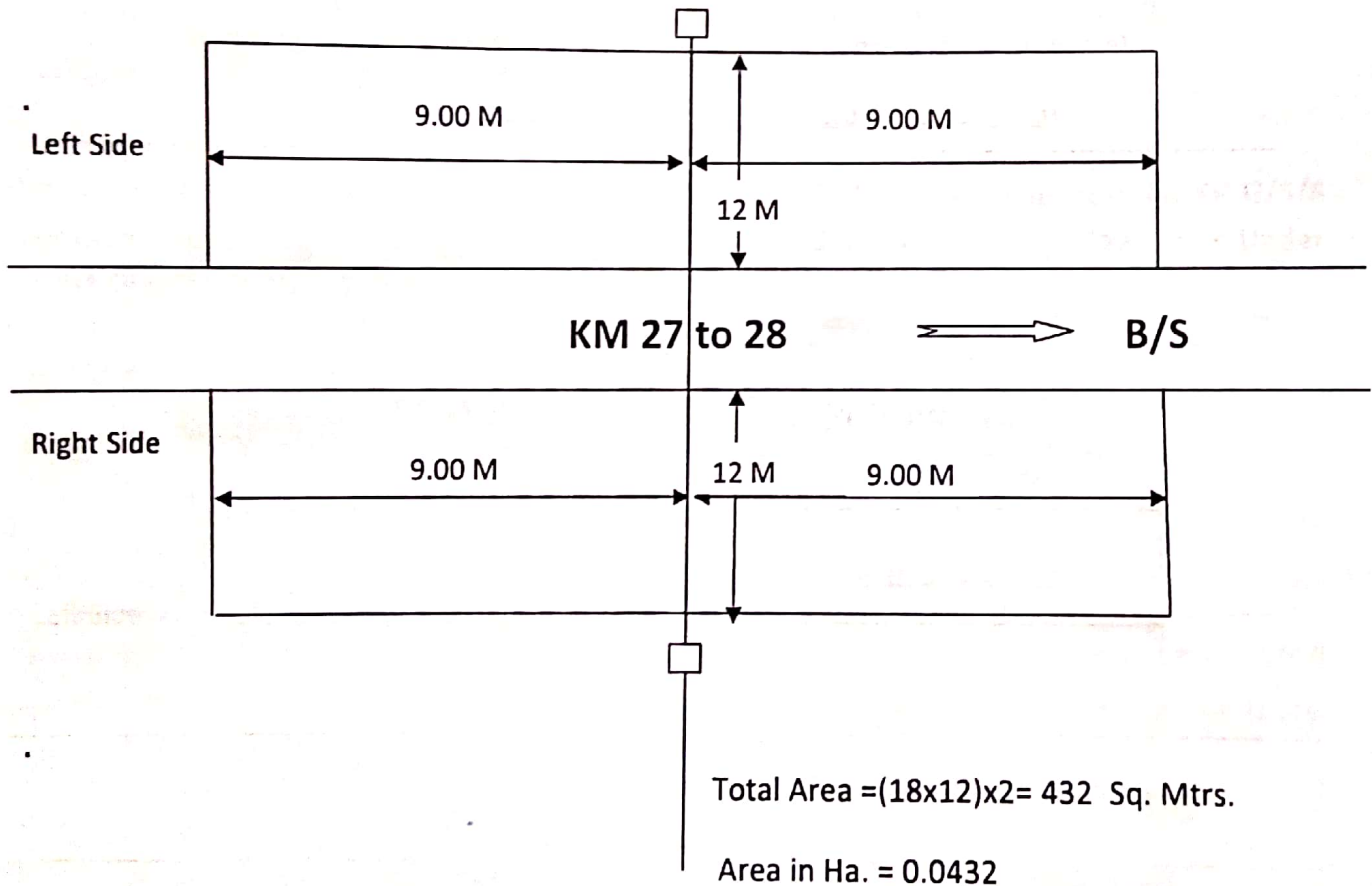
O/o Senior Executive Engineer, Transmission Lines Division, Patiala.

Address:- Officers Flat no. 24, Shakti Vihar, Patiala.

Mob:- +919646123955, Email:- adlsetlpta@gmail.com

Diversion of 0.0594 Ha. of forest land in favour of PSPCL for 66 KV line from 66 KV G/S/S Devigarh to 66 KV G/S/S Roharjagir T-Off for 66 KV G/S/S Bhasmara SC/DC Tower line Under Forest Division Patiala & Distt.Patiala.


MARKING LIST- Patiala Pehowa Rd




Total Trees = 8

Place: PATIALA

Dated: 19.09.2019


Er. Harjeet Singh
Sr. Executive Engineer
TL Divn. PSPCL, PATIALA


Asstt. Executive Engineer,
TL Subdivision, PSPCL,
PATIALA



Punjab State Power Corporation Limited

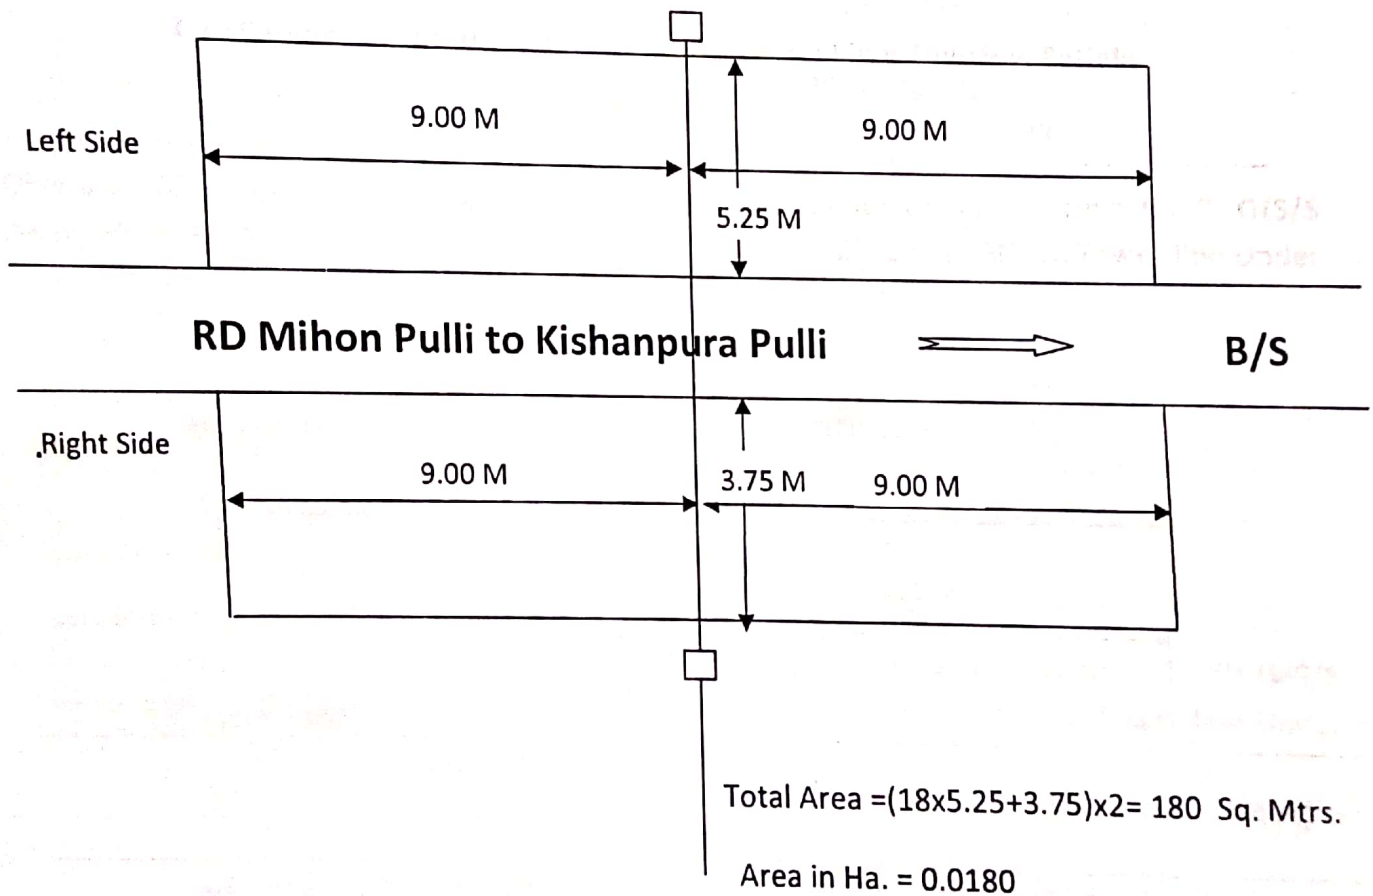
O/o Senior Executive Engineer, Transmission Lines Division, Patiala.

Address:- Officers Flat no. 24, Shakti Vihar, Patiala.

Mob:- +919646123955, Email:- adlsetlpta@gmail.com

Diversion of 0.0594 Ha. of forest land in favour of PSPCL for 66 KV line from 66 KV G/S/S Devigarh to 66 KV G/S/S Roharjagir T-Off for 66 KV G/S/S Bhasmara SC/DC Tower line Under Forest Division Patiala & Distt.Patiala.


MARKING LIST- Ghadham Distributary




Total Trees = 0

Place: PATIALA

Dated: 19.09.2019


Er. Harjeet Singh
Sr. Executive Engineer
TL Divn. PSPCL, PATIALA


Asstt. Executive Engineer,
TL Subdivision, PSPCL,
PATIALA

UNDERTAKING


I Er. Harjeet Singh, Senior Executive Engineer, TL Division, PSPCL, Patiala hereby affirm and declare that: -

- 1) That we have applied to the State Forest Department for cutting of trees for Construction of 66 KV Tower line from 66 KV G/S/S Devigarh to 66 KV G/S/S Roharjagir T-Off for 66 KV G/S/S Bhasmara SC/DC Tower line.
- 2) That the State Government has not fixed the price for non forest land, whatever it is fixed the said amount will be deposited.

Deponent

Place: PATIALA

Dated: 19.09.19


Er. Harjeet Singh
Senior Executive Engineer
TL Division, PSPCL, PATIALA


Verification:

It is certified that the above statement is true and correct to the best of my knowledge and nothing is concealed.

Deponent

Place: PATIALA

Dated: 19.09.19


Er. Harjeet Singh
Senior Executive Engineer
TL Division, PSPCL, PATIALA