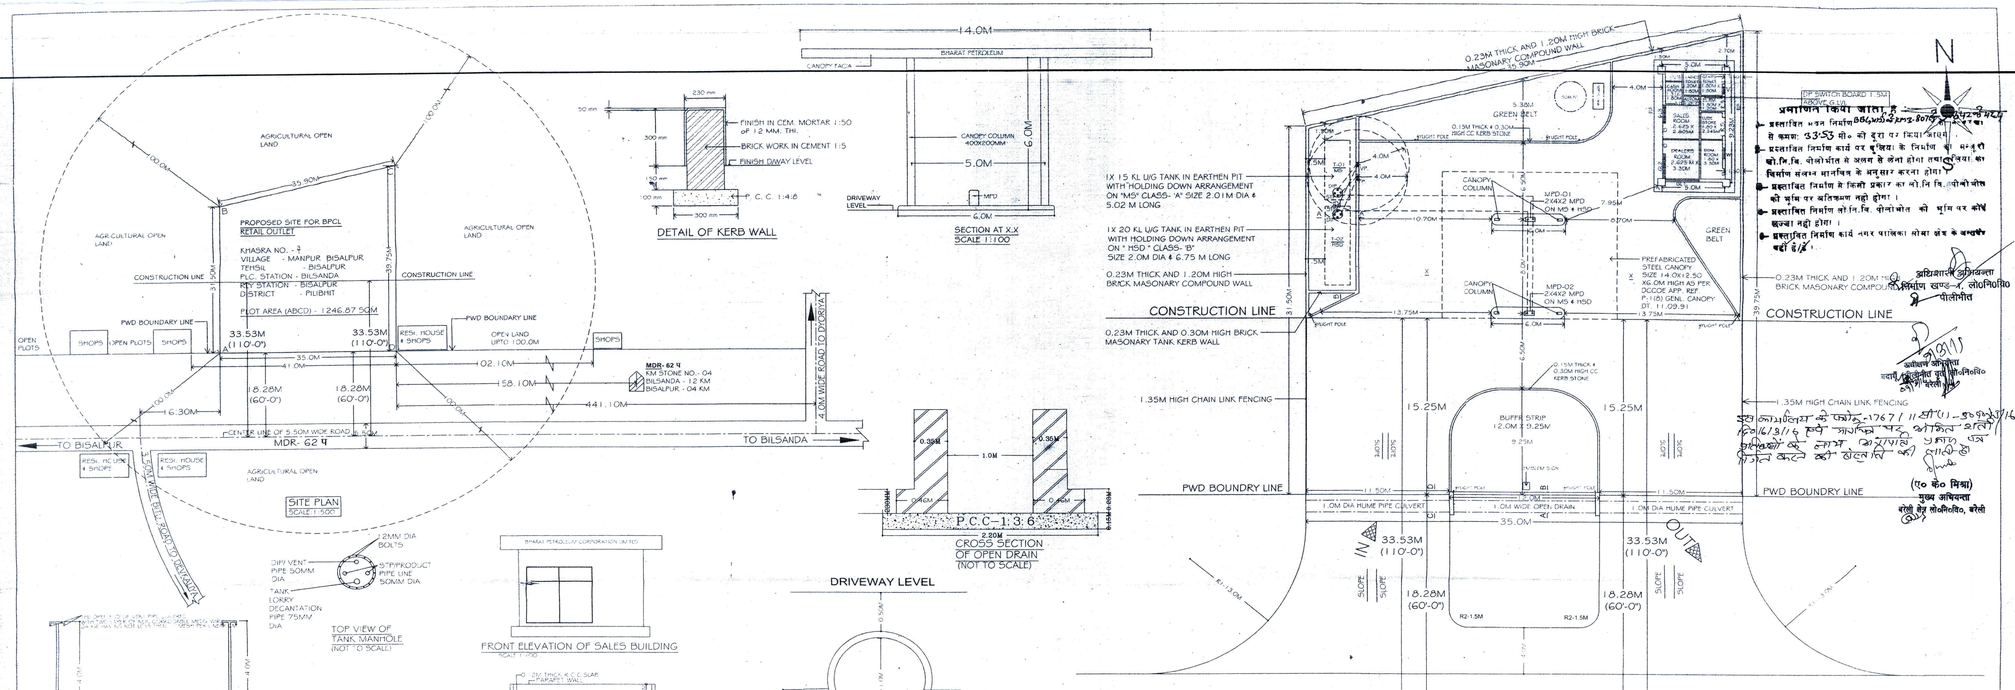


प्रमाणित किया जाता है ... पत्र सं. ... दिनांक ...
1. प्रस्तावित भवन निर्माण ... से कम: 9.255 मी.॰ की दूरी पर किया जायेगा ।
2. प्रस्तावित निर्माण कार्य पर भूमिज: के निर्माण की मंजूरी जो.नि.वि. पीलीभीत से अलग से लेना होगा तथा भूमिज: का निर्माण संबन्ध मानचित्र के अनुसार करना होगा ।
3. प्रस्तावित निर्माण के किसी प्रकार का जो.नि.वि. पीलीभीत की भूमि पर अतिक्रमण नही होगा ।
4. प्रस्तावित निर्माण जो.नि.वि. पीलीभीत की भूमि पर कोई क्षत्रा नही होगा ।
5. प्रस्तुतावित निर्माण कार्य नगर पालिका सीमा क्षेत्र के अन्तर्गत नहीं है/है ।

प्रविधिवार्ता अभियन्ता
निर्माण खण्ड-1, लो0नि0नि0
पीलीभीत

अधिशासी अभियन्ता
लो0नि0नि0 इकाई पीलीभीत
बरेली क्षेत्र

(ए० के० मिश्रा)
मुख्य अभियन्ता
बरेली क्षेत्र लो0नि0नि0, बरेली

NOTES:
1.VENT PIPE 4.0M HIGH END COVERED WITH TWO LAYERS OF BRASS WIRE GAUGE 11 MESH PER LINEAR CENTIMETER.
2.TANK LORRY
3.DIP PIPES WITH CAP ASSEMBLY
4.ALL ELECTRICAL FITTINGS ARE FLAME PROOF CONFORMING TO IS 2148 WITHIN 6.0M OF TANK AND MPD.
5.ALL DOORS OF BUILDING TO BE OPENED OUTWARD ONLY
6.NO SEWER OR SURFACE DRAIN WITH IN 6.0M OF U/G TANK & DISPENSING UNITS
7.PREMISES TO BE USED ONLY FOR STORAGE OF PETROLEUM PRODUCTS.
8.TANKS ARE PAINTED WITH TWO LAYERS OF HOT BITUMEN OVER TWO COATS OF RED OXIDE PRIMER TO PROTECT AGAINST CORROSION.
9.FABRICATION DESIGN OF UNDER GROUND STORAGE TANK ARE CONFORMING TO IS 10987:1992 AS PER C.C.O.E.
10.ALL DIMENSIONS ARE IN MM UNLESS OTHER WISE NOTED
11.SAND BUCKETS 5 NOS AS PER EXPLOSIVE RULES
12.FIRE EXTINGUISHERS 4 NOS AS PER EXPLOSIVE RULES
13.[illegible] TEST PRESSURE OF 0.3 KG/SQ.CM FOR 2HOURS. DURING THE TEST PERIOD THE TANK SHALL BE PAINTED WITH SOAP SOLUTION AND BUBBLES IF ANY NOTED SHALL BE RECTIFIED.
COATING AS APPLIED. THE TEST SHOULD BE MAINTAINED AT CONTROLLED PRESSURE OF 0.3G KG/SQ.CM FOR 2HOURS.
14.DIP RODS SUPPLIED WITH TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3280MM LONG INSTEAD OF STANDARD 2350MM
15.FABRICATION TOLERANCES OF SHELL PLATES AND END PLATES OF TANK 20KI SHELL CUM AND END 8MM
16.TANKS CONFORM TO RULES 124 , 125 & 131 OF THE PETROLEUM RULES 2002
17.ALL LIGHT POLES ARE FITTED AS PER APPROVEL OF CCOE NAGPUR VIDE LETTER NO PL-III (MS) DATE 26.11.1963
18.NATURAL DOWN SLOPE FROM THE EDGE OF METTALED ROAD TO CULVERT ON APPROCHES MAINTAINED FREE FLOW OF WATER TOWARDS DRAIN.
19.EV = EXTENDED VENT POINT
20.PROPER ARRANGMENT OF LIGHT POLES IN LICENSED PREMISES
21. NO ELECTRICAL LINE IS PASSING OVER LICENSED PREMISES.

LEGEND
PROP. WORK SHOWNIN RED

AREA STATMENTS
TOTAL PLOT AREA - 1246.87 SQM
COV.AREA OF SALES BUILDING - 46.15 SQM
PROPOSED COVERED AREA 175.00 SQM
TOTAL COVERED AREA 221.15 SQM
OPEN AREA 1025.72 SQM

TANKS AND PUMPS DETAIL

| S.NO | ITEM | SIZE | PETROLEUM CLASS | PRODUCT |
|---|---|---|---|---|
| 1 | TANK T-01 | 2.01M DIA X 5.02M LONG | CLASS "A" | MS |
| 2 | TANK T-02 | 2.0M DIA X 6.75M LONG | CLASS "B" | HSD |
| 3 | MPD -01 | 2PX4HX4 DISPLAY | CLASS "A & B" | MS & HSD |
| 4 | MPD -02 | 2PX4HX4 DISPLAY | CLASS "A & B" | MS & HSD |

BHARAT PETROLEUM CORPORATION LIMITED
SUBJECT - LAY OUT PLAN OF NEW RETAIL OUTLET / SERVICE STATION STN

| | |
|---|---|
| PLOT / KHASRA NO. | 2 |
| TOWN / VILLAGE | MANPUR BISALPUR |
| NEAREST RLY.STATION | BISALPUR |
| NEAREST POLICE STATION | BISALPUR |
| LITIGATION AREA | DISTRICT: PILIBHIT, STATE: UTTAR PRADESH |

| DRG. NO | DATE | SCALE | PREPARED BY | CHECKED BY |
|---|---|---|---|---|
| NRO BISALPUR | | AS SHOWN | SARA ENGINEERING CONCEPT | |