


पुनर्मोजणीचा नकाशा  
मोक्या प्रमाणे अद्यावत केलेला नकाशा  
अद्यावतीकरणा वर्ष १९९०-९१

[illegible]

| SPECIALTY, EQUIPMENT AND REQUIREMENTS<br>FOR LAYING & CONSTRUCTION OF 120KV DCB CYC TOWER LINE |                          |      |          |         |        |        |      |      |              |
|------------------------------------------------------------------------------------------------|--------------------------|------|----------|---------|--------|--------|------|------|--------------|
| Sl. No.                                                                                        | Name of the Material     | Unit | Quantity |         | Rate   | Amount | Unit | Rate | Total Amount |
|                                                                                                |                          |      | Estimate | Revised |        |        |      |      |              |
| <b>1. Material</b>                                                                             |                          |      |          |         |        |        |      |      |              |
| 1.                                                                                             | 1. Specially Corrida     | 230  | 75       | 20      | 1005   | 0.15   | 397  |      |              |
| <b>2. Manpower</b>                                                                             |                          |      |          |         |        |        |      |      |              |
| 2.                                                                                             | 2. Manpower Corrida      | 180  | 12       | 27      | 645    | 0.042  | 2.1  |      | 4.284        |
| <b>3. Machine</b>                                                                              |                          |      |          |         |        |        |      |      |              |
| 3.                                                                                             | 3. Machine Corrida       | 440  | 12       | 27      | 324.00 | 0.035  | 2.1  |      |              |
| <b>4. Transportable Corrida</b>                                                                |                          |      |          |         |        |        |      |      |              |
| 4.                                                                                             | 4. Transportable Corrida | 875  | 80       | 265     | 2,140  | 0.216  | 2.1  |      |              |
| <b>5. Others Corrida</b>                                                                       |                          |      |          |         |        |        |      |      |              |
| 5.                                                                                             | 5. Others Corrida        | 619  | 210      | 27      | 9070   | 0.897  | 2.1  |      |              |
| <b>6. Others</b>                                                                               |                          |      |          |         |        |        |      |      |              |
| 6.                                                                                             | 6. Others                | 608  | 48       | 27      | 1765   | 0.782  | 2.1  |      |              |
| <b>Total Estimate &amp; Revised Amount</b>                                                     |                          |      |          |         |        |        |      |      | 2244.18      |

| LEGEND |                                         | SYMBOL            |                      |
|--------|-----------------------------------------|-------------------|----------------------|
| 1.     | 13% KV DC CONDUIT 5/8" - HIRDAAMU RTS'S | TR LINE ALIGNMENT | (Length = 17.261 km) |
| 2.     | FOREST AREA                             |                   |                      |
| 3.     | REQUIRED FOREST AREA                    |                   |                      |

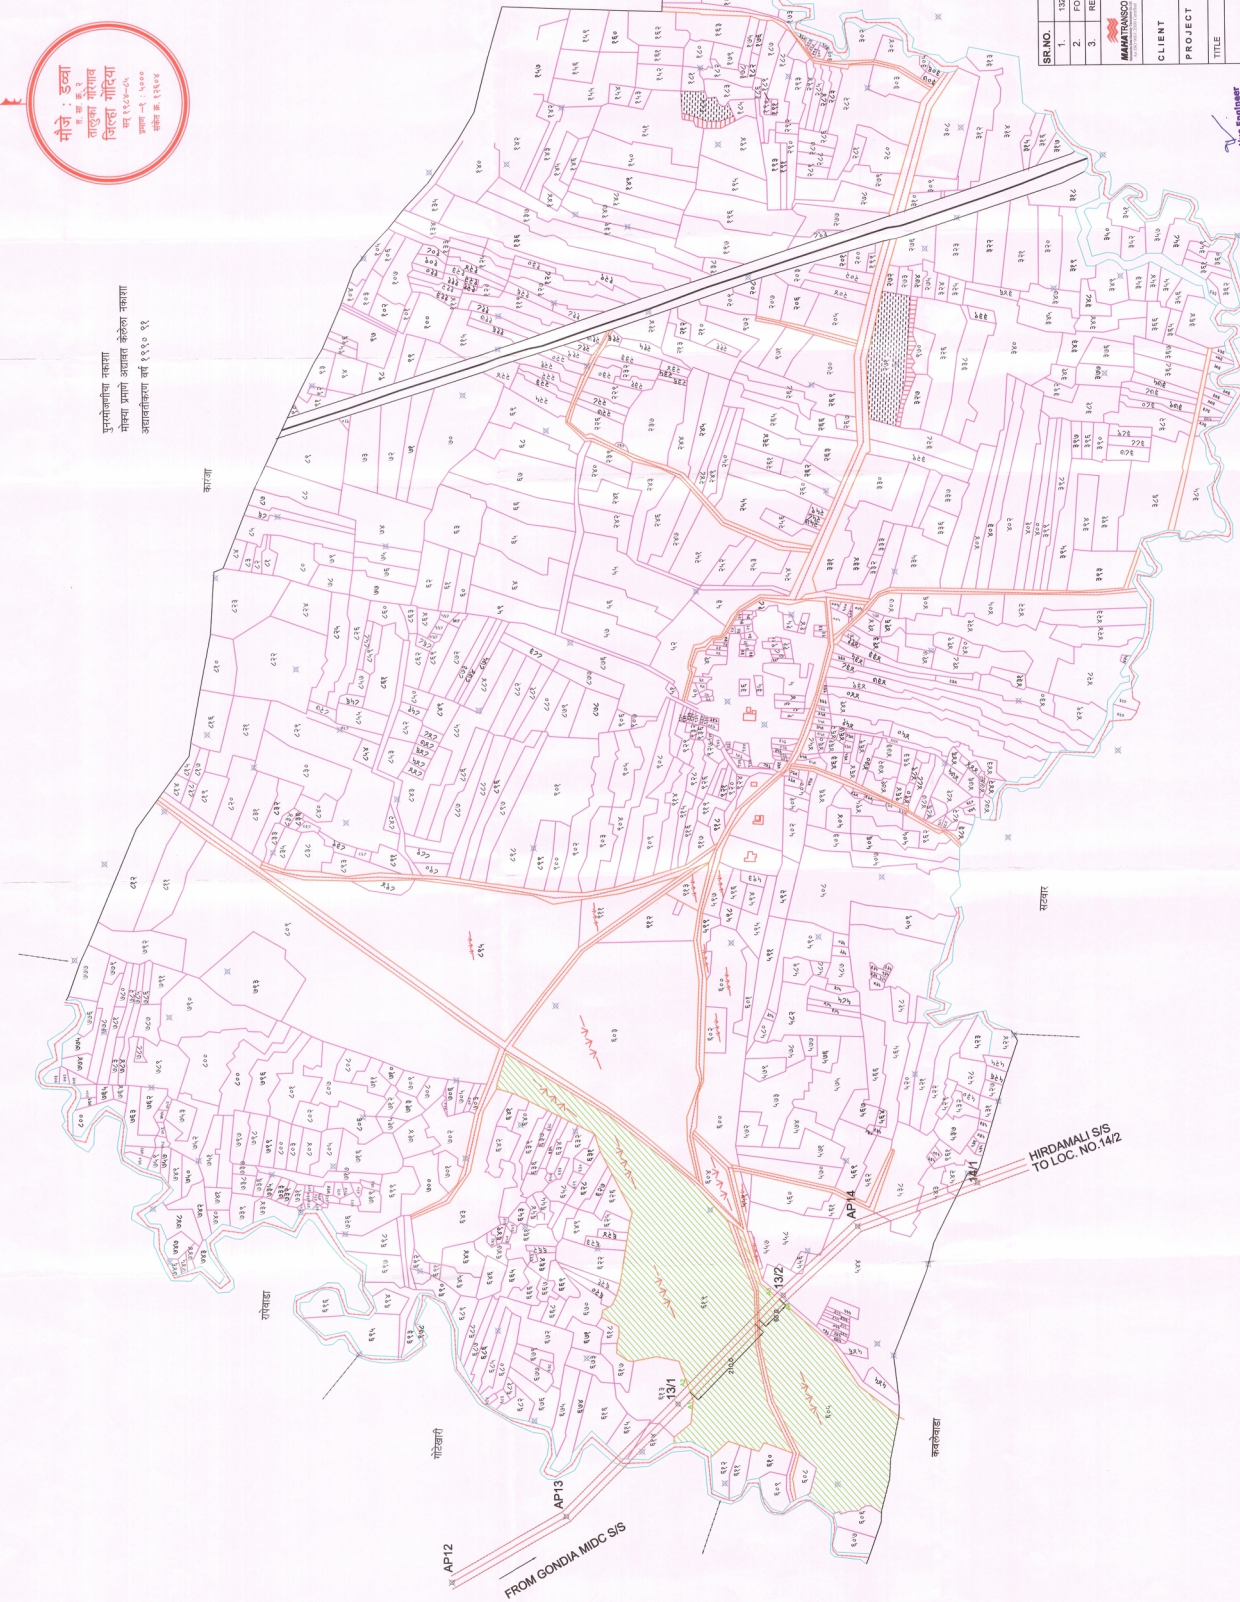

**MAHA RASHTRA  
POWER TRANSMISSION  
CORPORATION**

**MAHARASHTRA STATE ELECTRICITY  
TRANSMISSION CO. LTD.**

**DY. CHIEF ELECTRICAL ENGINEER,  
RLY. ELECTRIFICATION, NAGPUR**

**13% KV CONDUIT 5/8" - HIRDAAMU RTS'S DC  
TRANSMISSION LINE**

**SHEET NO**  
0005

**APPROVED BY**

| CLIENT | PROJECT | TITLE                                                  | SCALE      | CHECKED BY | SUBMITTED BY |
|--------|---------|--------------------------------------------------------|------------|------------|--------------|
|        |         | VILLAGE MAP SHOWING FOREST AREA REQUIRED FOR ALIGNMENT | DRAWING NO |            |              |
|        |         | METELC0004004-HIRDAAMU RTS'S 12KV/13KV/14KV MAP        |            |            |              |
|        |         |                                                        |            |            |              |

Executive Engineer  
E.H.V. Project Dn.II  
S.T.C.L. Nagpur