


# LAYOUT PLAN OF BARODA TANK SCHEME

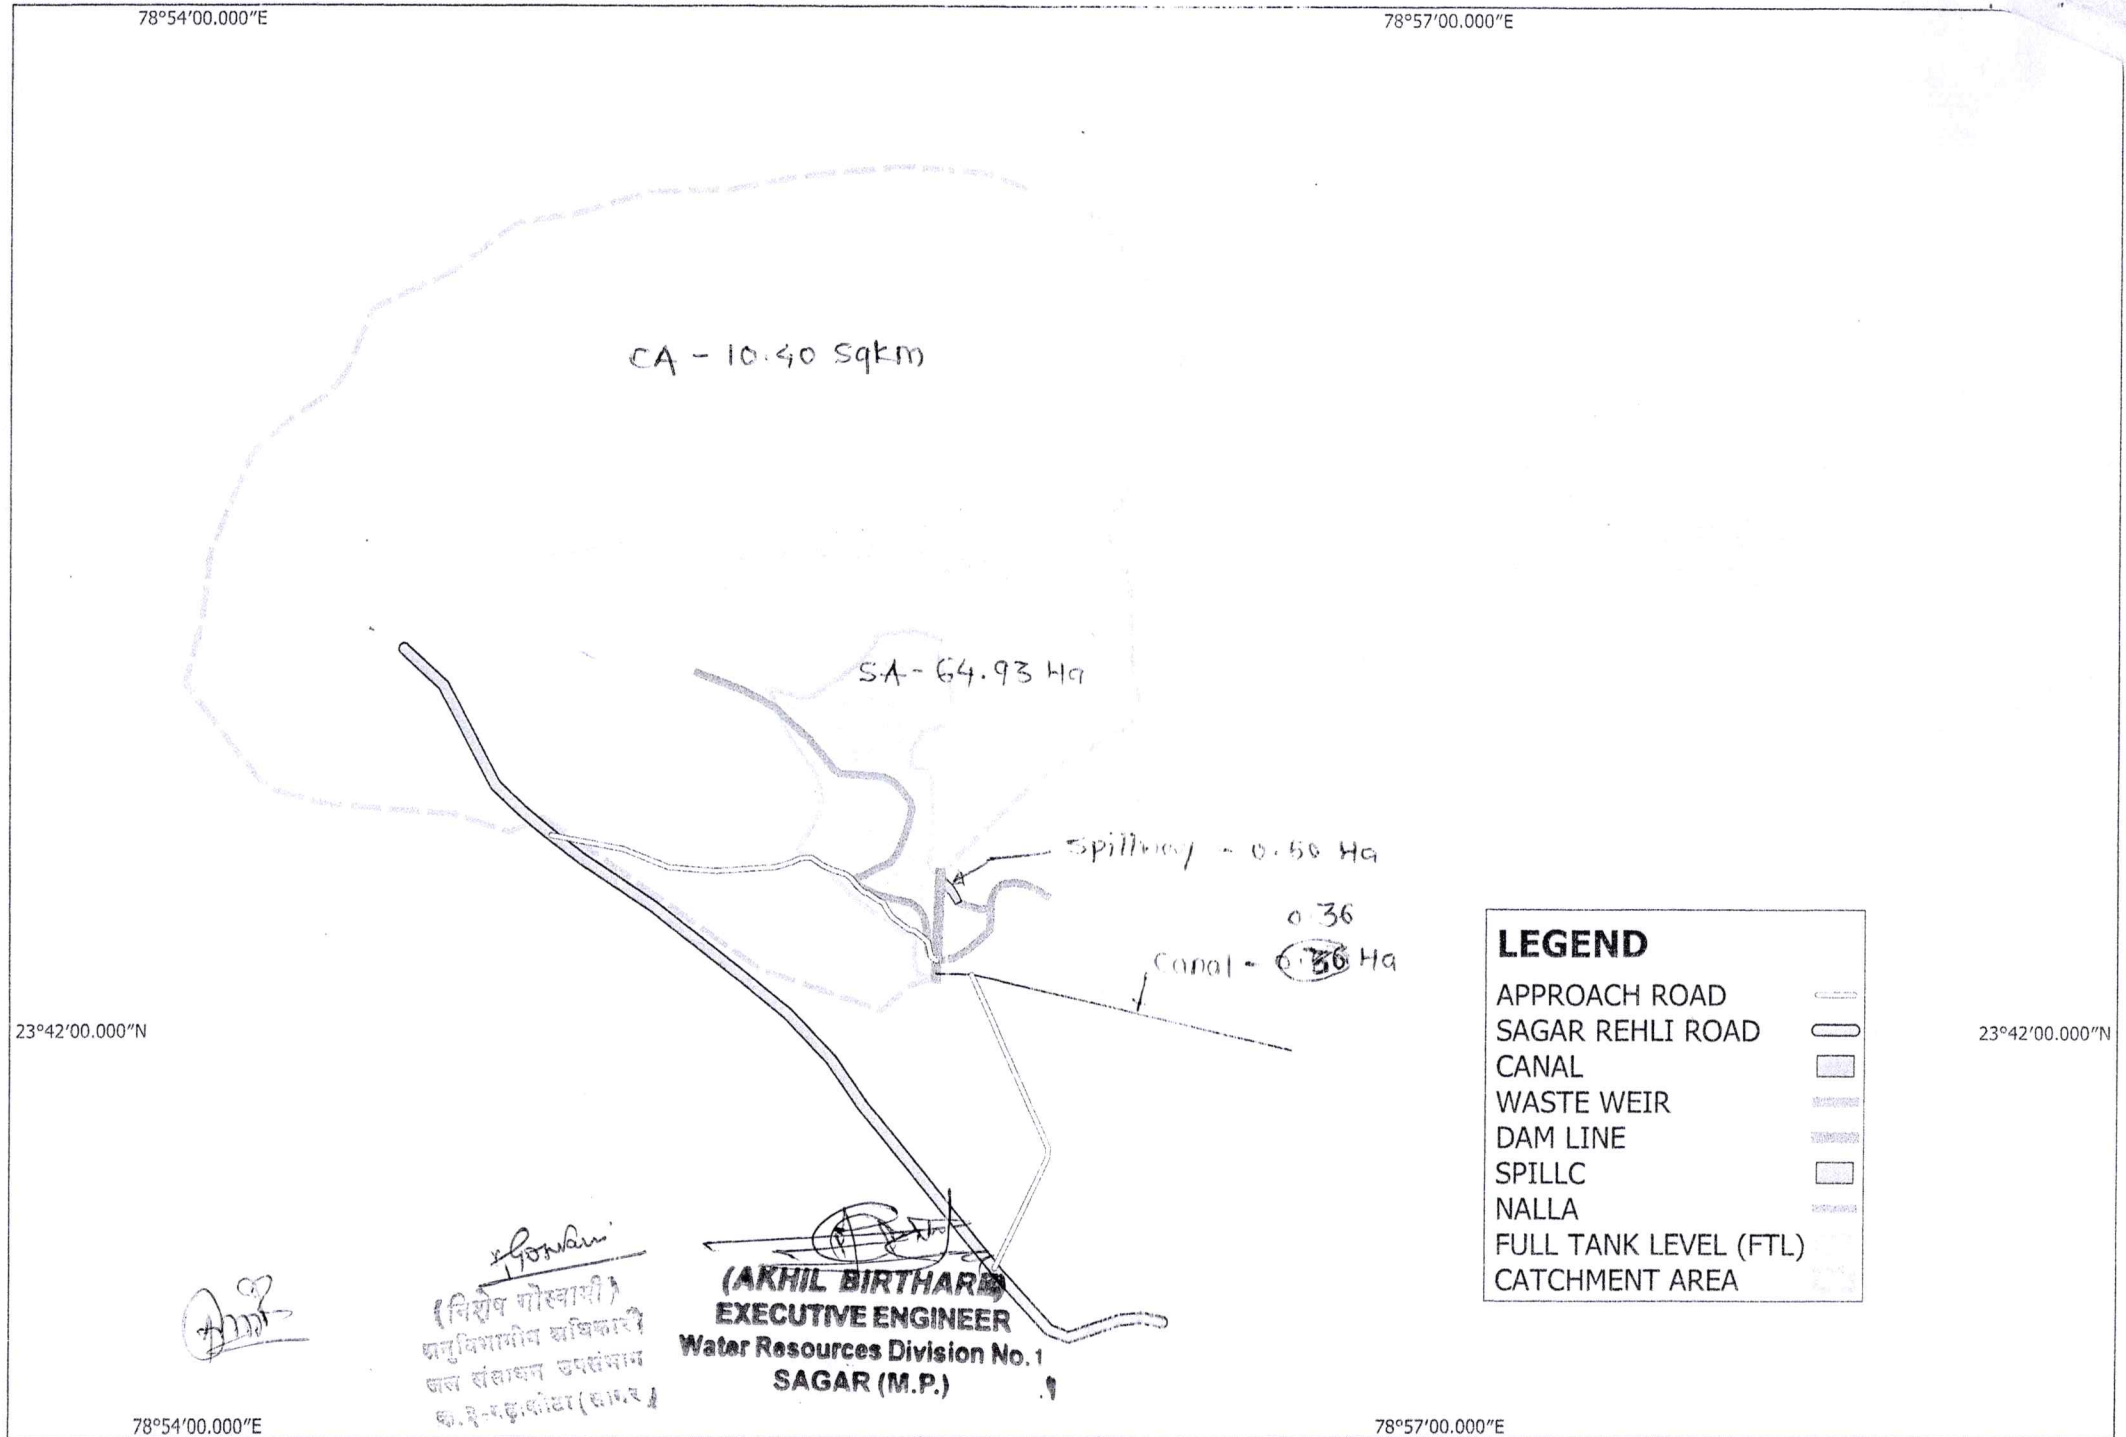

## BARODA TANK SCHEME

### COMPOSITIONWISE AREA BREAKUP OF FOREST LAND


SUBMERGENCE AREA UNDER FOREST(inc. damsheets) = 20.20 Ha

AREA REQUIRED FOR RAILWAY = 0.50 Ha

AREA REQUIRED FOR CANAL = 0.36 Ha

---

TOTAL FOREST LAND REQUIRED = 21.06 Ha



(सिद्धेश मोस्वामी)  
प्रमुख निदेशक  
पत्र संसाधन विभाग  
रा.सं.सं.सं.सं.सं.



(AKHIL BIRTHAR)  
EXECUTIVE ENGINEER  
Water Resources Division No. 1  
SAGAR (M.D.)