



i) MIN.CLEARANCE AS PER REC CONSTRUCTION STANDARD M-7 IS 5200+1110+400=6710MM

NOTE:—

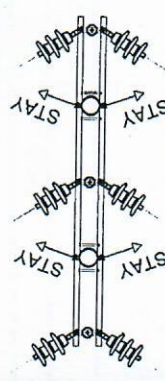
1. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE MENTIONED.
2. POLE FOUNDATION DRAWING SHALL BE SUBMITTED SEPARATELY.
3. 8 SWG EARTH WIRE SHALL BE CONNECTED FROM POLE TO POLE THROUGH BACK CLAMP OF CROSS ARM.
4. ALL MILD STEEL FABRICATED ITEMS SHALL BE HOT DIP GALVANIZED. PREFORMED INSULATOR BINDING TO BE PROVIDED FOR EACH PIN INSULATOR TO FIX CONDUCTOR.
5. THE PROTECTIVE ANGLE OF 45 DEG. TAKEN AS PER IS 2309 CLAUSE 8.2.1
6. OPGW JOINT BOX SHALL BE PROVIDED WHEREVER JOINING OF OPGW IS REQUIRED

* EARTHING WILL BE DONE ON 4 POLES PER KM. ON AVERAGE.

** GUARDING SHALL BE DONE AT ALL CROSSINGS AND LINE PASSING THROUGH THE POPULATED AREA WHERE MIN. CLEARANCE REQUIRED AS PER REC STANDARD M-6 IS 6.1MTR.

[illegible][illegible]

	R4	REVISED AS PER COMMENTS	27.06.2017
	R3	REVISED AS PER COMMENTS	25.04.2017
	R2	REVISED AS PER COMMENTS	21.02.2017
	R1	REVISED AS PER COMMENTS	13.02.2017
	R0	SUBMISSION FOR APPROVAL.	30.12.2016
	REVISION,	DESCRIPTION.	ISSUE DATE

[illegible]

- NOTE: 1. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE MENTIONED.
2. POLE FOUNDATION DRAWING SHALL BE SUBMITTED SEPARATELY
3. 8 SWG EARTH WIRE SHALL BE CONNECTED FROM POLE TO POLE THROUGH BACK CLAMP OF CROSS ARM.
4. ALL MILD STEEL FABRICATED ITEMS SHALL BE HOT DIP GALVANIZED.
5. THE PROTECTIVE ANGLE OF 45 DEG. TAKEN AS PER IS 2309 CLAUSE 8.2.1
6. OPEN JOINT BOX SHALL BE PROVIDED WHEREVER JOINING OF OPW IS REQUIRED
7. EARTHING WILL BE DONE ON 4 POLES PER KM. ON AVERAGE.
8. GROUNDING SHALL BE DONE AT ALL CROSSINGS AND LINE PASSING THROUGH THE POPULATED AREA WHERE MIN. CLEARANCE REQUIRED AS PER REC STANDARD M-6 IS 6.1MTR.
9. DANGER PLATE AND BARBED WIRE SHALL BE ON BOTH SIDE OF CROSSING.

PLAN

NOTE:— 1. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE MENTIONED

2. POLE FOUNDATION DRAWING SHALL BE SUBMITTED SEPARATELY.

3.8 SWG EARTH WIRE HSALL BE CONNECTED FROM POLE TO POLE

BACK CLAMP OF CROSS ARM.

4. ALL MILD STEEL FABRICATED ITEMS SHALL BE HOT DIP GALVANIZED

PREFORMED INSULAGR BINDING TO BE PROVIDED FOR EACH PIN TO FIX CONDUCTOR

5. THE PROTECTIVE ANGLE OF 45 DEG. TAKEN AS PER IS 2309 CL

6. OPGW JOINT BOX SHALL BE PROVIDED WHEREVER JOINING OF

OPGW IS REQUIRED

- EARTHING WILL BE DONE ON 4 POLES PER KM. ON AVERAGE.
- GUARDING SHALL BE DONE AT ALL CROSSINGS AND MAIN RAILWAYS.

THE POPULATED AREA WHERE MIN. CLEARANCE REQUIRED AS BE

STANDARD M-6 IS 5.1 MTR.

* DANGER PLATE AND BARBED WIRE SHALL BE ON BOTH SIDE OF

R4	REVISED AS PER COMMENT
----	------------------------

R3	REVISED AS PER COMMENT
----	------------------------

	R2	REVISED AS PER COMMENT
--	----	------------------------

[illegible]

REVISED AS PER COMMENT	REVISIONS
R0	ADD EXTRA REGIONAL

DATE	
NAME	
ADDRESS	
CITY	
STATE	
ZIP	
TELEPHONE	
SUBMISSION FOR APPROVAL	

REVISION.	DESCRIPTION.
-----------	--------------

TECHNOTAB ENGINEERING LTD.
