

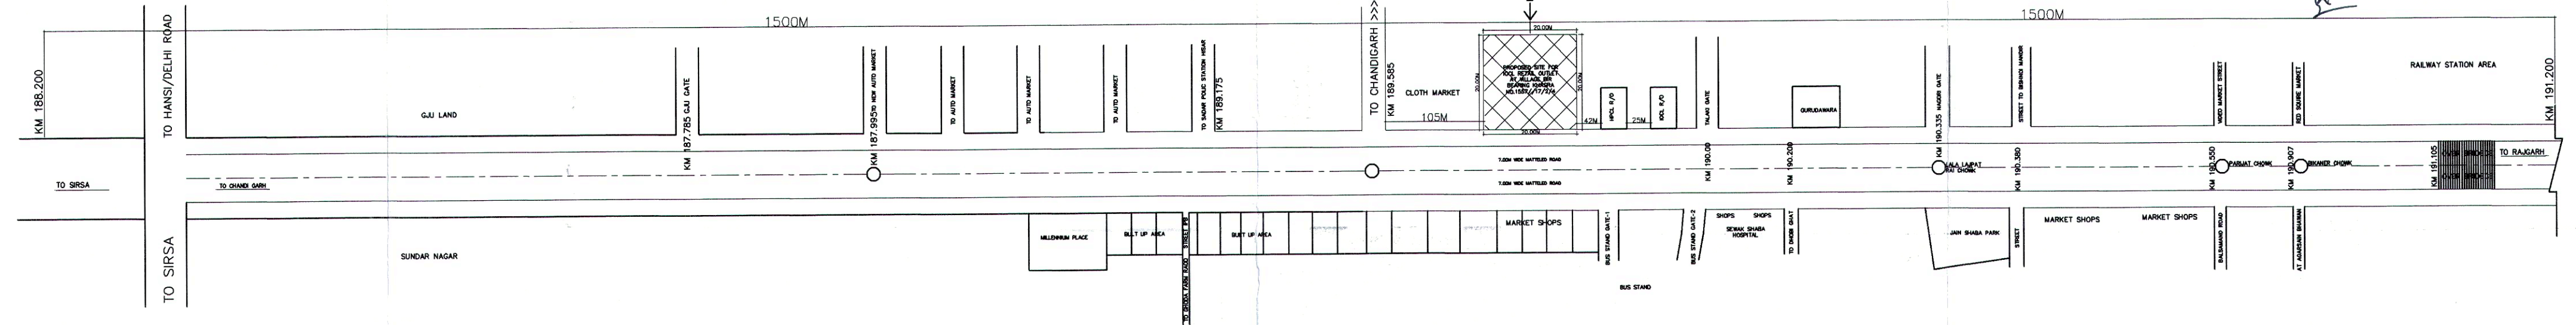
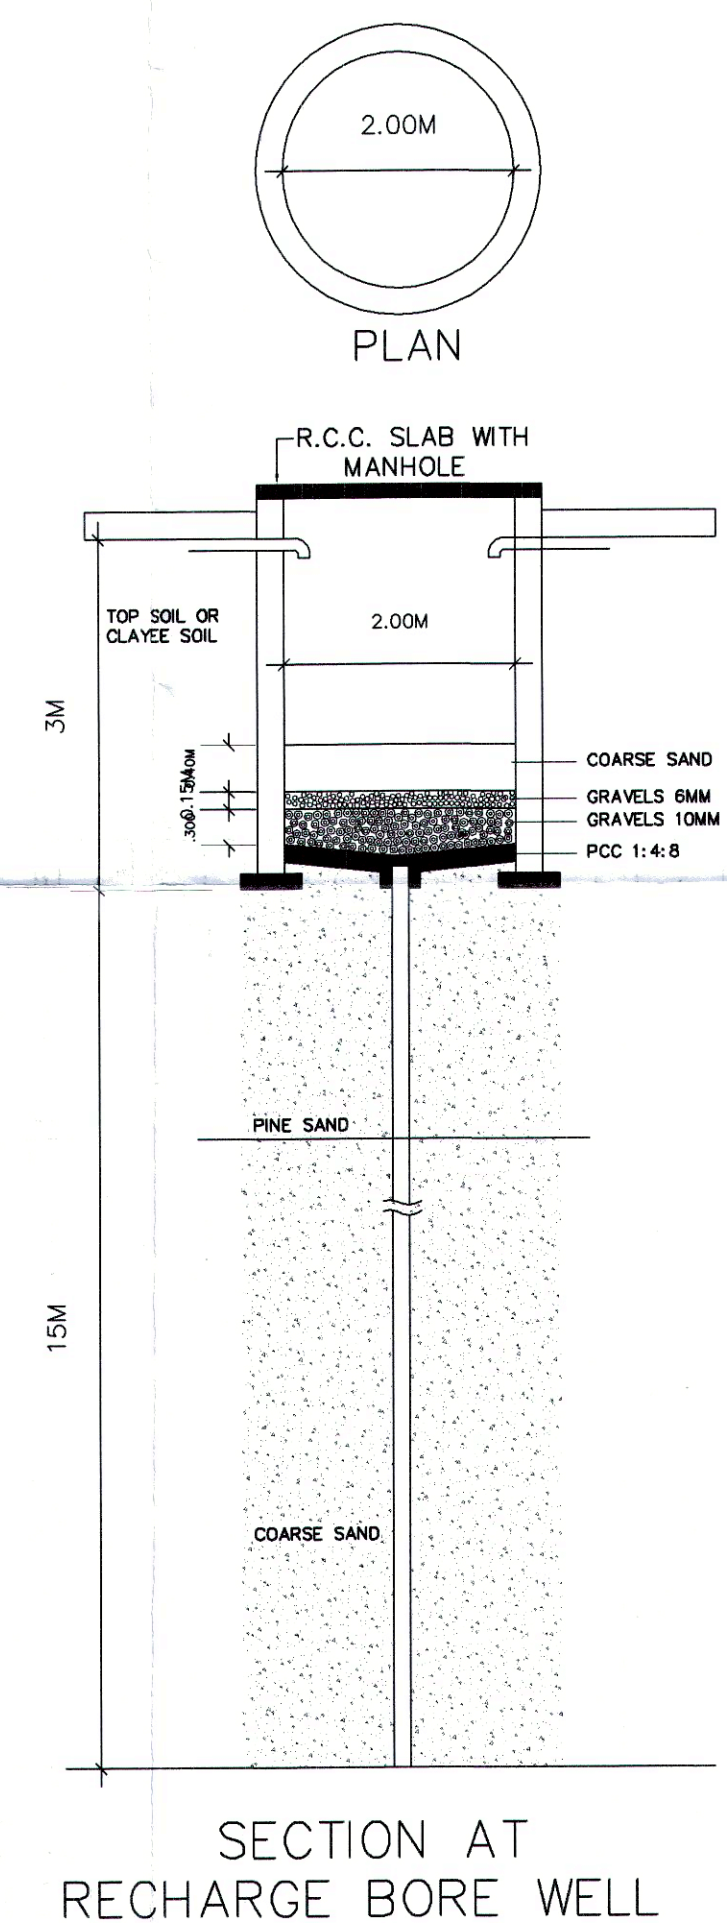
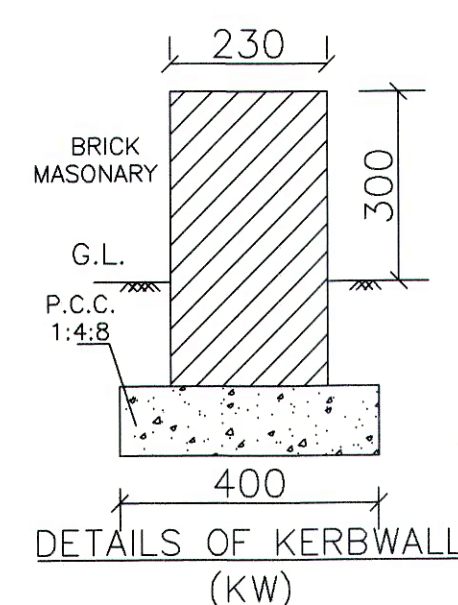
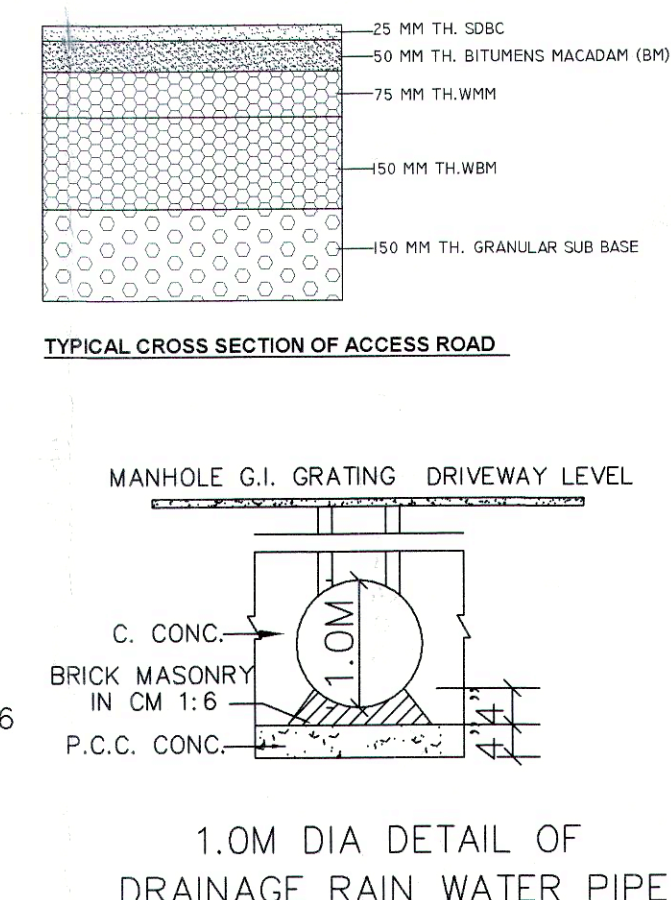
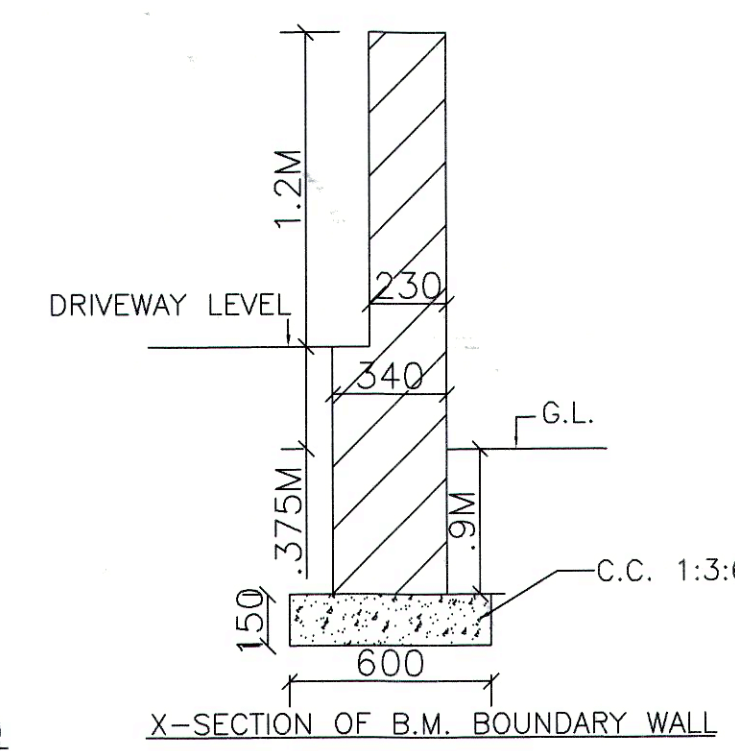


Executive Engineer
Provincial Divn. No. 1
PWD B&R Br. HISAR

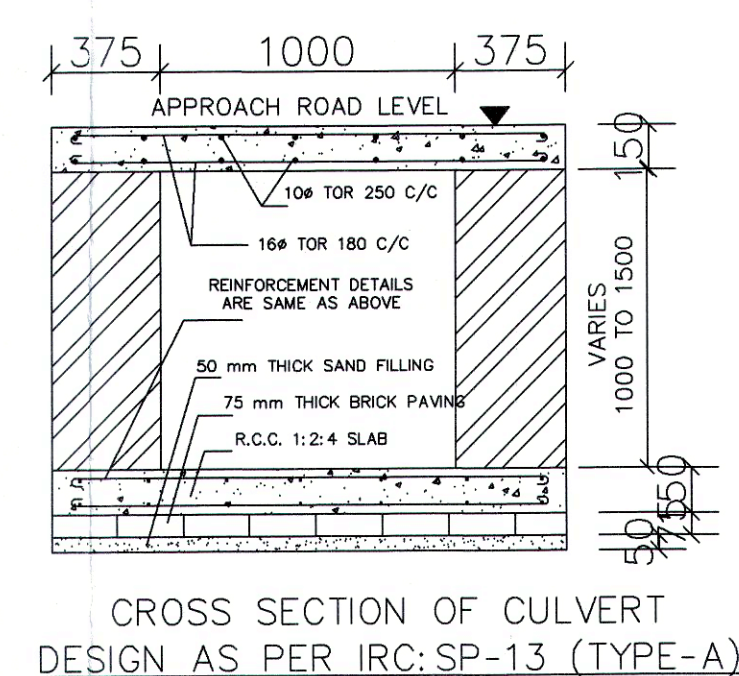

1. Construction work should be taken in hand/start after taking demarcation form revenue department and there should be no encroachment allowed on PWD land which is recorded in the revenue department.
2. If any encroachment and violation on schedule road act 1963 found on PWD land after construction same will be removed at on his own cost.
3. No material allowed to be dumped on PWD land during construction.
4. As per instruction issued by the department PWD B&R lease charges and processing fee may please be deposit.
5. There should be no violation allowed on schedule road act 1963 and no pucca structure is allowed with in 30 mtr. from the PWD Boundary .
6. If any drain or sewerage line is found on PWD land then the owner has to provide a drainage system with proper design to drain out the water.
7. The Department PWD B&R reserve the sight to withdraw the NOC if any violation made by applicant on the parameter/Instruction of IRC and PWD B&R Department.

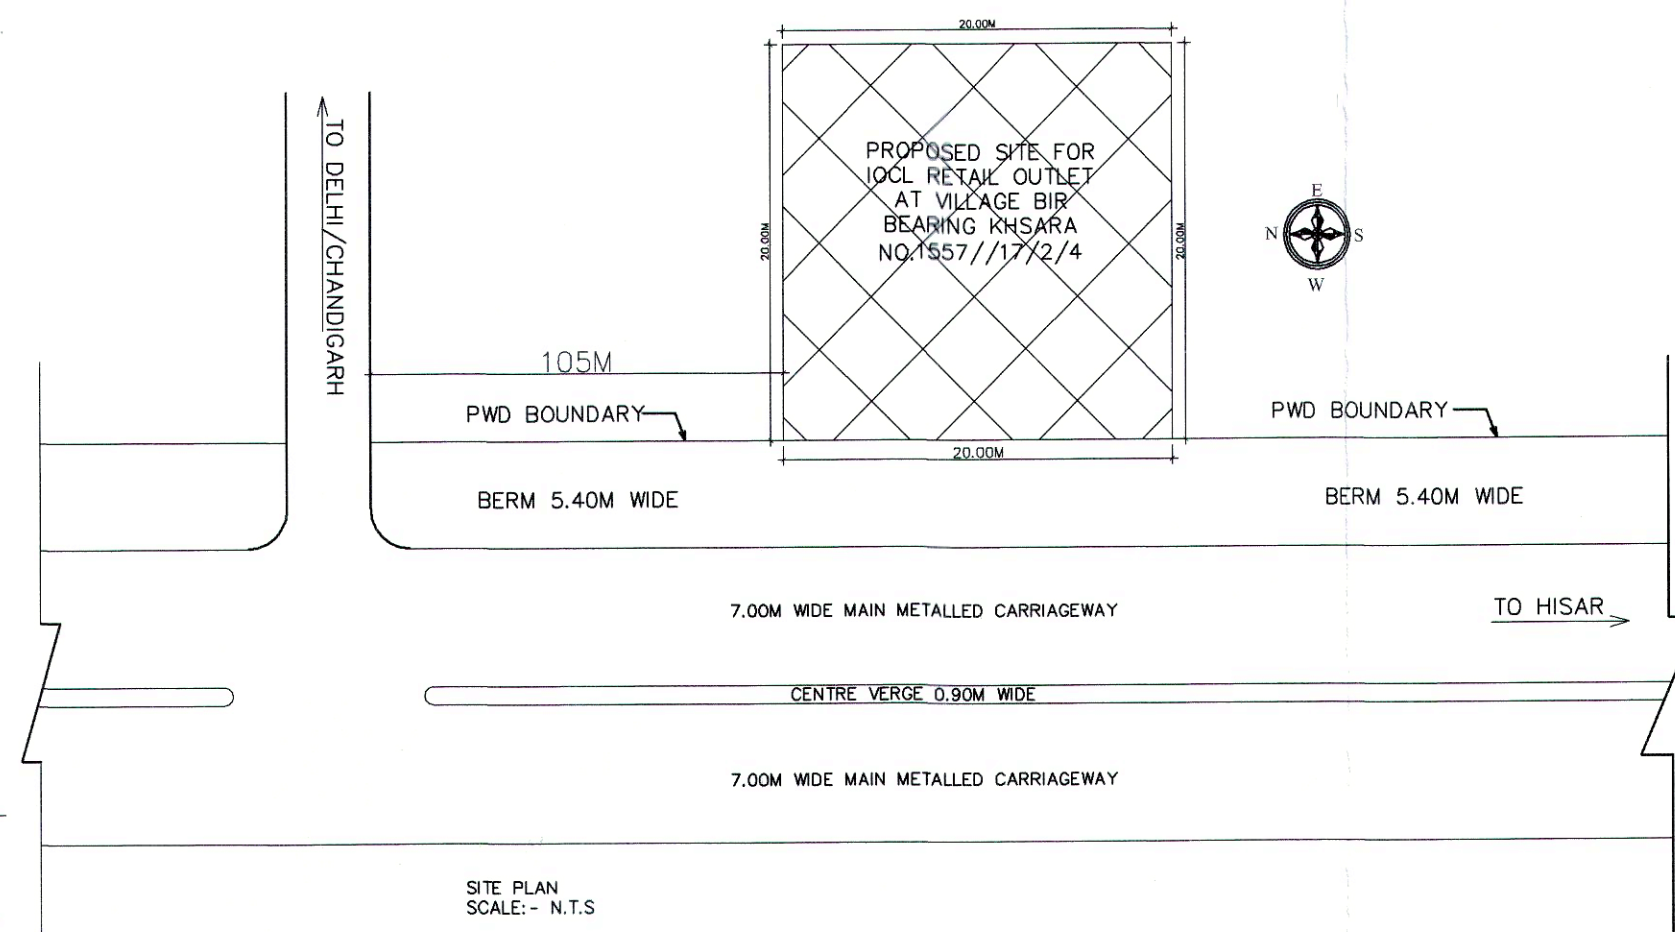

1. NO ROAD CROSSING WITHIN 300M ON EITHER SIDES OF THE PLOT.
2. NO RAIN SEWER OR STRUCTURE WITHIN 1.5M FROM THE UNDER GROUND TANKS.
3. SECTION/FILL VENT PIPES UNDER THE DRIVEWAY TO BE HOUSED UNDER PIPE SLEEVE.
4. VENT PIPE 40MM DIA AND 4.0M HIGH FROM THE GROUND LEVEL AND
4.00MTR. CLEAR ALL ROUND WITHIN THE PLOT FITTED WITH INVERTED 'U' TYPE VENT HOOD
5. COVERED WITH TWO LAYERS OF NON CORRODIBLE METAL WIRE GAUGE OF 11 MESH PER LINEAL CENTIMETER AT ITS OPEN ENDS.
6. D.P.S. BOARD FIXED ON THE WALL OF ROOM 1.50MTR. HIGH. FROM ITS FLOOR LEVEL AND SHALL NOT BE KEPT UNDER LOCK AND KEY.
7. FILL POINTS ARE KEPT 3.65M CLEAR AROUND.
8. "NO SMOKING" SIGN SHALL BE DISPLAYED AT THE PETROL PUMP.
9. 04 Nos. 10 Kg DCP type fire extinguisher, 01 no. 4.5 Kg Co2 type fire extinguisher and 06 Nos. sand buckets, 10 Kg each.
10. TANKS, FED BY TANK LORRY.
11. BOTH THE TANKS NOT BE REPLENISHED AT THE SAME TIME.
12. FILL PIPE AND DIP PIPES ARE FITTED WITH LOCKING CAP
13. ALL ELECTRIC FITTING CONFORM TO IS CODE NO. 2148.

CERTIFIED THAT THE TANK SHALL BE TO FABRICATED AS PER APPROVED SPECIFICATION AS BSI CODE 10978

1. CERTIFIED THAT THIS IS A NEW RETAIL OUTLET & NOT RESTITUTION CASE.
2. CERTIFIED THAT NO COURT CASE PENDING IN ANY COURT OF INDIA AGAINST THIS SITE\DEALERSHIP.
3. CERTIFIED THAT ALL THE CLEARANCES\APPROVALS FROM MCP\IRC AND OTHER RELEVANT GOVT. DEPTT. SHALL BE OBTAINED.
4. THE CERTIFIED THAT M.S. CASES OF MEASURING 00.0 M X 00.0 M SHALL CONFIRM TO SOUND & SPEC. AND THERE IS NO CHANCE OF ITS EVER CAVING-IN UNDER NORMAL CIRCUMSTANCES. STEEL CANOPY APPROVAL NO. CCE G-40(NC) P-CANOPY DT.26.07.89

4. CERTIFIED THAT ALL FACILITIES AS SHOWN IN THE DRAWING ARE INSTALLED \ PROVIDED AT ABOVE R/O.

हिमांशु शर्मा / Himanshu Sharma
 वरिष्ठ प्रबंधक (रिसेल्ट) / Sr. Manager (RS)
 हिंसार मण्डल कार्यालय
 Hissar Divisional Office
 इंडियन ऑयल कॉर्पोरेशन लि.
 Indian Oil Corporation Ltd.
 हिंसार - 125005 / HISSAR - 125005