

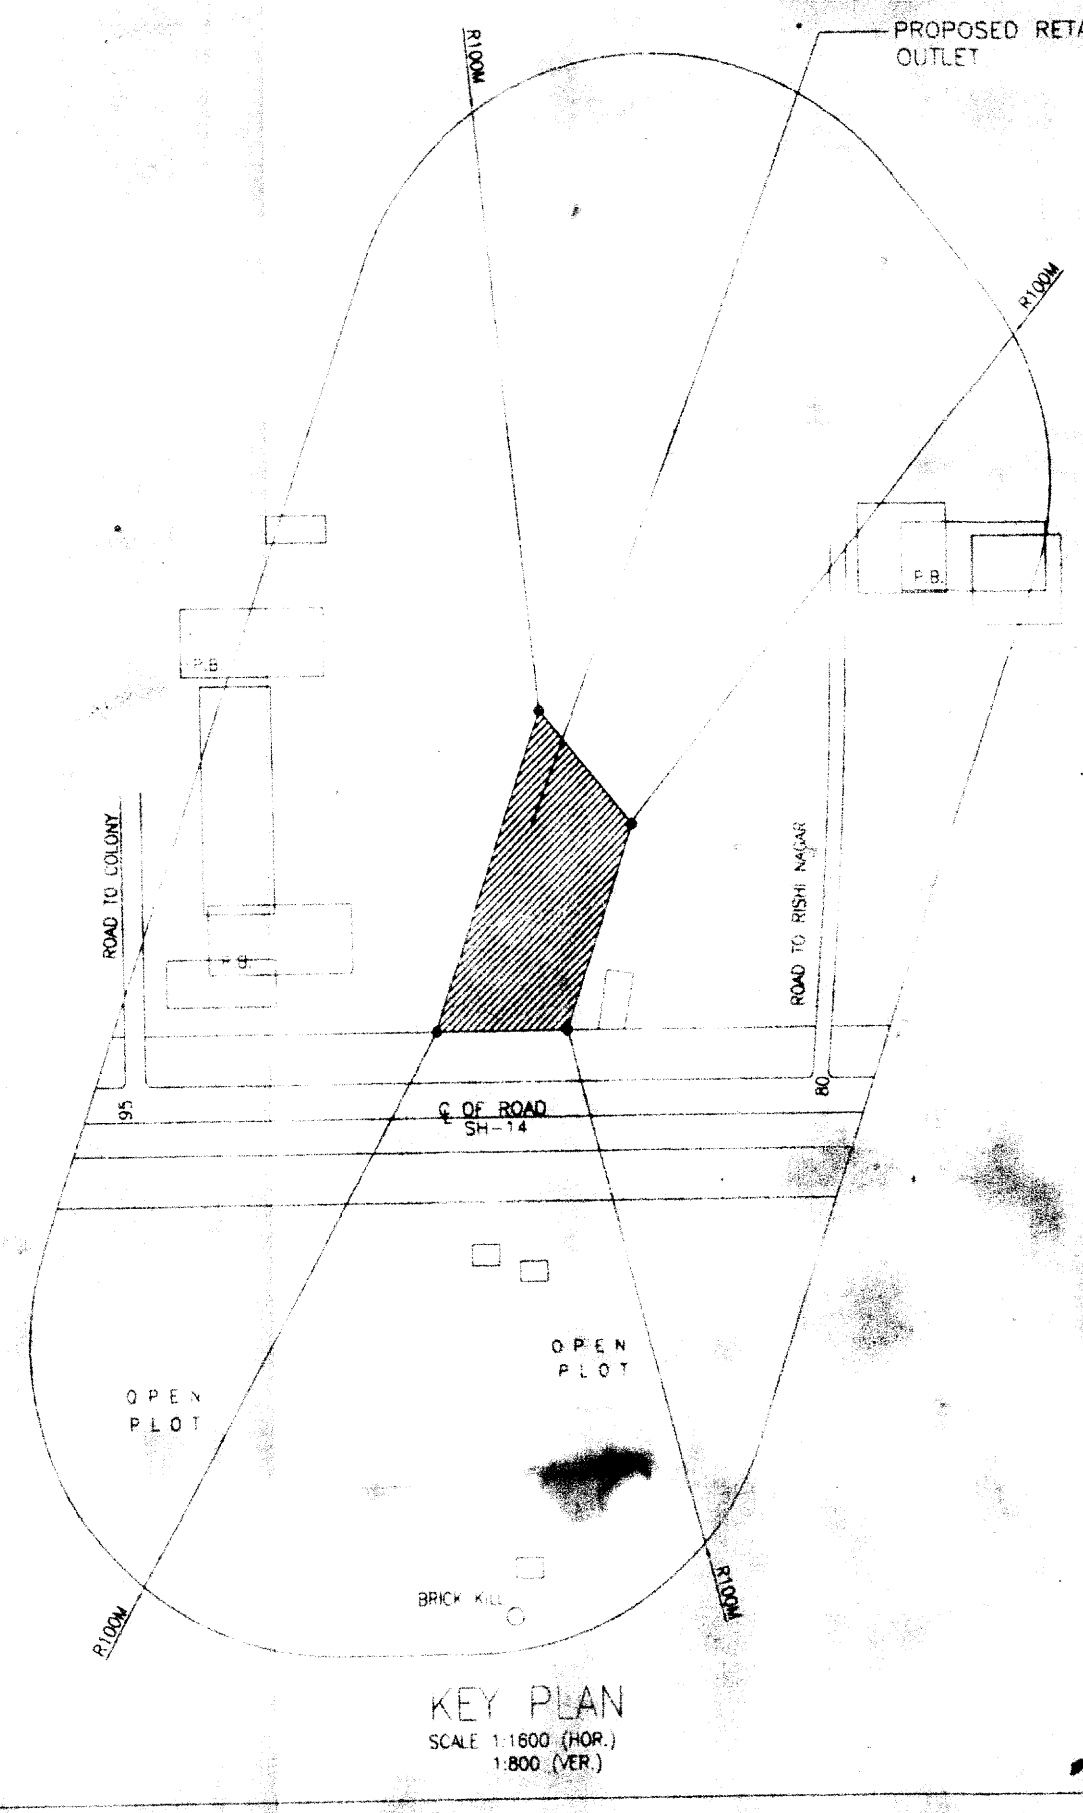
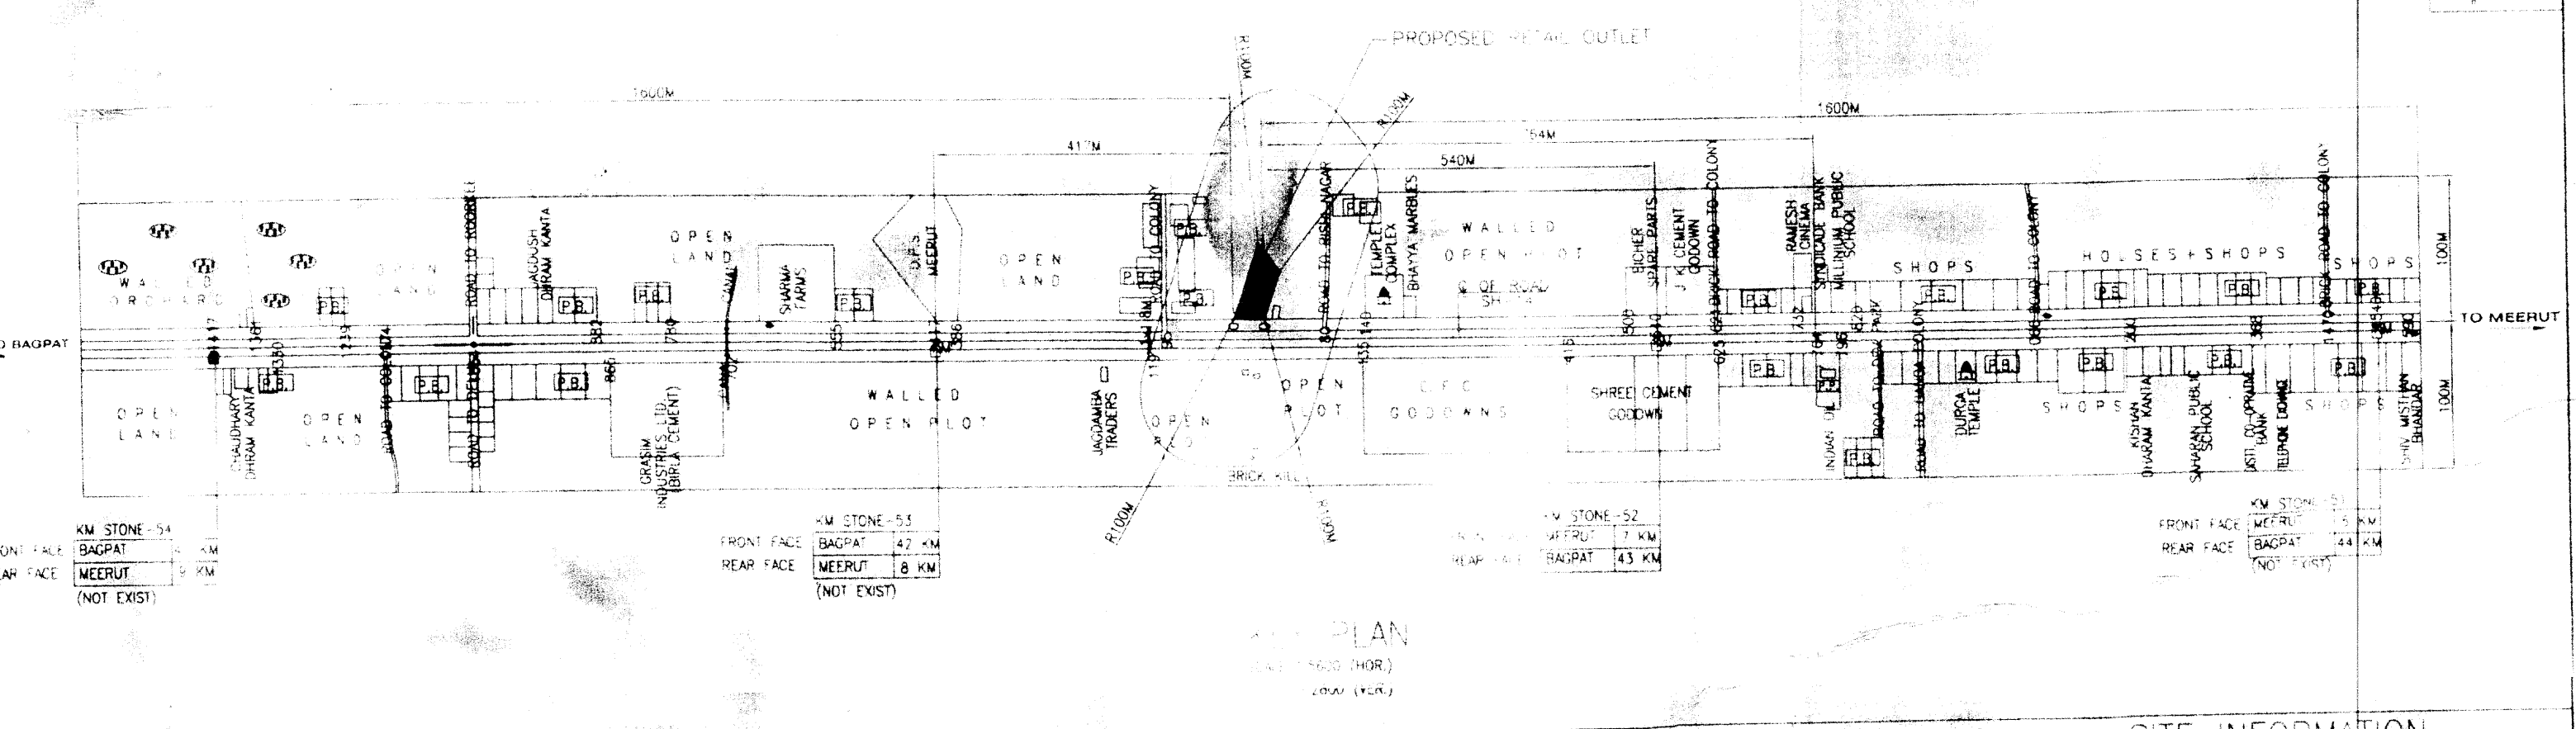
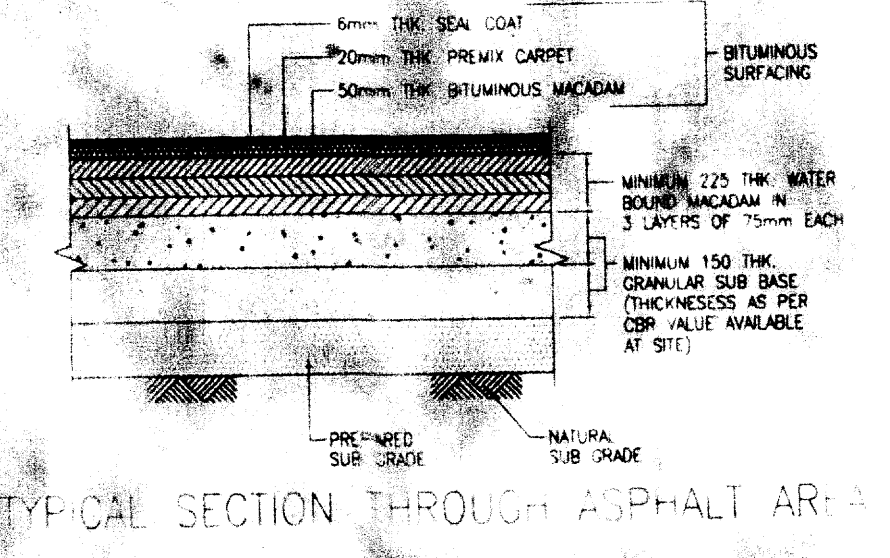
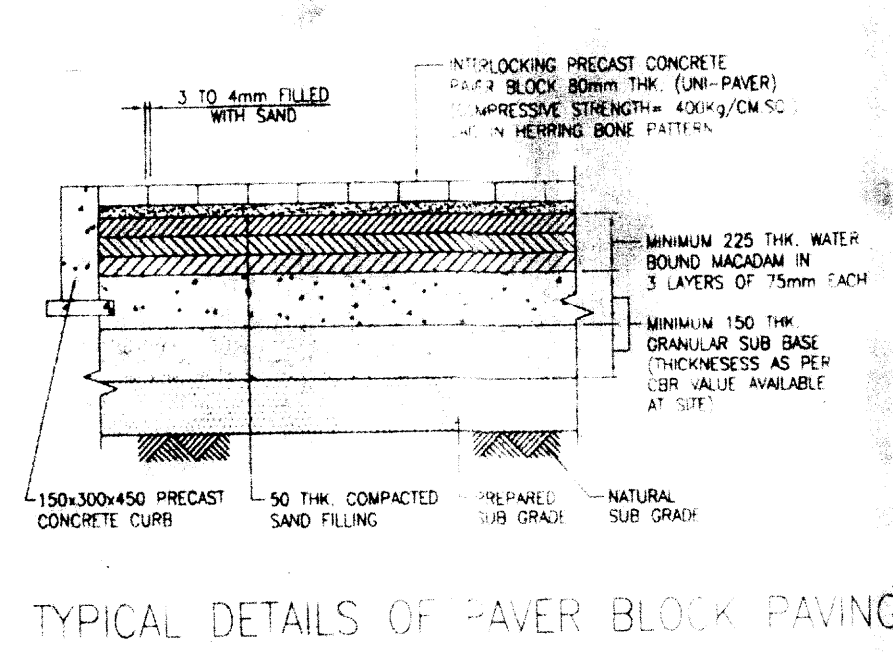
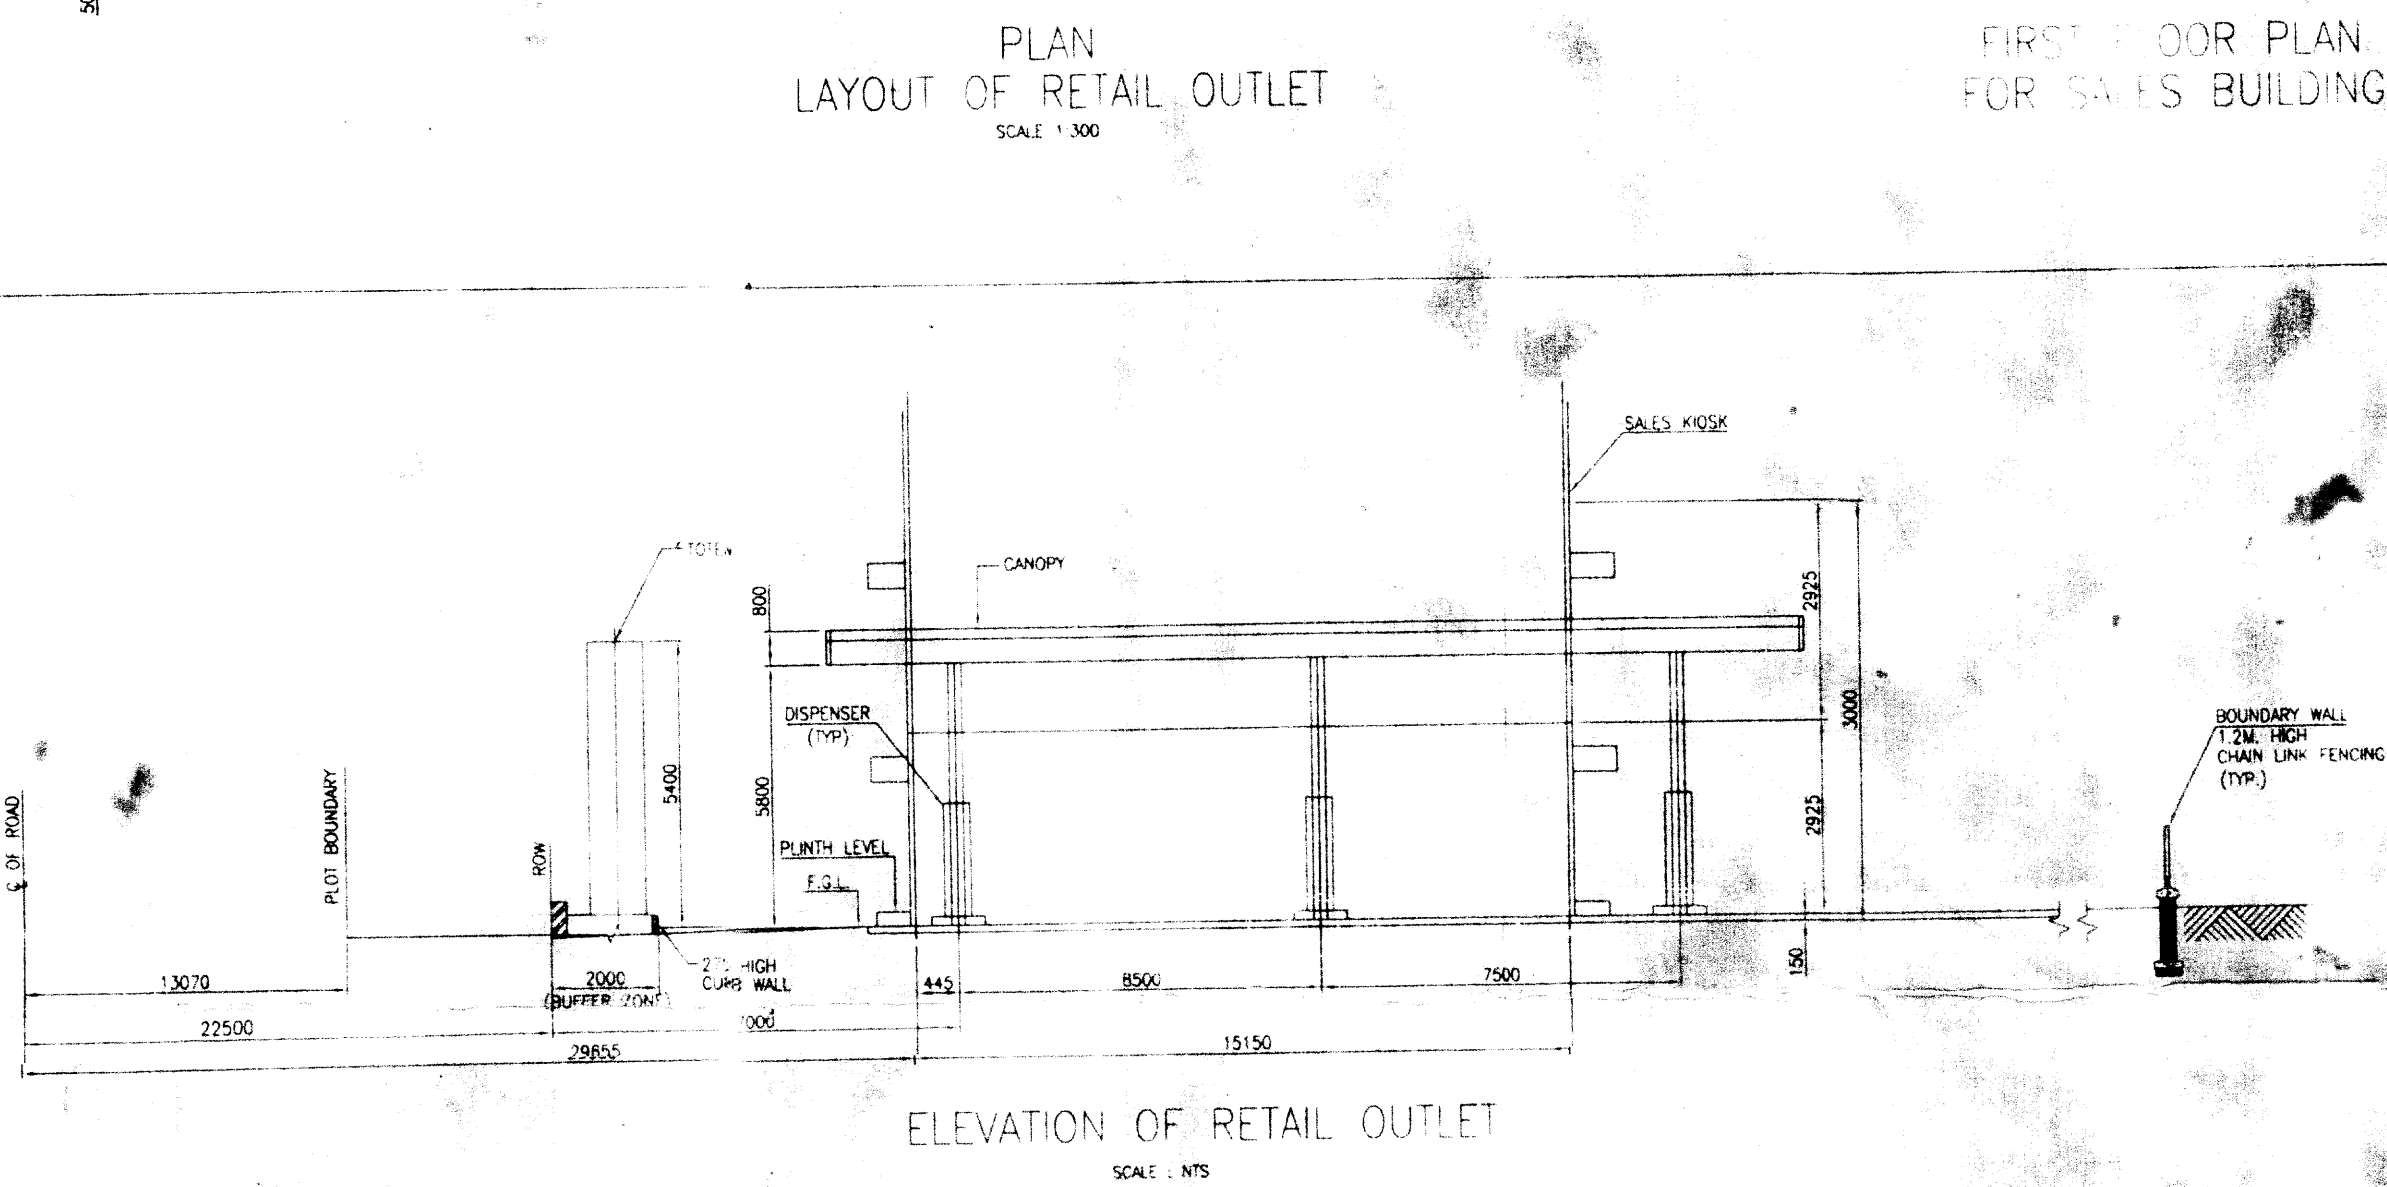


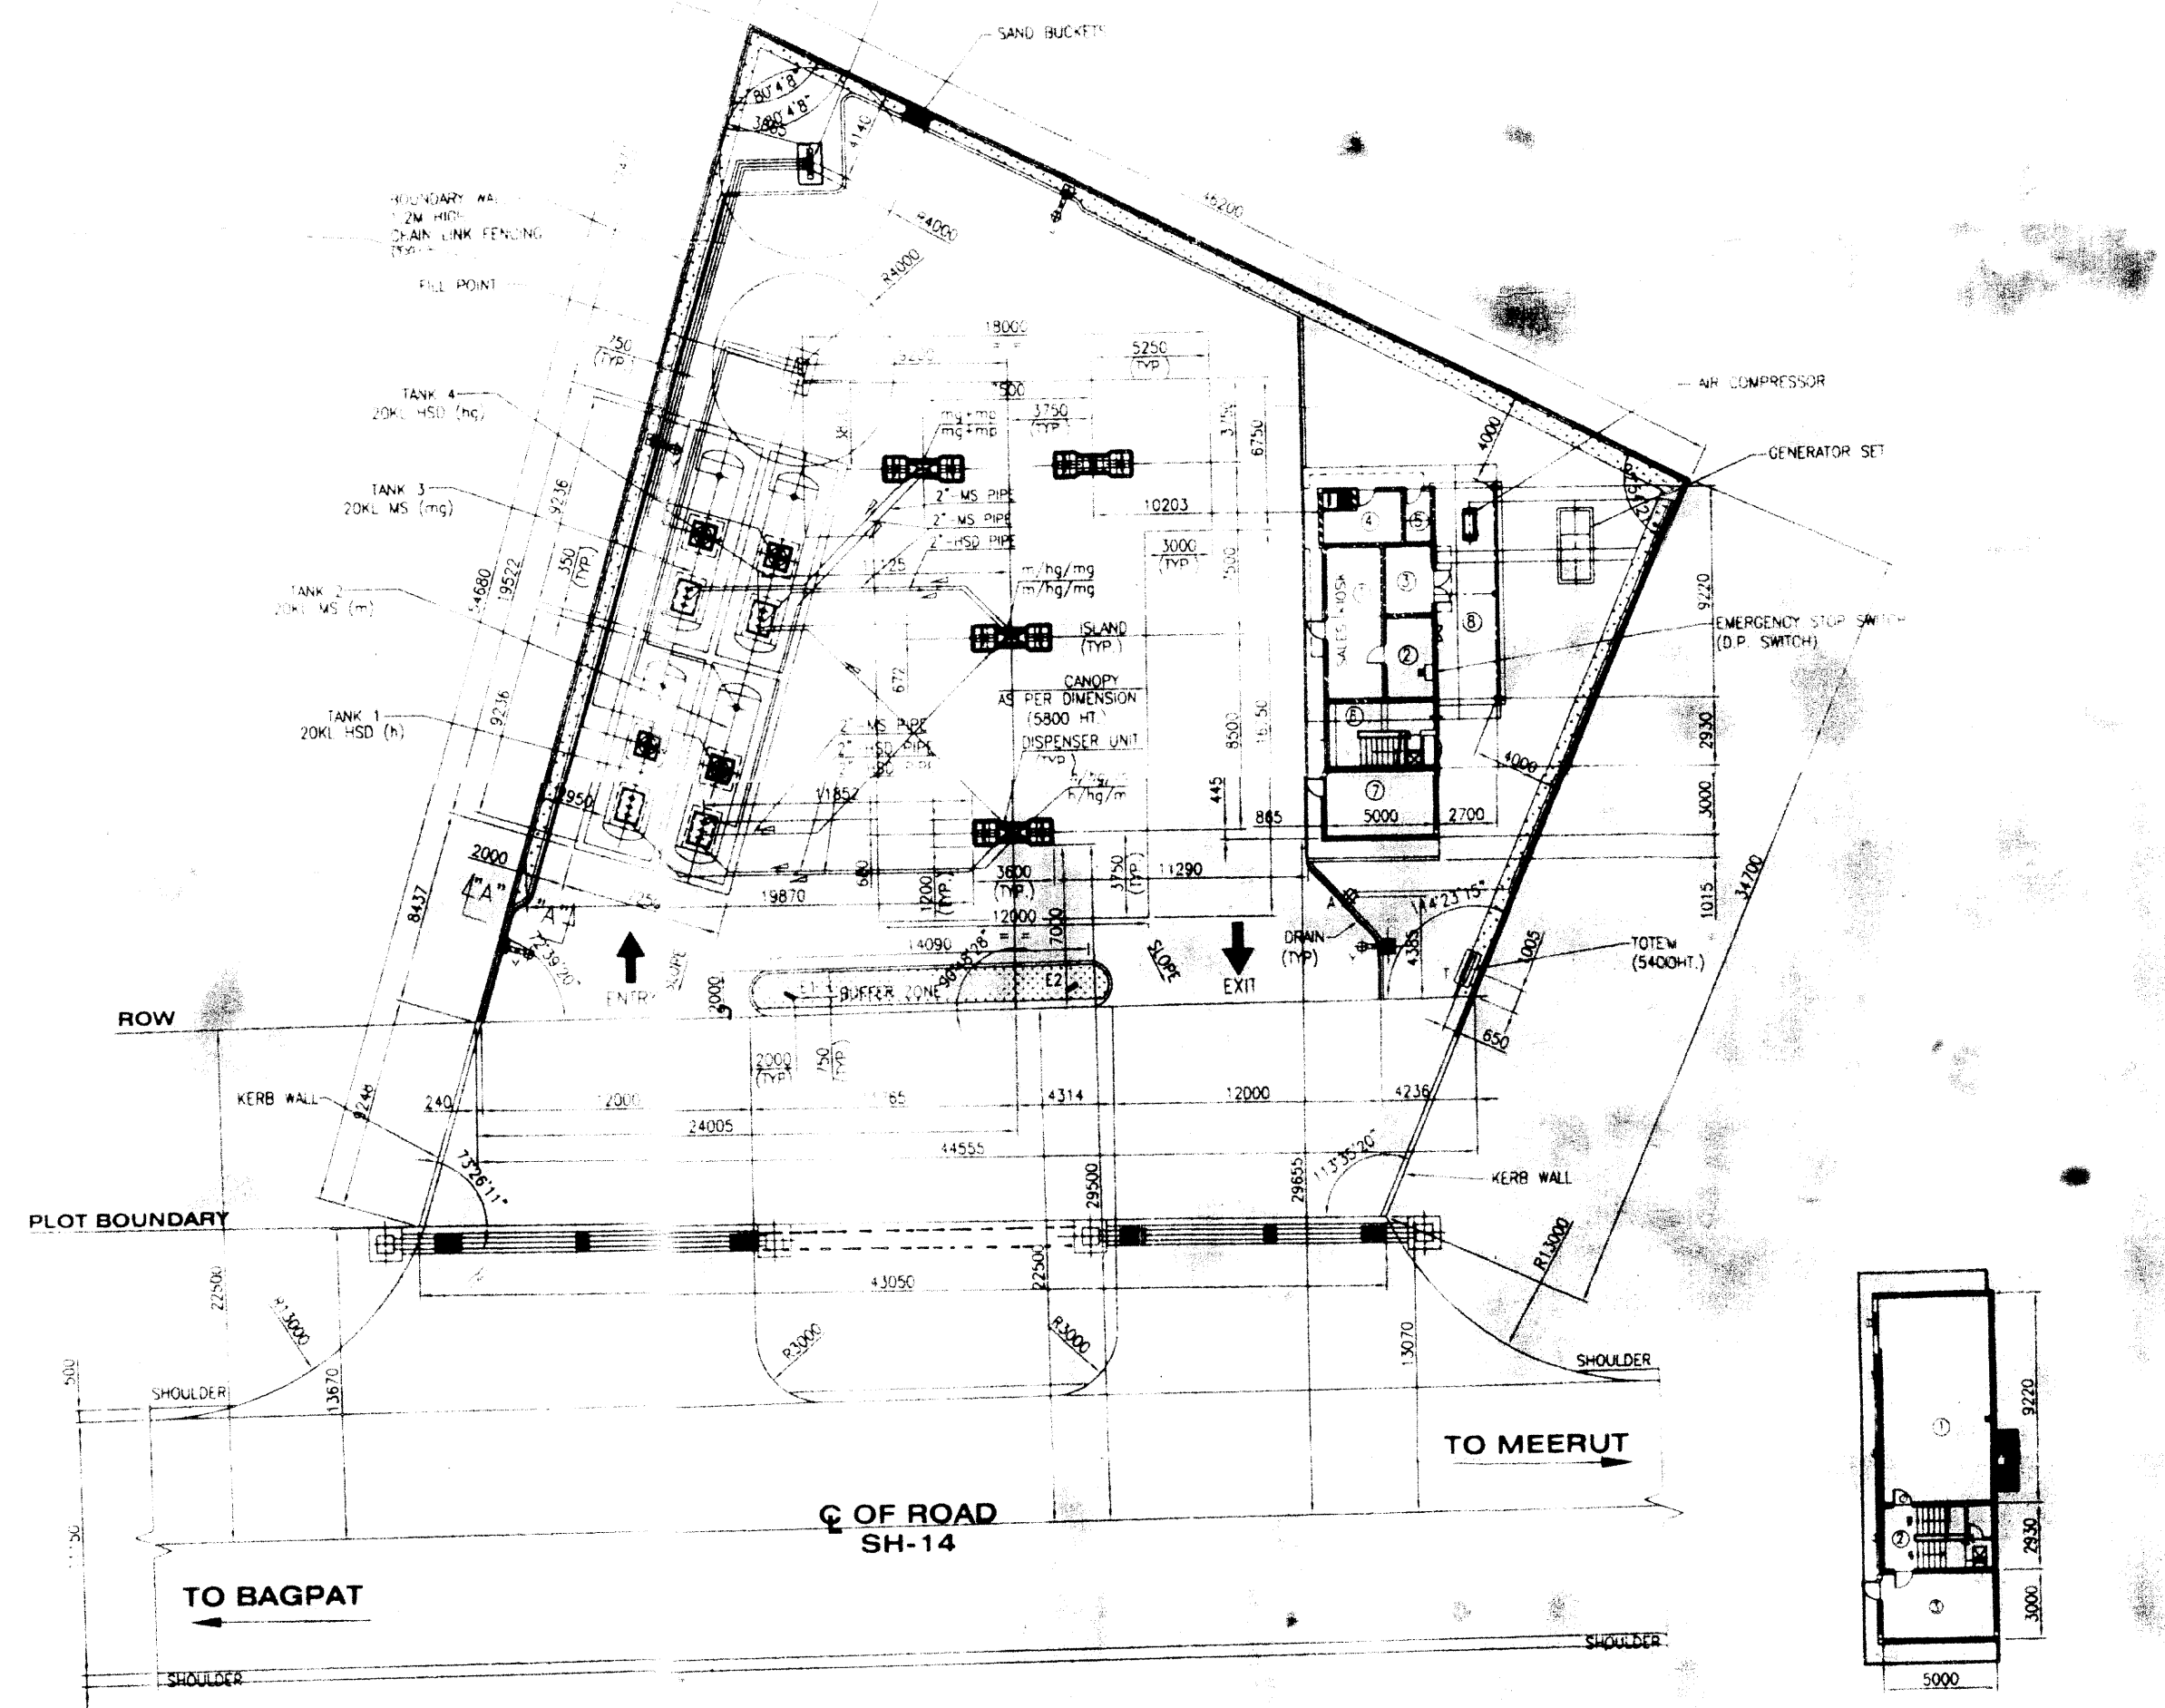

AREA STATEMENT

1. TOTAL PLOT AREA	= 1928.89 SQ.M
2. PERMISSIBLE COVERED AREA	= 771.48 SQ.M
3. PROPOSED BUILDING AREA FOR SALES KIOSK	= 202.680 x 3.340 = 269.7045 SQ.M
4. MERCHANDISING (3.0M x 5.23M) (G+1)	= 31.38 SQ.M
5. DO SHED AREA - 9.45M x 2.70M	= 25.51 SQ.M
6. TOTAL PROPOSED AREA (G+1)	= 187.01 SQ.M
7. ROOFED CANOPY AREA (G+1)	= 187.01 SQ.M

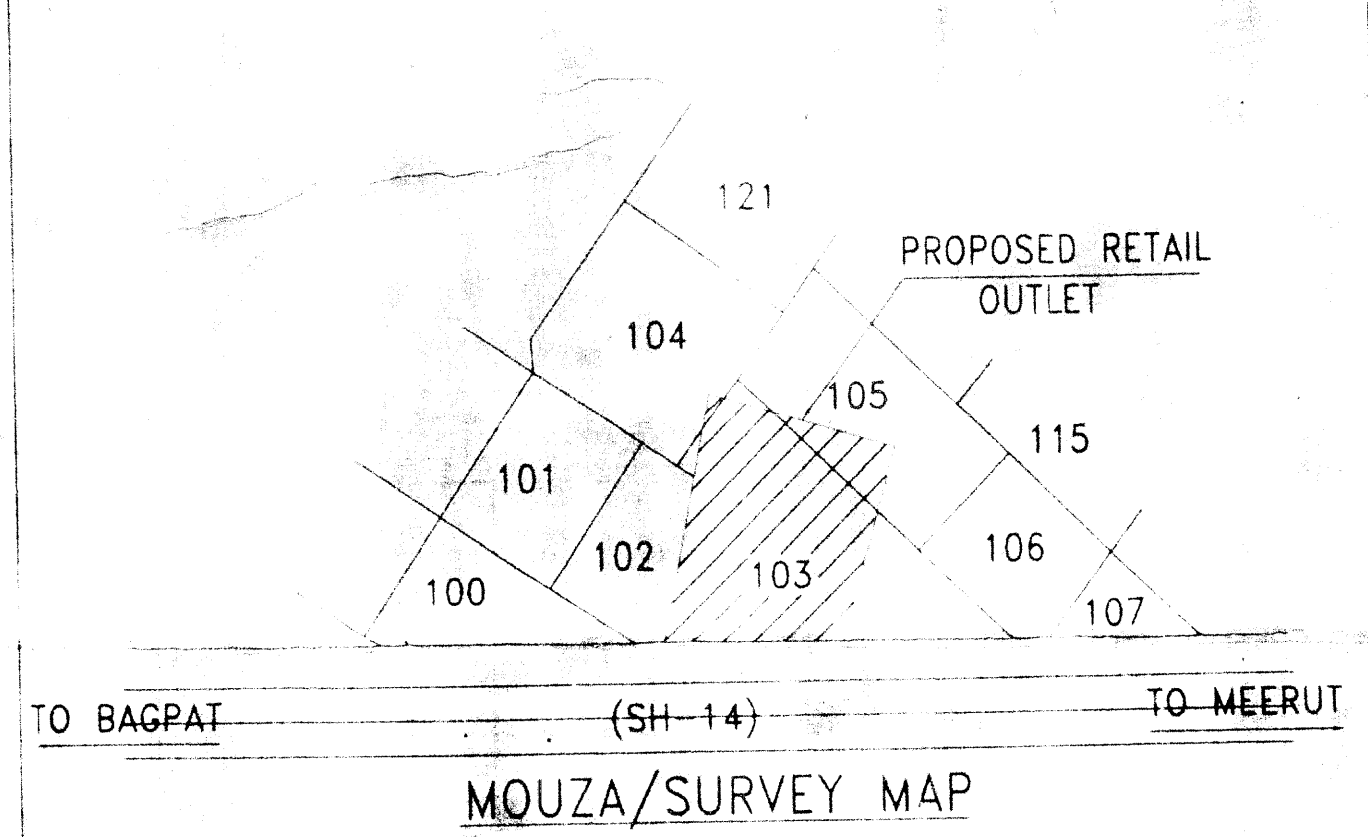

DETAIL OF TANKS

SR. NO.	ITEM	QTY	DIMENSION	CAPACITY OF TANKS IN LITRES			
				CLASS 'A'	CLASS 'B'	CLASS 'C'	CLASS 'D'
1	UNDERGROUND TANK 1	1	1800M x 8036LG	MS (H)	21800	1800	20000
2	UNDERGROUND TANK 2	1	1800M x 8036LG	MS (H)	21800	1800	20000
3	UNDERGROUND TANK 3	1	1800M x 8036LG	MS (H)	21800	1800	20000
4	UNDERGROUND TANK 4	1	1800M x 8036LG	MS (H)	21800	1800	20000

EQUIPMENT LIST


SR. NO.	ITEM	QTY	DIMENSION / CAPACITY	REMARKS
1	DISPENSING UNIT HSD/MS	1	3 PUMPS x 3 DISPLAY x 6 HOSES	
2	DISPENSING UNIT HSD/MS	1	3 PUMPS x 3 DISPLAY x 6 HOSES	
3	DISPENSING UNIT MS	1	2 PUMPS x 4 DISPLAY x 6 HOSES	
4	ATO (AUTO TANK GAUGING) SYSTEM	1		

SALES KIOSK GROUND FLOOR

SR. NO.	FACILITY	QTY	DIMENSION (INTERNAL)
1	CUSTOMER DEALING ROOM	1	4595 x 2490
2	BACK OFFICE	1	3515 x 2050
3	ELECTRICAL ROOM	1	2850 x 2050
4	STORAGE & WATER COOLER SPACE	1	3555 x 2195
5	TOILET	1	1100 x 2165
6	STAIRCASE	1	5000 x 2930
7	MERCHANDISING	1	5000 x 3000
8	SHED	1	9220 x 2700

SALES KIOSK FIRST FLOOR

SR. NO.	FACILITY	QTY	DIMENSION (INTERNAL)
1	MERCHANDISING	1	9720 x 5000
2	STAIRCASE	1	5000 x 2930
3	MERCHANDISING	1	5000 x 3000

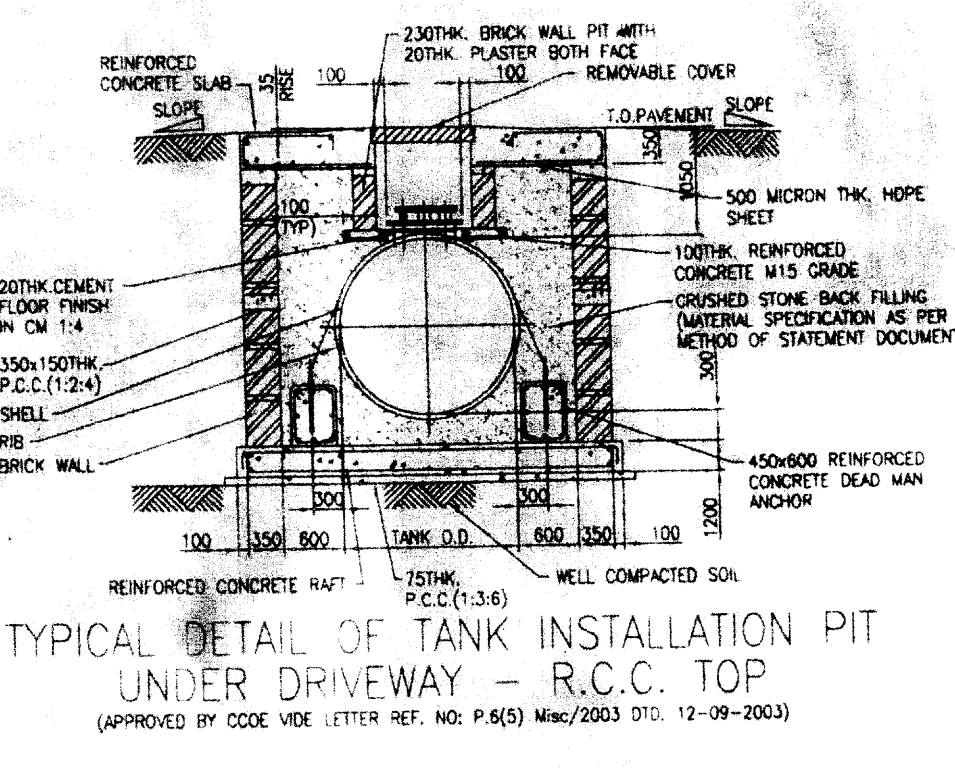

SITE INFORMATION

NAME	NO.	POST OFFICE	RAILWAY STATION	POLICE STATION	TRANSPORT NAGAR	MEERUT NAGAR	STATE	UTTER PRADESH
KHATA NO.	141							
KHATA NO.	N.A.							
KHATA NO.	141							
KHATA NO.	103, 104, 105							
VILLAGE	MALYANA							

- GENERAL NOTES:-**
- ALL DIMENSIONS ARE IN MM AND LEVELS IN METRES UNLESS OTHERWISE STATED.
 - DISPENSING UNIT, AUTOMATIC TANK GAUGING AND SUBMERSIBLE TURBINE PUMP ETC. CONFORMS TO SPECIFICATIONS APPROVED BY CODE.
 - ALL THE TANKS SHALL NOT BE REPLENISHED AT THE SAME TIME.
 - TANKS SHALL BE FED BY TANK LORRY ONLY.
 - NO SMOKING SIGN SHALL BE DISPLAYED AT PROMINENT LOCATION.
 - THERE SHALL BE A CLEAR SPACE ALL AROUND THE TANK WITH LOOKING CAP ARRANGEMENT.
 - EMERGENCY STOP SWITCH SHALL BE PROVIDED AT ACCESSIBLE LOCATION.
 - FUEL PIPE IS LAID IN TRENCHES TO ENSURE THAT VEHICLE LOAD IS NOT TRANSMITTED TO PIPE.
 - THE BUFFER ZONE NO. HEDGE AND PLANT SHALL BE TALLER THAN 0.9M.
 - THE LICENSED PREMISES SHALL BE USED ONLY FOR THE PURPOSE FOR WHICH IT IS LICENSED FOR.
 - THE NUMBERS OF 10 KG. CAPACITY DRY CHEMICAL TYPE (DCP) FIRE EXTINGUISHERS AT THE RO AND TWO NUMBERS OF SAND BUCKETS SHALL BE PROVIDED FOR EACH DISPENSING UNIT.
 - NO DRAIN, SEWER OR STRUCTURE WITHIN 1.5M FROM UNDERGROUND TANK.
 - ELECTRICAL FITTINGS CONFORM TO IS:2148 INSTALLED IN HAZARDOUS AREA ZONE 1.
 - THE OPEN END OF VENT PIPE SHALL BE COVERED WITH TWO LAYERS OF NON-CORROSIVE WIRE MESH OF 1.1 MESH PER LINEAR CENTIMETRE. HEIGHT OF VENT PIPE SHALL BE 4.0M (MIN) OR 1.5M ABOVE TOP OF SALES BUILDING / KIOSK.
 - EXHAUST PIPE OF GENERATOR SET SHALL BE FITTED WITH SPARK ARRESTOR.

- SPECIAL NOTES:-**
- CERTIFIED THAT ALL APPLICABLE NORMS AND REQUIREMENTS AS PER IRC - 1983 (WITH LATEST AMENDMENT) WILL BE COMPLIED WITH.
 - CERTIFIED THAT THE CANOPY DESIGN CONFORMS TO SOUND ENGINEERING SPECIFICATIONS AND THERE IS NO CHANCE OF CAVING UNDER NORMAL CIRCUMSTANCES.
 - CERTIFIED THAT THE SITE IS FREE FROM ANY LITIGATION & NO CASE IS PENDING IN ANY COURT OF LAW.
 - CERTIFIED THAT FOR TANKS HAVE TYPE APPROVAL FROM CHIEF CONTROLLER OF EXPLOSIVES, NAGPUR VIDE LETTER NO. P.865/MAC/2003 DATED 12/09/2003.
 - ATE CONTROL PANEL AND DISPLAY SHALL BE INSTALLED AS PER TYPE APPROVAL OBTAINED FROM CODE VIDE REF. P.939224/99/1 DTD. 05.08.2003 AND DRAWING NUMBERS 20-200-15-11-01 & 20-200-15-11-02.
 - NO ELECTRICAL LINE IS PASSING OVER THE PROPOSED RETAIL OUTLET.

- LEGEND:-**
- EMERGENCY STOP SWITCH
- FUEL DISPENSER TYPES:-
- mp - OIL PREMIX (2 STROKE) 40 L/MIN
 - ms - MOTOR SPIRIT (UNLEADED) 40 L/MIN
 - ms - MOTOR SPIRIT (PREMIUM) 40 L/MIN
 - h - DIESEL (CARS & LCVS) 40 L/MIN
 - hg - DIESEL (PREMIUM) 40 L/MIN
- SIGNAGE TYPES
- TOTAL SIGN
 - ENTRY/EXIT SIGN
 - YARD POLE WITH METAL HALIDE LAMP
 - AR LOCATION SIGN

For Reliance Industries Ltd.

JACOBS H&G

JACOBS H&G PRIVATE LIMITED
2ND, CHAKRA INDUSTRIAL ESTATE, PHASE - II,
NEW DELHI 110002
TEL: (011-11) 28848801, 28848802 FAX: (011-11) 2831747
A MEMBER OF THE JACOBS ENGINEERING GROUP, INC.

Reliance

RETAIL OUTLET - UWCO09 (MEERUT CITY-I)

AT BAGPAT NO. 141, STATE SH-14, MEERUT NAGAR, DISTRICT MEERUT, STATE U.P.

LAYOUT OF RETAIL OUTLET

DATE: 14.06.05

Amit Bhatia
State Head
UP (M) & Varakhand
Reliance Industries Ltd