


# LINEAR PLAN OF 132 KV D/C RAMBAN SANGALDHAN TRANSMISSION LINE

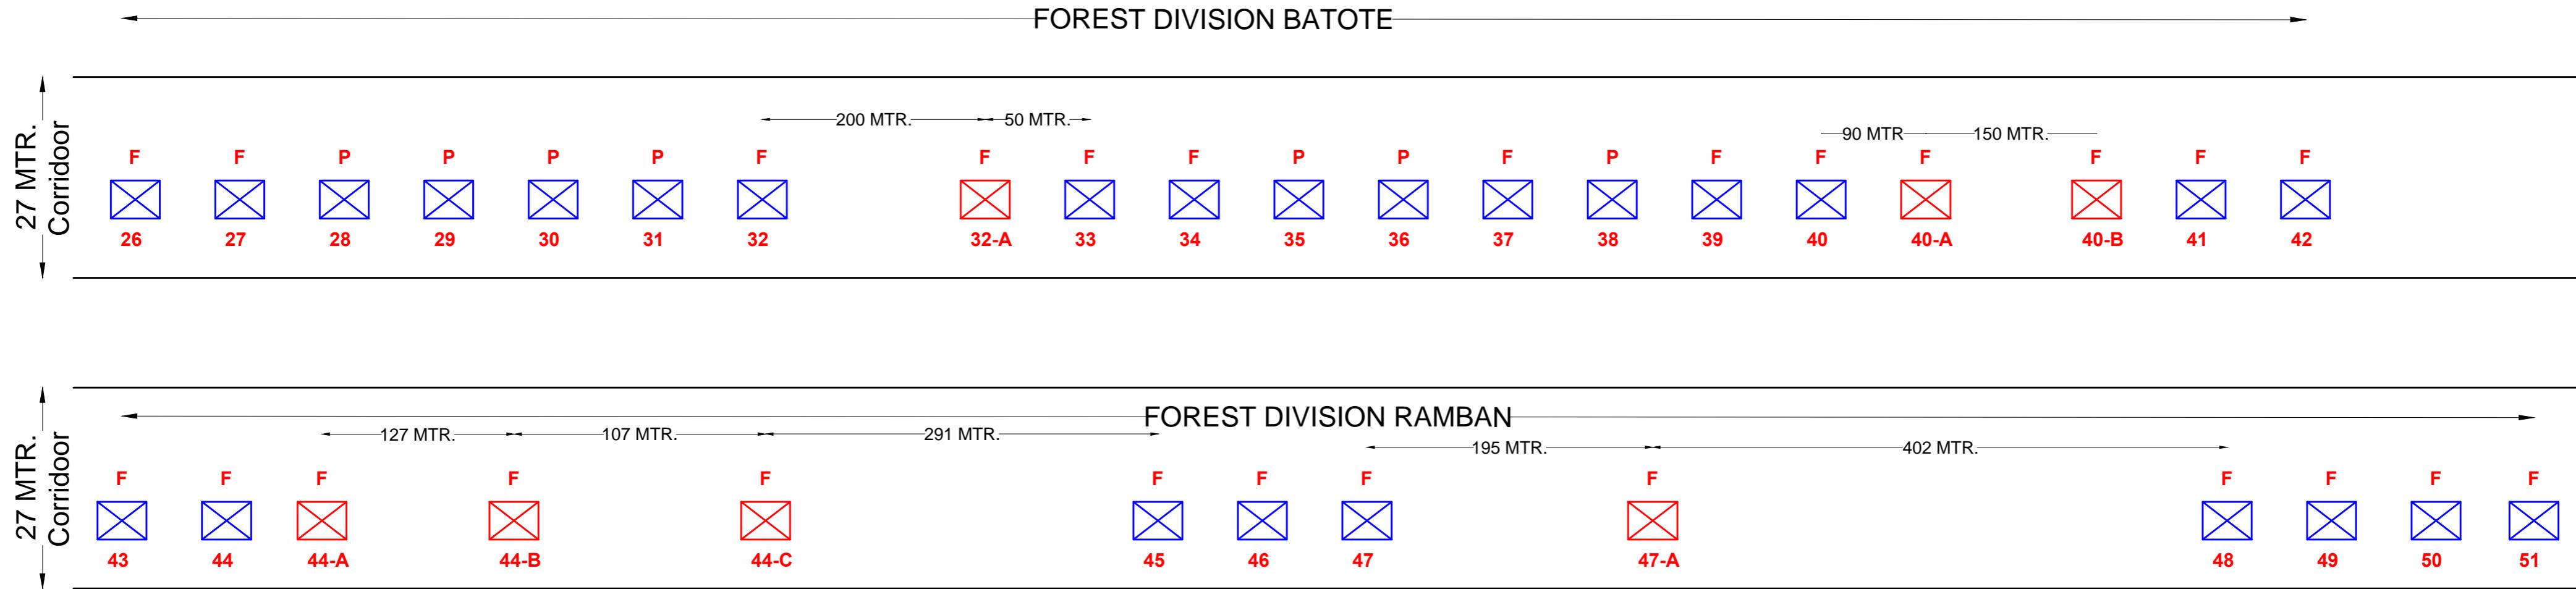

## FOREST DIVISION BATOTE

- LAND MEASURING = 7.2765 HA. FOR TOWER NO.: 26,27,32,33,34,37,39,40,41,42 GOT ALREADY DIVERTED VIDE FST NO. 400/FST/OF2018 DT. 27.12.2018.
- LAND MEASURING = 1.34 HA. FOR TOWER FOUNDATION AND LINE CORRIDOR FOR TOWER NO. 32-A, 40-A, 40-B, NEEDS TO BE DIVERTED.
  - DISTANCE BETWEEN 32 TO 32-A = 200 MTRS.
  - DISTANCE BETWEEN 32 -A TO 33 = 50 MTRS.
  - DISTANCE BETWEEN 40 TO 40-A = 99 MTRS.
  - DISTANCE BETWEEN 40-A TO 40-B = 150 MTRS.
 TOTAL AREA = 499 MTRS.  
 (WIDTH OF CORRIDOR x 27 MTRS. = 1.34 HA.)

## FOREST DIVISION RAMBAN

- LAND MEASURING = 6.272 HA. FOR TOWER NO.: 43,44,45,46,47,48,49,50,51 GOT ALREADY DIVERTED VIDE FST NO. 290/FST/OF2019 DT. 24.09.2019.
- LAND MEASURING = 3.03 HA. FOR TOWER FOUNDATION AND LINE CORRIDOR FOR TOWER NO. 44-A, 44-B, 44-C, 47-A NEEDS TO BE DIVERTED.
  - DISTANCE BETWEEN 44-A TO 44-B = 127 MTRS.
  - DISTANCE BETWEEN 44-B TO 44-C = 107 MTRS.
  - DISTANCE BETWEEN 44-C TO 45 = 291 MTRS.
  - DISTANCE BETWEEN 47 TO 47-A = 195 MTRS.
  - DISTANCE BETWEEN 47-A TO 48 = 402 MTRS.
 TOTAL AREA = 1122 MTRS.  
 (WIDTH OF CORRIDOR x 27 MTRS. = 3.0294 HA. (SAY 3.03 HA.))

1. EXISTING TOWER	
2. NEW TOWER	
<b>F = FOREST LAND</b>	
<b>P = PRIVATE LAND</b>	

*JKS  
Bantote*

*JKS*  
Assistant Ex. Engineer  
TLM Sub-Division-III  
Transmission Line Maintt. Div-III  
Bantote

*JKS*  
Executive Engineer  
Transmission Line Maintt. Div-III  
Udhampur

*JKS*  
Divisional Forest Officer  
Divisional Forest Officer  
Ramban Forest Division

*JKS*  
Divisional Forest Officer  
Divisional Forest Officer  
Bantote Forest Division  
Bantote