


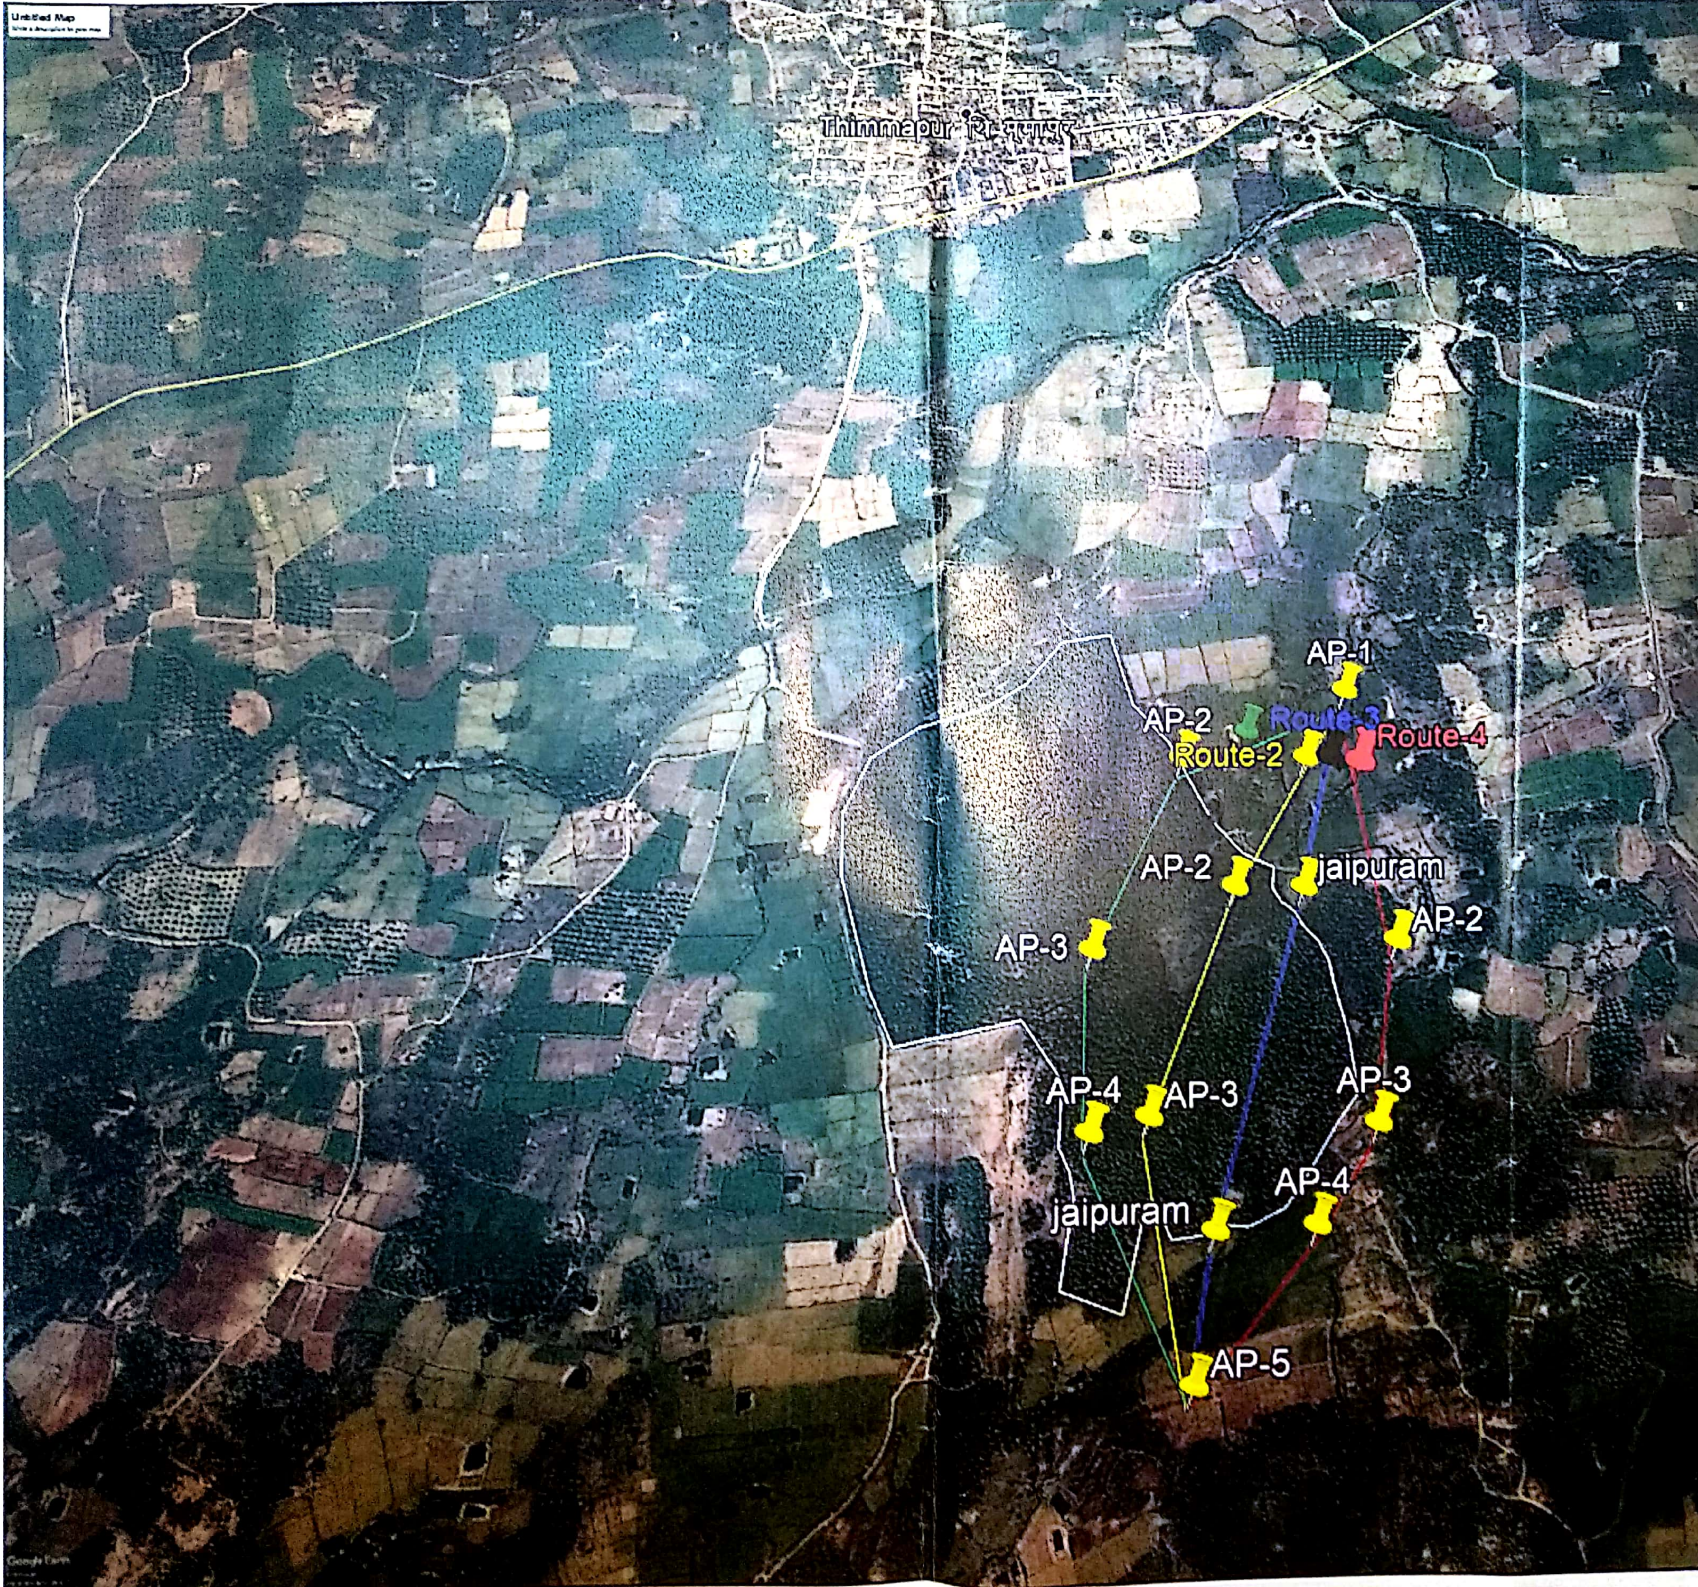

Note:-

At the Gumnegutta Forest area, total 4 Nos routes are examined as given below.

1) Route-1 and Route-2 are passing deeply through the forest and consuming more forest land area.

Thereby, it was not considered for execution of the line.

2) Route-4 is passing through longer distance which is not economic and also few of the Transmission lines are passing in the vicinity of Route-4 and doesnot satisfy I.E rules.

3) The Route-3 is the best possible route and there is no alternate route available and the Transmission line distance is the shortest acquiring least of the Forest land area and further, it is economic.

D. Subramanian

SUPERINTENDING ENGINEER
400KV CONSTRUCTION CIRCLE
TSTRANSCO, KARIMNAGAR.