

LILO OF 132 KV TOHANA-DHAMTHAN SAHIB LINE AT 220 KV S/STN SAMAIN 02.SQ*ACSR PANTHER CONDUCTOR

IN FATEHABAD District

Date of Proposal:-.....

CHECK LIST SERIAL NUMBER:-18(a)

Length and width of Transmission Line passing through forest and non-forest area.

1	Total Length (Forest & Non-Forest) of T/L in Fatehabad Forest Division	8601 Mtr
2	Total width required for 132 KV Electric Transmission Line (ROW)	27.00 Mtr.
3	Total area (Forest & Non Forest) involved of T/L in Fatehabad Forest Division	23.2227 Hac
4	Total Length Passing through Forest Area of Fatehabad Forest Division	60 Mtr
5	Total Forest Area involved in Fatehabad Forest Division	0.1620 Hac
6	Total Length Passing through Non -Forest Area of Fatehabad Forest Division	8541 Mtr
7	Total Non-Forest Area involved in Fatehabad forest Division	23.0657 hac

For Details of the breakup of the area in Fatehabad Forest division please refer check list serial No.-18(a) for reference

Place Fatehabad

Date:-.....

ARSHI TADAH
Sub Division
Assistant Executive Engineer
HVPNL, HISSAR

Assistant Executive Engineer
Construction Sub Division
HVPNL, HISSAR

Executive Engineer
TS Division HVPNL
HISAR

LILO OF 132 KV TOHANA-DHAMTHAN SAHIB LINE AT 220 KV S/STN SAMMAIN 02.SQ* ACSR PANTHER CONDUCTOR

S NO.	Name of forest area	Width of Line (In Mtr)	Width of forest (In Mtr)	Total Forest Area to be used(In sq. Mtr)	Total Forest Area to be used(In Hac.)	COORDINATE
1	TOHANA ROAD-KANHERI ROAD L TOHANA ROAD-KANHERI ROAD L	27 27	2 2	54 54	0.0054 0.0054	N 29°40'47.01" E 75°55'33.02"
2	Drain L Drain R	27 27	17 21	459 567	0.0459 0.0567	N 29°40'40.48" E 75°55'33.26"
3	TOHANA-SAMAIN ROAD L TOHANA-SAMAIN ROAD R	27 27	3 3	81 81	0.0081 0.0081	N 29°40'33.29" E 75°55'29.68"
4	TOHANA ROAD-KAMALWALA ROAD L TOHANA ROAD-KAMALWALA ROAD R	27 27	3 3	81 81	0.0081 0.0081	N 29°41'80" E 75°55'0.4"
5	TOHANA ROAD-LOHAKHERA ROAD L TOHANAROAD-LOHAKHERA ROAD R	27 27	3 3	81 81	0.0081 0.0081	N 29°40'29.3" E 75°55'32.8"
	TOTAL	270	60	1620	0.1620	


Assistant Executive Engineer
Construction Sub Division
HVPNL, HISSAR


Executive Engineer
TS Division HVPNL
HISAR

LILO OF 132 KV TOHANA-DHAMTHAN SAHIB LINE AT 220 KV S/STN SAMMAIN 02.SQ*ACSR PANTHER CONDUCTOR

S NO.	VILLAGE	TOTAL AREA (in sq. mtr)	FOREST AREA (in sq. mtr)	NON FOREST AREA (IN Sq Mtr)
1	TOHANA	20655	162	20493
2	KAMALWALA	36315	NIL	36315
3	KANHERI	126522	891	125631
4	SAMAIN	48735	NIL	48735
	TOTAL	232227	1053	231174

Assistant Executive Engineer
Construction Sub Division
HVPNL, HISSAR

Executive Engineer
TS Division HVPNL
HISSAR


FOREST PROPOSAL

LILO OF 132 KV TOHANA-DHAMTHAN SAHIB LINE AT 220 KV S/STN SAMAIN 02.SQ*ACSR PANTHER CONDUCTOR

IN Fatehabad DISTRICT

Crossing Between:- Tower No.03- Tower No.04

TL.NO.04

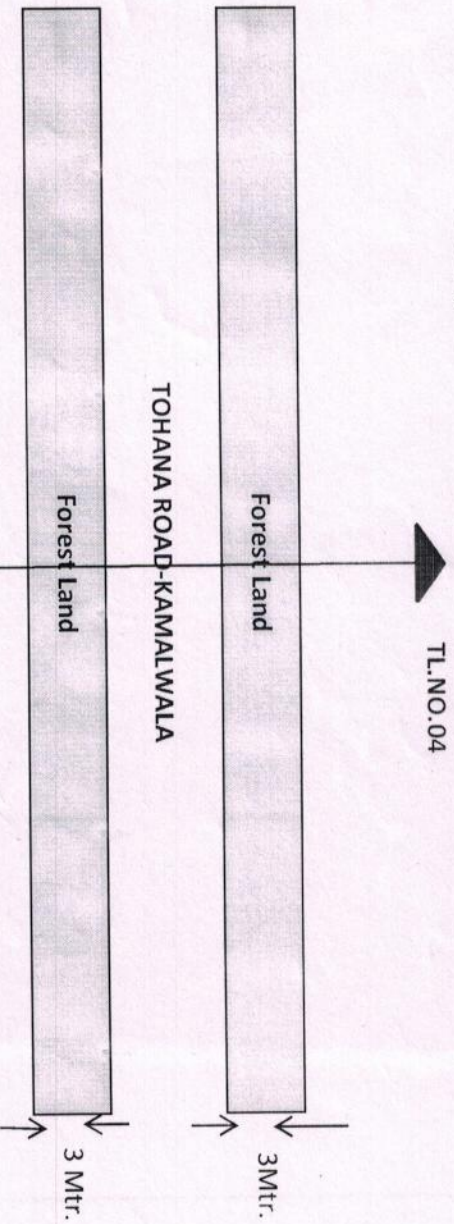

NO OF TREE-NIL

TL. NO.03

Side	Length in Mtr.	Width in Mtr.	Area Sq. Mtr.	Area in Hac.
Left	3	27	81	0.0081
Right	3	27	81	0.0081
TOTAL			162	0.0162

Place-..... Fatehabad

Date-.....

Assistant Executive Engineer
Construction Sub Division
HVPNL, HISSAR

Executive Engineer
TS Division HVPNL
HISSAR

FOREST PROPOSAL

LILO OF 132 KV TOHANANA-DHAMTHAN SAHIB LINE AT 220 KV S/STN SAMMAIN 02.SQ*ACSR PANTHER
CONDUCTOR

IN Fatehabad DISTRICT

Crossing Between:- Tower No.12 - Tower No.13

TL.NO.13

Forest Land

5 Mtr.

DAIN

Forest Land

10 Mtr.

NO OF TREES = 35 EUCALYPTUS
NO OF TREES = 03 NEEM

TL. NO.12

Side	Length in Mtr.	Width in Mtr.	Area Sq. Mtr.	Area in Hac.
Left	5	27	135	0.0135
Right	10	27	270	0.0270
	TOTAL		405	0.0405

Place- Fatehabad

Date-.....

Assistant Executive Engineer
Construction Sub Division
HVPNL, HISSAR

Executive Engineer
TS Division HVPNL
HISSAR

FOREST PROPOSAL

LILO OF 132 KV TOHANA-DHAMTHAN SAHIB LINE AT 220 KV S/STN SAMAIN 02.SQ*ACSR PANTHER
CONDUCTOR

IN Fatehabad DISTRICT

Crossing Between:- Tower No.13- Tower No.14

TL.NO.14



Forest Land

3Mtr.

TOHANA-SAMAIN ROAD

Forest Land

3 Mtr.

NO OF TREES = 06 ARJUN

TL. NO.13



Side	Length in Mtr.	Width in Mtr.	Area Sq. Mtr.	Area in Hac.
Left	3	27	81	0.0081
Right	3	27	81	0.0081
TOTAL			162	0.0162

Place- Fatehabad

Date-.....

Assistant Executive Engineer
Construction Sub Division
HVPNL, HISSAR

Executive Engineer
TS Division HVPNL
HISAR

FOREST PROPOSAL

LILO OF 132 KV TOHANA-DHAMTHAN SAHIB LINE AT 220 KV S/STN SAMAIN 02.SQ*ACSR PANTHER
CONDUCTOR

IN Fatehabad DISTRICT

Crossing Between:- Tower No.15- Tower No.16

TL.NO.16

TOHANA ROAD-LOHA KHERA

NO OF TREE-NIL

TL. NO.15

Side	Length in Mtr.	Width in Mtr.	Area Sq. Mtr.	Area in Hac.
Left	3	27	81	0.0081
Right	3	27	81	0.0081
TOTAL			162	0.0162

Place- Fatehabad


Date-.....

Assistant Executive Engineer
Construction Sub Division
HVPNL, HISSAR

Executive Engineer
TS Division HVPNL,
HISSAR

LILO OF 132 KV TOHANA - DHAMTHAN SAHIB LINE AT 220 KV

S/STN SAMAIN 02.50" ACSR PANTHER CONDUCTOR.

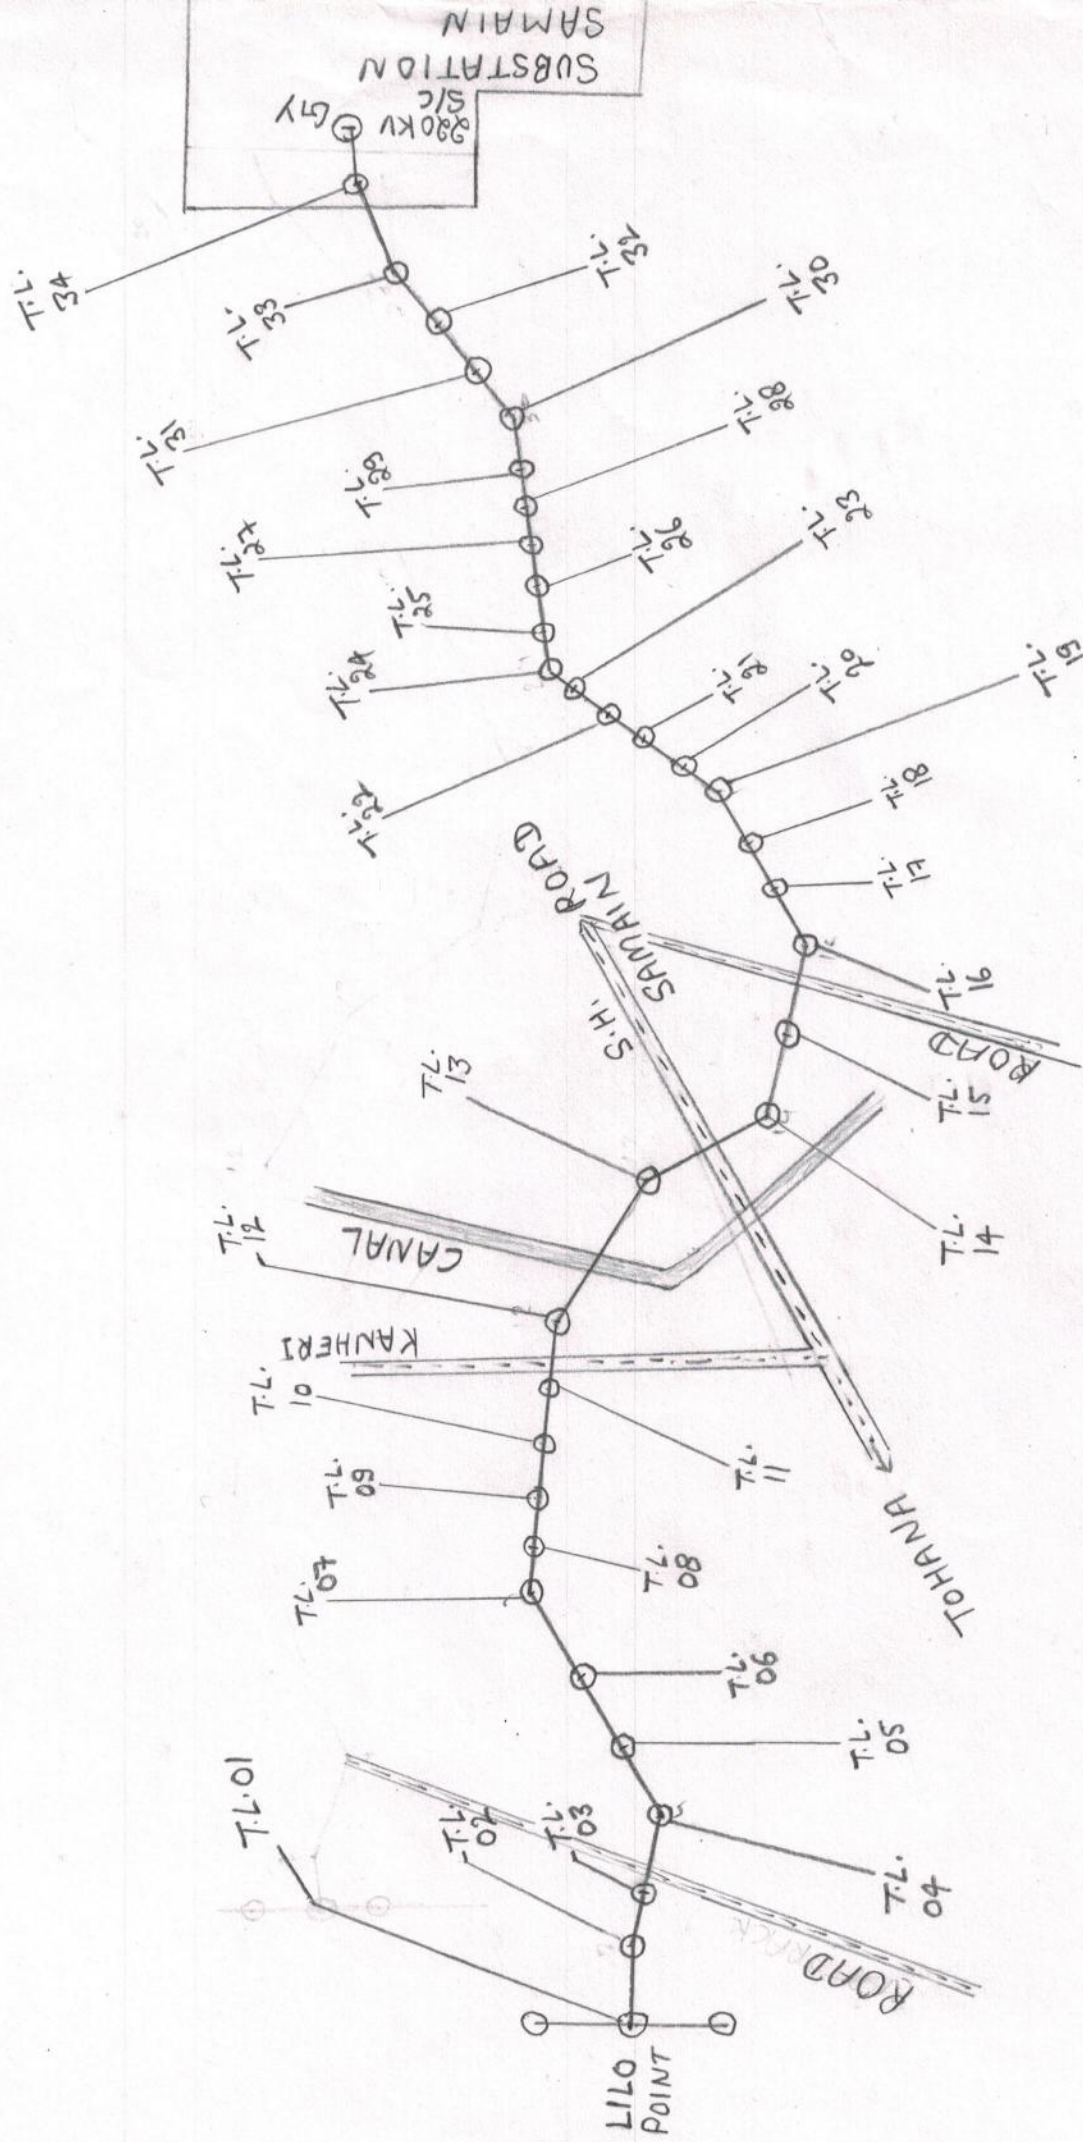

 S.D.O. Construction
Executive Engineer
S/Divn. HVPNL, Hisar
TS Division HVPNL
HISAR