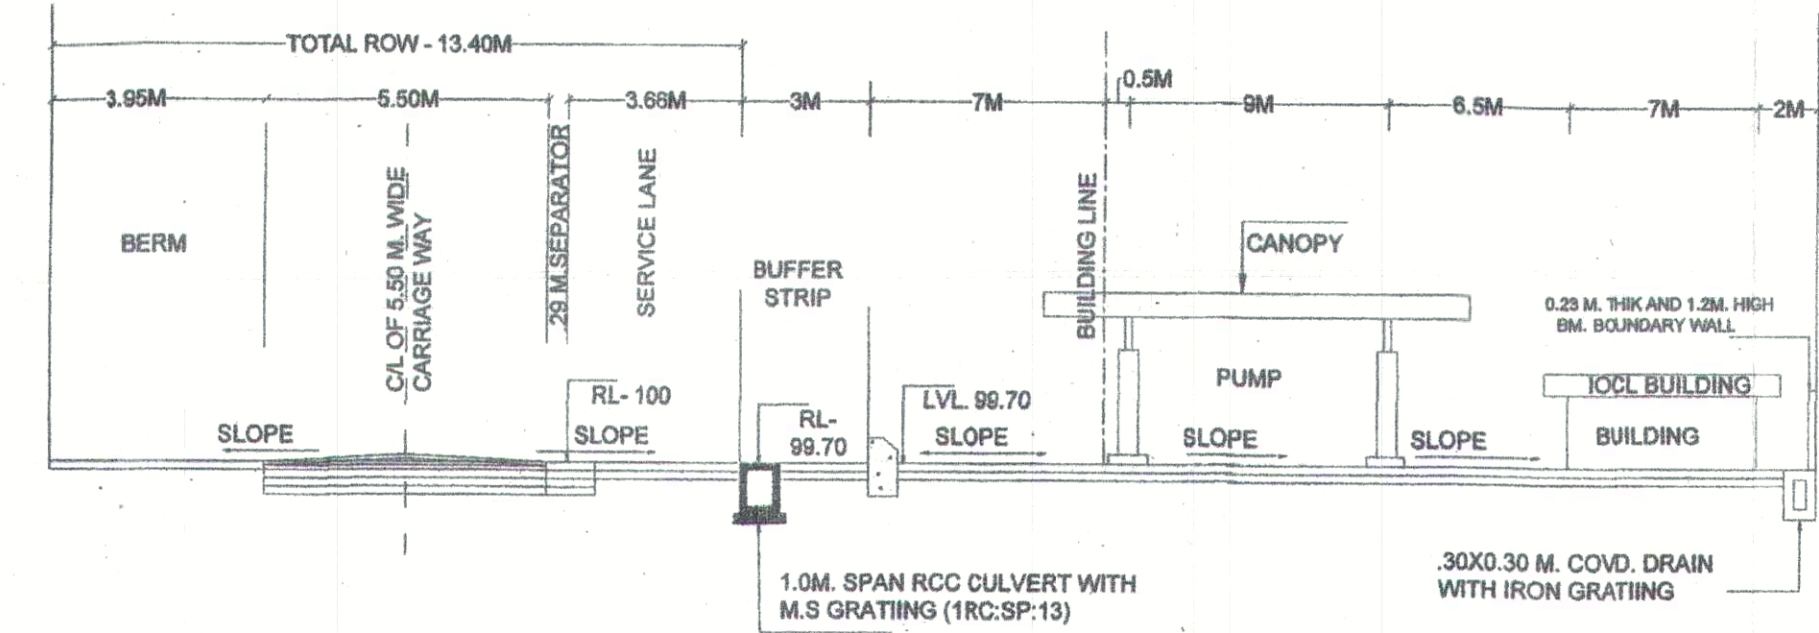



[illegible][illegible][illegible]

Certificates

1. It is certified that there is no encroachment at the proposed fuel station.
2. Row at the Proposed fuel station is 13.400 meter.
3. It is found that an 11 KV High Transmission Power line is passing along road side through the PWD Land Plan supply pipeline is passing through the Proposed fuel station.
4. There is no sewer line and underground water supply pipeline is passing through the Proposed fuel station.
5. It is certified that No permission / Note of access within 300 meter 1000 meter (undivided) Divided) carriage way on either side of Proposed outlet has been given in past and all such type of Repairs could not be shown in the drawing.
6. No HT Electric Power line is passing through the Proposed fuel station.

CH - 12356-0
OPEN
AGRICULTURAL LAND


Sub ~~Divisional~~ Engineer
Provincial Sub. Division
PWD (B&R) Br. Hodal
Rohit

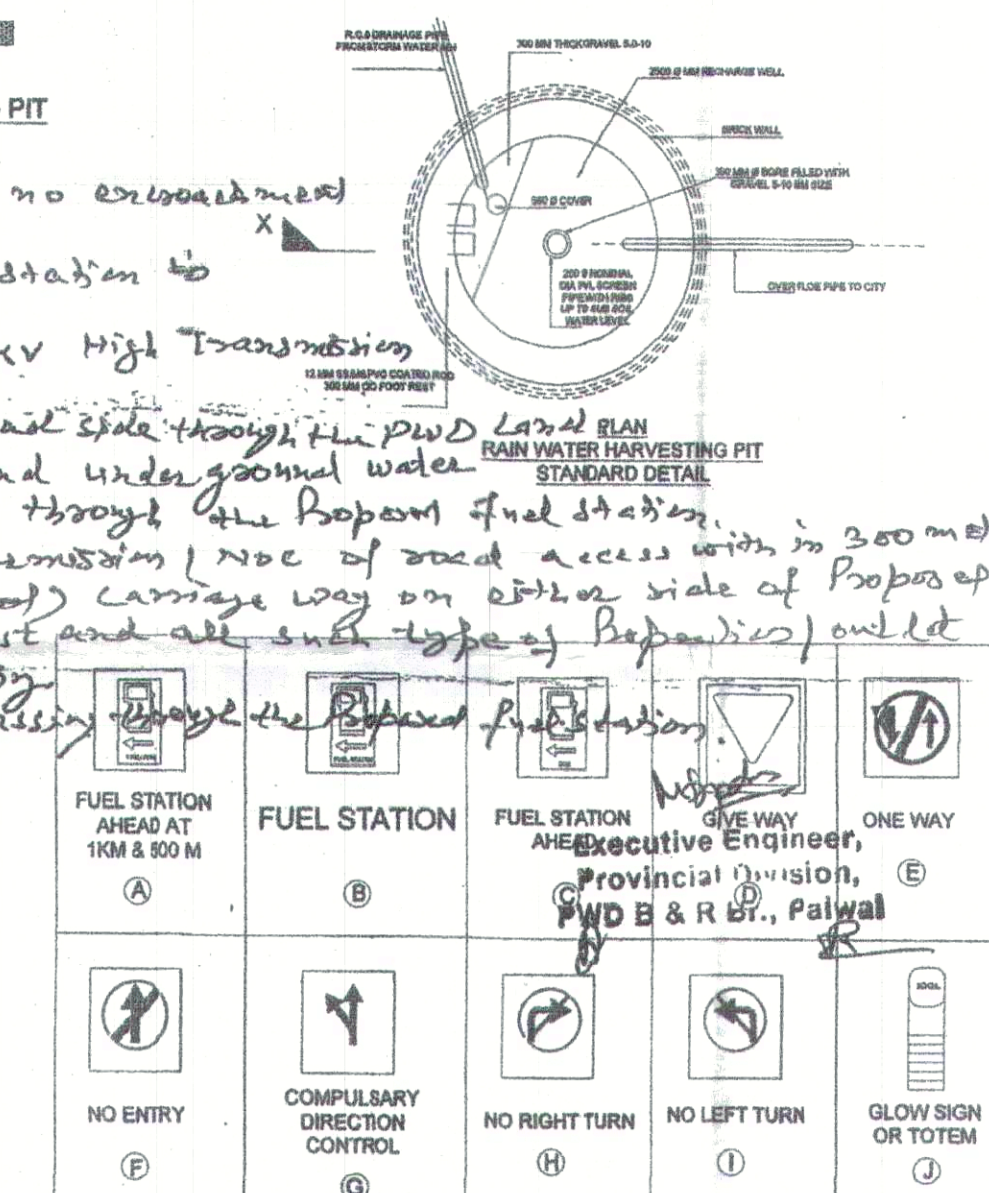

TANK DATA CHART				
TANK NO.	SIZE OF TANK	TANK & PUMP		
		MS	HSD	
1X30 KL	2.1 X 8.25 M. LONG		HSD	
1X20 KL	2.1 X 8.25 M. LONG		MS	
CONST. DETAIL OF U/G TANK				
CAPACITY	(L)	(D)	(PL1)	
15KL	5.0M	2.101M@		6MM
20KL	6.75M	2.102M@		6MM
SCHEDULE OF TANK AND PUMP				
PRODUCT	CAPACITY	NO. OF TANK	PUMP NO. OF NOZZLES	
MS	15KL	1NO	4NOS	
HSD	20KL	1NO	4NOS	
AREA STATEMENT:-				
TOTAL AREA OF PLOT		= 1225.50 SQ.M.		
PROPOSED CLOT, AREA OF BUILDING = 66.50 SQ.M.				
SITE INFORMATION:-				
VILLAGE	GULAWAD			
ROAD ID	QDR 3441			
KILLA NO.	19/2			
KHEWAT NO./KHATAUNI NO.	706 / 756			
MUSTIL NO.	85			
TEHSIL	HODAL			
DISTRICT	PALWAL			
STATE	HARYANA			
NEAR POLICE STATION	HASSANPUR			
NEAR RAILWAY STATION	HODAL			

1. V-PH PIPES WITH 4 IN. HSIH & 4.0 M. CLAMP AROUND ENDS THROUGHT LAYERS OF BRASS WIRE GAUGE 1 MESH PER LINEAL CENTIMETER.
2. V-PH PIPES FITTED WITH CUP OR CUP LIKE COUPLER IN AIR TIGHT COVERED WITH BRASS CAP FOR DECAYING FROM TANK LAKERY.
3. ALL ELECTRICAL FITTINGS ARE LINE PROOF CONFORMING TO 2-3148.
4. ALL DOORS OF BUILDING TO BE OPENED OUT HARDLY.
5. NO SEWER OR OTHER DRAIN WITHIN 6 M. OF THE TANKS & D.U.
6. PREMISES TO BE USED FOR ONLY STORAGE OF PETROLEUM PRODUCTS.
7. TANKS ARE PAINTED WITH TWO LAYERS OF HOT BITUMEN UNDER TWO COATS OF RED LEAD PRIMER TO PROTECT AGAINST CORROSION.
8. FOUNDRY AND BLACK SMITH WORK OF STEEL STORAGE TANKS ARE CONFORMED TO IS : 10897-1982 AS PER C.C.O. & NAGPUR ORDINANCE 10-4/2000/MS/2002 DATED 24.05.2002.
9. TANKS ARE KEPT IN A LEAK PROOF CONDITION NOTED.
10. S-BAND BRIGHT TO NOT AS PER EXISTING RULES.
11. F-8 FIBRE INSULATOR - NO GAS IS FOR EXPLOSION RESISTANT.
12. TANKS OVER 1000 LITERS PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED. THE TEST SHOULD BE MENTIONED AT A CONTROLLED PRESSURE OF 0.38 MEGAPASCAL FOR 2 HOURS.
13. NO FIBRE INSULATOR OF ANY TYPE OF INSULATION SHOULD BE 30MM MAX INSTEAD OF STANDARD 2500 MM.
14. FABRICATION PARTICULARS OF SHELL PLATES AND END PLATE OF TANKS.
20 IN. BULLHEAD
END-BASE
15. TANKS CONFORM TO IS 2153 & 1511 OF THE PETROLEUM RULES 2000.
16. ALL LIGHTS PROVIDED ARE FITTED AS PER APPROVAL OF C.C.O. NAGPUR VIDE LETTER NO. PL-10/MS/2002 DATED 28.11.1993.
17. WHEN A SIGNAL FROM THE SIDE OF METAL ROAD TO GO/NOT TO GO APPROACHES WILL BE MAINTAINED FREE FLOW OF WATER TOWARDS ROAD.
18. ALL WORKS TO BE COMPLETED IN ACCORDANCE WITH LATEST AMENDMENTS.
20. EV-EXCHANGING POINTS
P-EXTENDED R/O POINTS
19. THE PROPOSED SITE IS FREE FROM ANY TYPE OF LITIGATION AND NO CASE IS PENDING IN ANY COURT OF LAW.
20. NO ELECTRIC LINE PASSING OVER THE R/O PREMISES.

DATE	REV.NO.	BRIEF DESCRIPTION OR REVISIONS MADE	CHEAKED
------	---------	-------------------------------------	---------

 Indian Oil		Indian Oil Corporation Limited (Marketing Division) Guragon Divisional Office,	
PROPOSED RETAIL OUTLET AT VILLAGE- GULAWAD ON GULAWAD TO HASSANPUR ROA , TEHSIL - HODAL, DISTT. PALWAL (HARYANA) ODR ROAD ID - 3491			
PIN CODE NO		POLICE STATION	HASANPURA
DRAWN BY.	SEHGAL	RLY STATION	HODAL
APPROVED BY.		SCALE	1:200
CHECKED BY.		DRAWING NO.	RWR / GULAWAD /01
DATED	09.03.2021		
			PREPARED BY.
अभिनेय कपूर / Abhinay K. हासक प्रबंधक (रि.सं.) , ए.सी.डी.ए. 11 , Asst. Manager (RS), Field-Seed & L.S. एडमिनिस्ट्रेशन बिल्डिंग, 7, बिल्डिंग, INDIAN OIL CORPN.			SANDEEP KUMAR MOB. 9991638186

Indian Oil Corporation Limited
(Marketing Division)
Gurugon Divisional Office,

**PROPOSED RETAIL OUTLET AT VILLAGE- GULAWAD ON GULAWAD TO
HASSAMPUR ROA , TEHSIL - HODAL, DISTT. PALWAL (HARYANA)
ODR ROAD ID - 3491**

PIN CODE NO		POLICE STATION	HASANPURA
DRAWN BY.	SEHGAL	RLY STATION	HODAL
APPROVED BY.		SCALE	1:200
CHEAKED BY.		DRAWING NO.	RWR / GULAWA
DATED	09.03.2021		

अभिनव कपूर/Abhinav K. सहायक प्रबंधक (फि.रे.), जल-संयंत्र-1, 1 Asstt. Manager (SR), Fairfield 41.1.8 इण्डियन ऑइल कॉर्पोरेशन लिमिटेड INDIAN OIL CORPORATION LTD.	PREPARED BY.
---	---------------------