
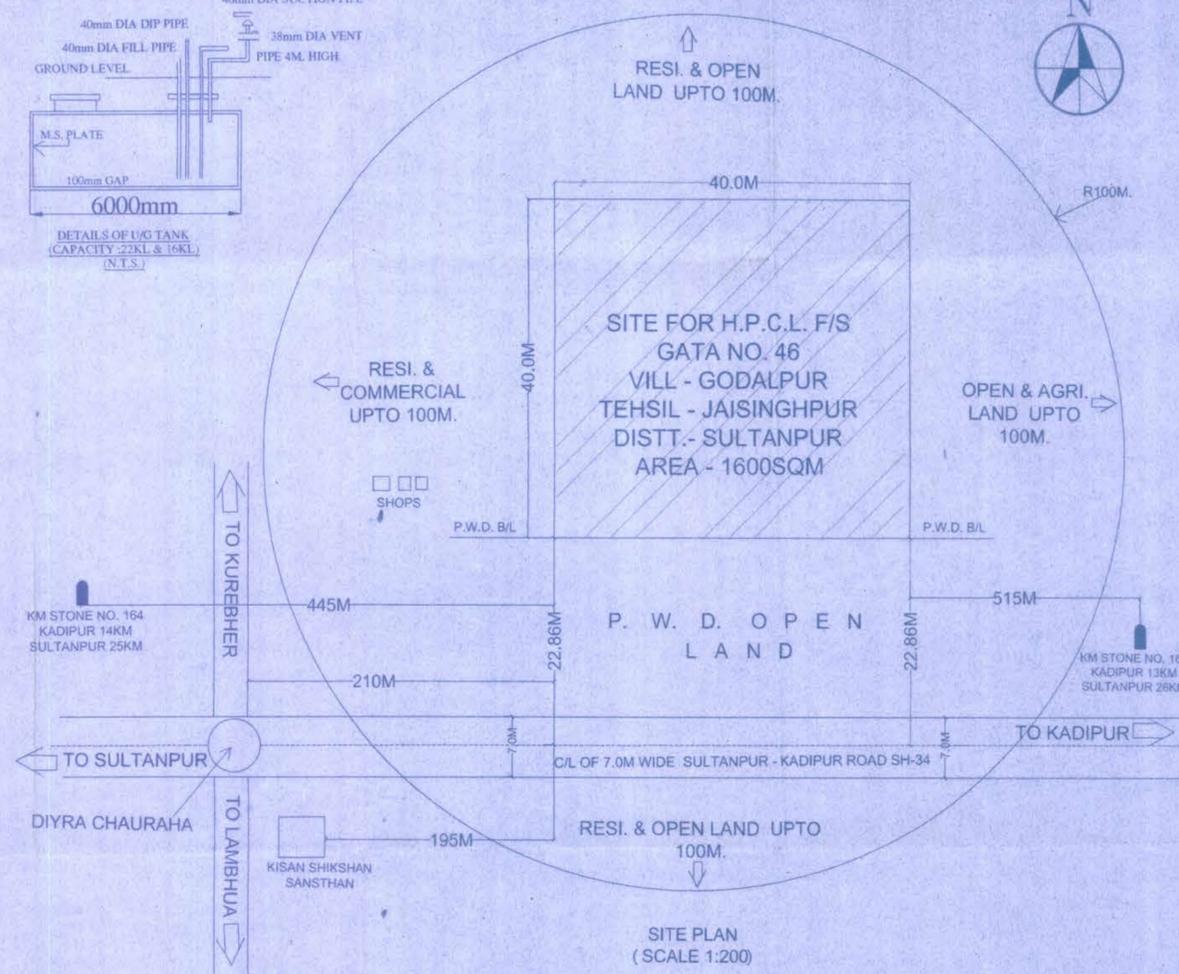
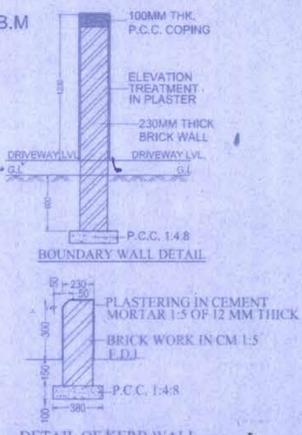
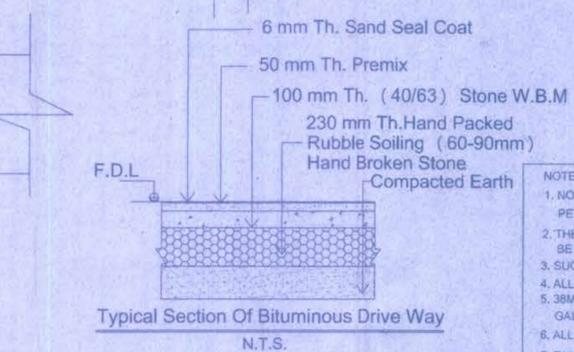
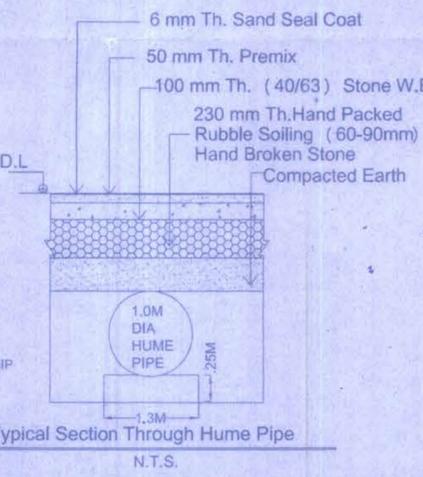
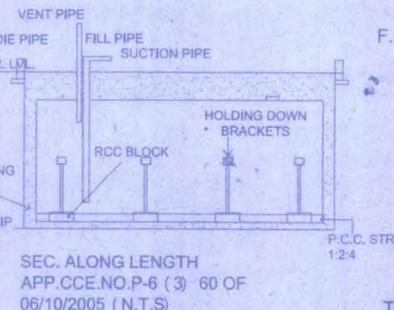
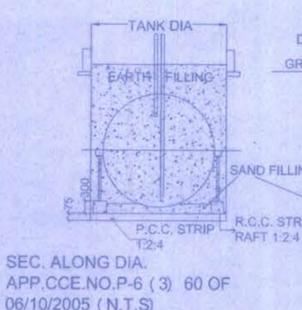
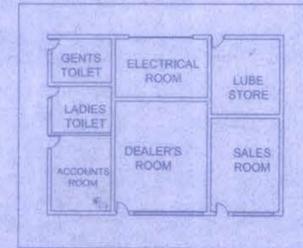
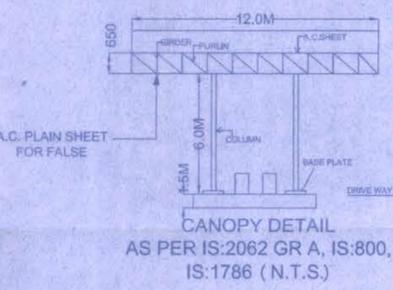
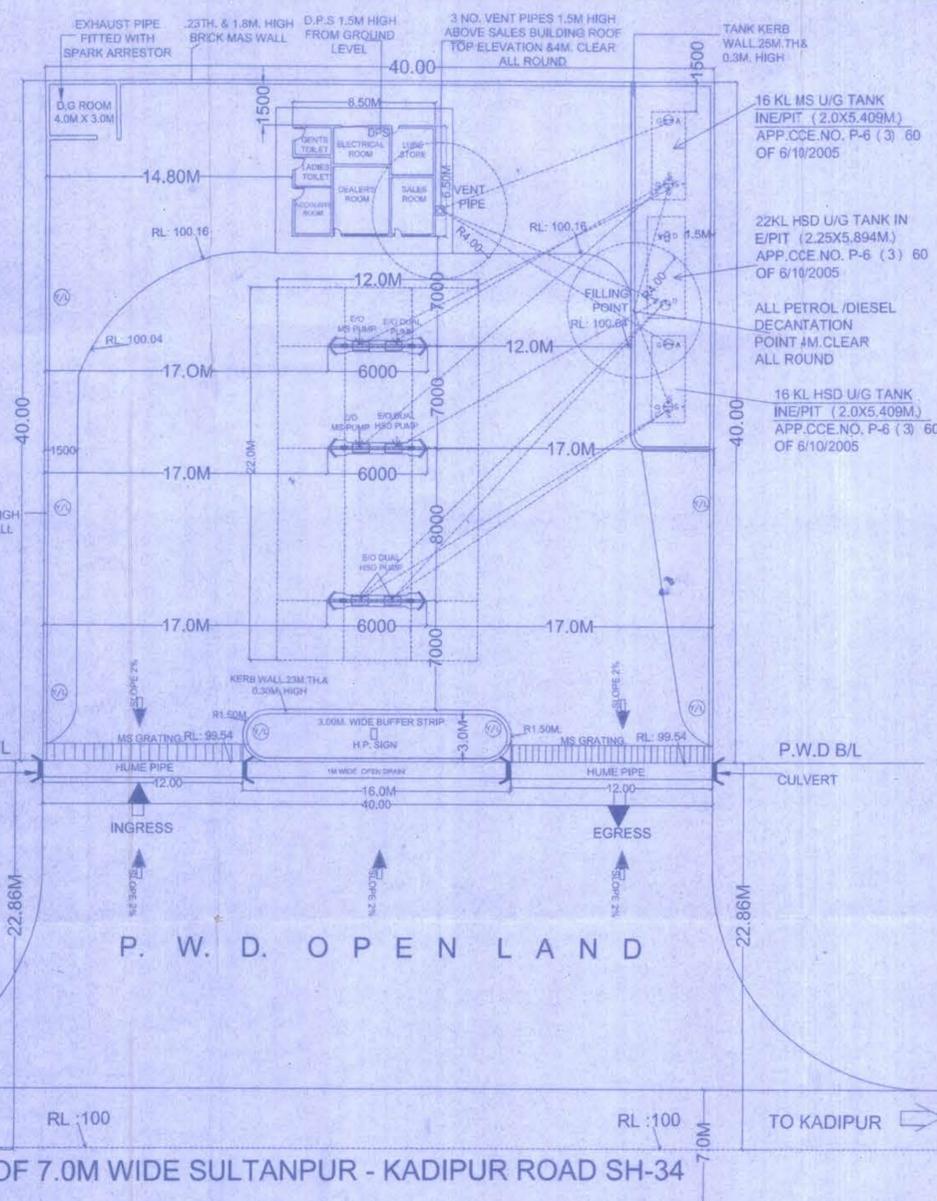


GATA NO.	46
VILL.	GODALPUR
PARGANA	ALDEHMAU
TEHSIL	JAISINGHPUR
NEAREST POLICE STN.	MOTIGARPUR
NEAREST RLY. STN.	LAMBHUA
DISTT.	SULTANPUR
PIN CODE	228171
STATE	UTTAR PRADESH

GROUND FLOOR	
TYPE	SIZE
ELEC. ROOM	3000X2000
ACCT. ROOM	2000X2680
LUBE STORE	2580X2810
DEALER'S RM	3000X3600
GENTS TOILET	2000X1500
LADIES TOILET	2000X1500
SALES ROOM	2580X3340

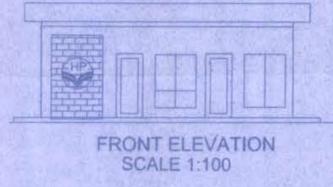

- NOTES:
- NO OTHER STRUCTURE ERECTED NOR ANY OTHER SERVICE RENDERED EXCEPT THAT CONNECTED WITH PETROL PUMP WITHOUT PRIOR APPROVAL OF P.W.D.
 - THE BERM PORTION IS NOT INCLUDED IN THE AREA TO LEASED FROM P.W.D. FOR APPROACH ROAD BUT TO BE METALLED BY THE COMPANY.
 - SUCTION PIPE UNDER DRIVE WAY TO BE HOUSE IN PIPE SLEEVE FILLED WITH SAND.
 - ALL THE TANK ARE NOT TO BE REPLENISHED AT THE SAME TIME.
 - 38MM AIR VENT PIPE 4.0M HIGH FROM G.L. ON ITS ENDS TWO LAYERS OF NON-CORRODIBLE METAL WIRE GAUGE OF 11 MESH PER LINEAR CM IS TO BE PROVIDED.
 - ALL ELECTRICAL FITTING CONFORM TO IS:2148, FOR DISPENSING UNITS.
 - TANK TO BE FEED BY TANK LORRY ONLY.
 - D.P.S. BOARD 1.5 M. FROM G.L. & NOT BE KEPT UNDER LOCK & KEY.
 - NO SMOKING SIGN IS TO BE DISPLAYED PROMINENTLY.
 - ALL STRUCTURE ON GOVT. LAND SHALL BE TEMPORARY.
 - ALL DIMENSIONS ARE IN METER UNLESS STATED OTHERWISE.
 - 6 NOS. FIRE-EXTINGUISHERS DRY-CHEMICAL TYPE ARE APPROVED IN LICENCED PREMISES.
 - 8 NOS. FIRE BUCKET FILLED WITH SAND ARE PROVIDED IN LICENCED PREMISES.
 - FILL POINTS 4.0M CLEAR ALL ROUND.
 - VENT PIPE SHALL BE 1.5 M HIGH ABOVE SALES BUILDING SLAB TOP & 4.0 M CLEAR ALL ROUND.
 - VENT HOOD FITTED WITH 2 LAYERS OF NON CORRODIBLE METAL WIRE GAUGE OF 11 MESH PER LINEAR CM.
 - APPROACHES SHOULD HAVE MIN. PAVEMENT COMPOSITION OF 150MM GSB WBM GR OF 75MM BM EACH, 50MM BM & 25MM SDC.
 - NO CASE AGAINST THE LAND IS PENDING IN ANY COURT.
 - THE TANK ARE FABRICATED AS PER IS: 10987 OF 1992 (RE-AFFIRMED IN 1998)
 - NO HIGH TENSION LINE IS PASSING THROUGH THE PREMISES.
 - TANKS KERB WALL 0.25M TH & 0.30M HG FROM FLOOR LVL. PROVIDED TO THE EARTH BURIED.
 - ROAD LEVEL ASSUMED AS 100M. ELEVATION.

HP HINDUSTAN PETROLEUM CORPORATION LTD.
PLOT NO. 1, NEHRU ENCLAVE, GOMTI NAGAR, LUCKNOW.

PROPOSED LAYOUT PLAN OF FILLING STATION AT GATA NO. - 46, VILL. - GODALPUR PARGANA - ALDEMAU, TEHSILE - JAISINGHPUR ON SULTANPUR - KADIPUR ROAD SH - 34 KM STONE NO. (164 - 165) DISTT. - SULTANPUR U.P.

SCALE AS SHOWN CHKD/APP. BY: DRG.NO.-HPCL/K/02/016

DRAWN BY: BSG ENGINEERS ASHYAMA UKO Chief Regional Manager (Lucknow Retail) Region Off.

PRANAW KUMAR SINHA
Sr. Manager-Retail Operations
Hindustan Petroleum Corporation Ltd.
Plot No. 1, Nehru Enclave,
Gomti Nagar, Lucknow-226018

10-10-2016