
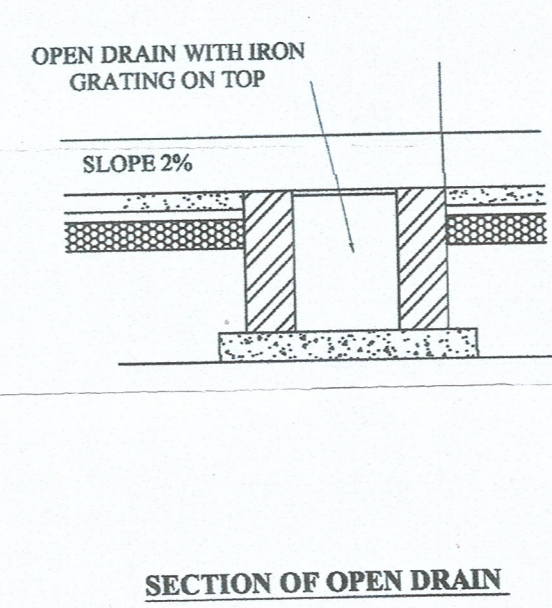
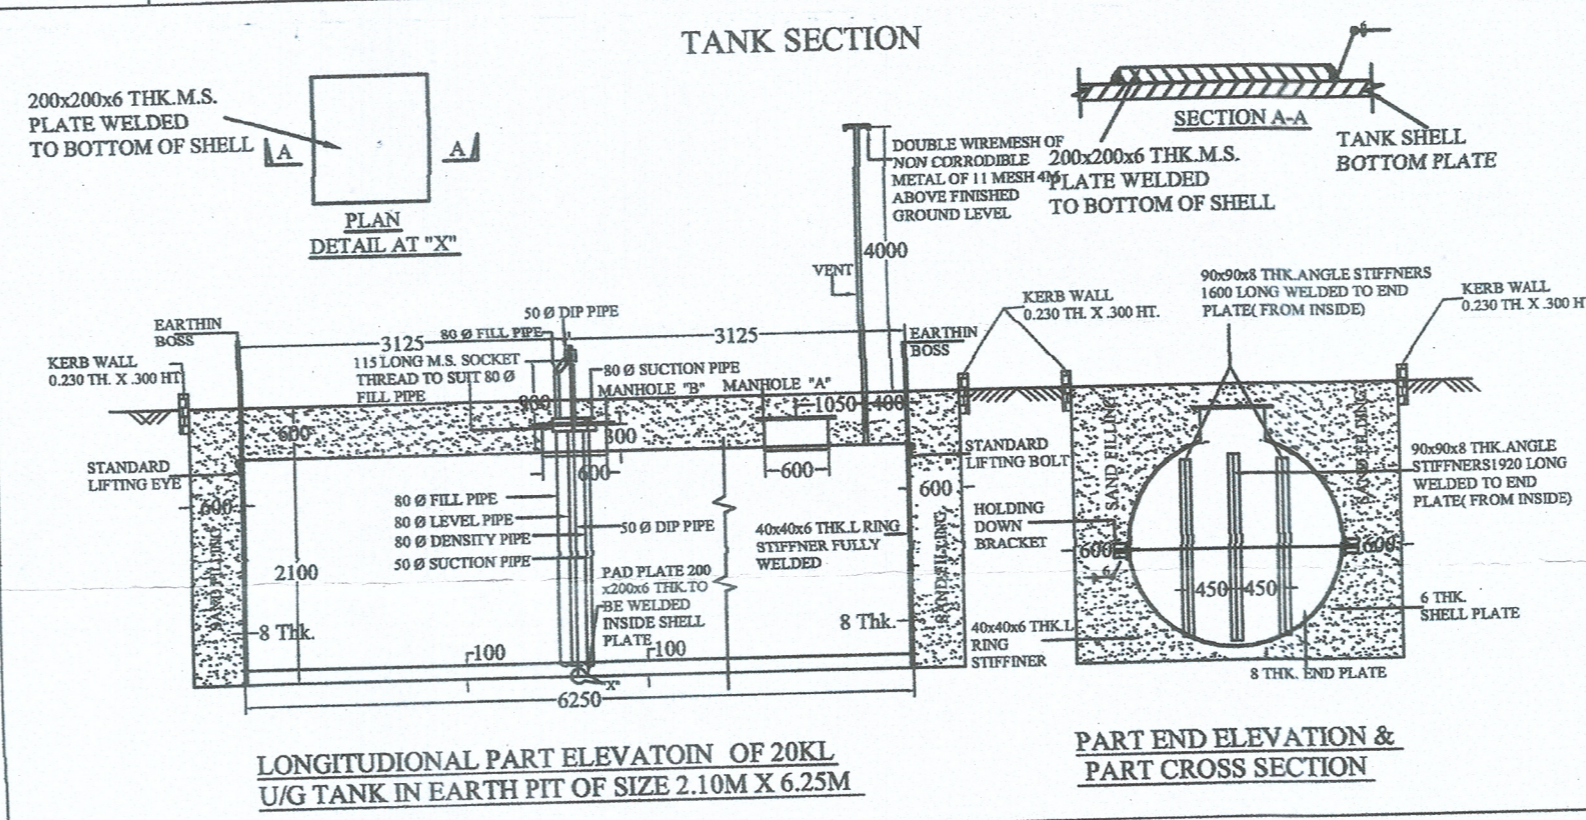
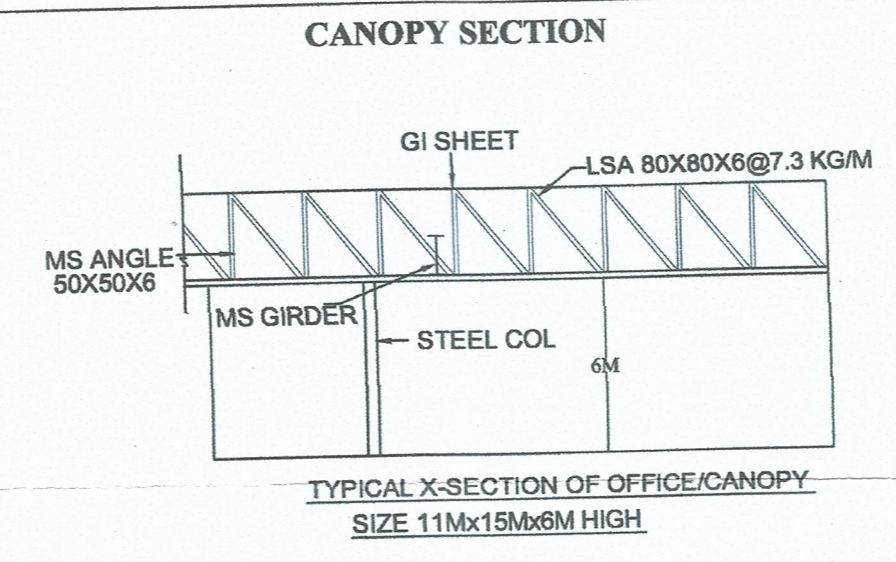
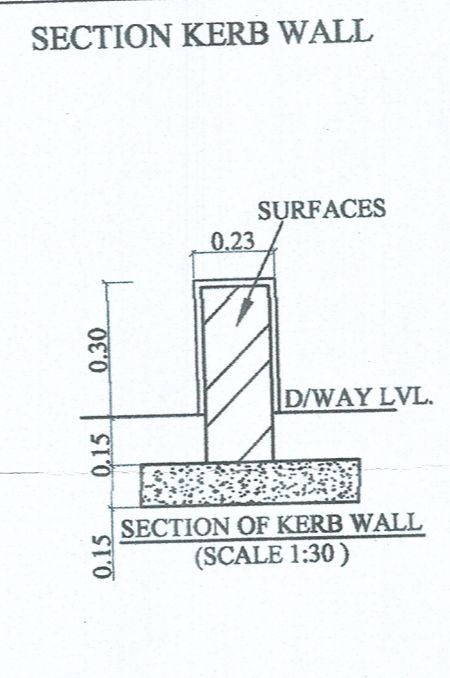
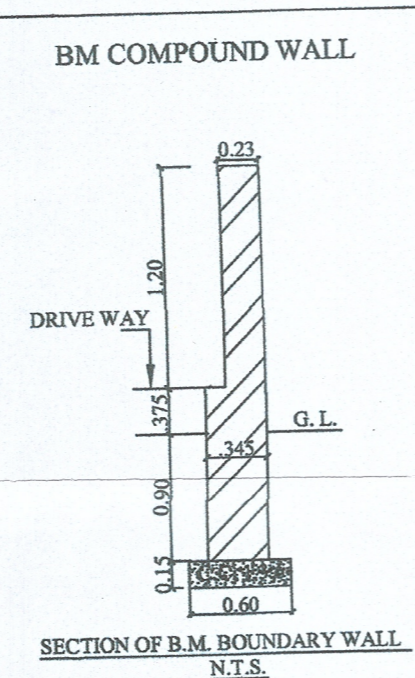


**LAYOUT PLAN
SCALE 1:250**

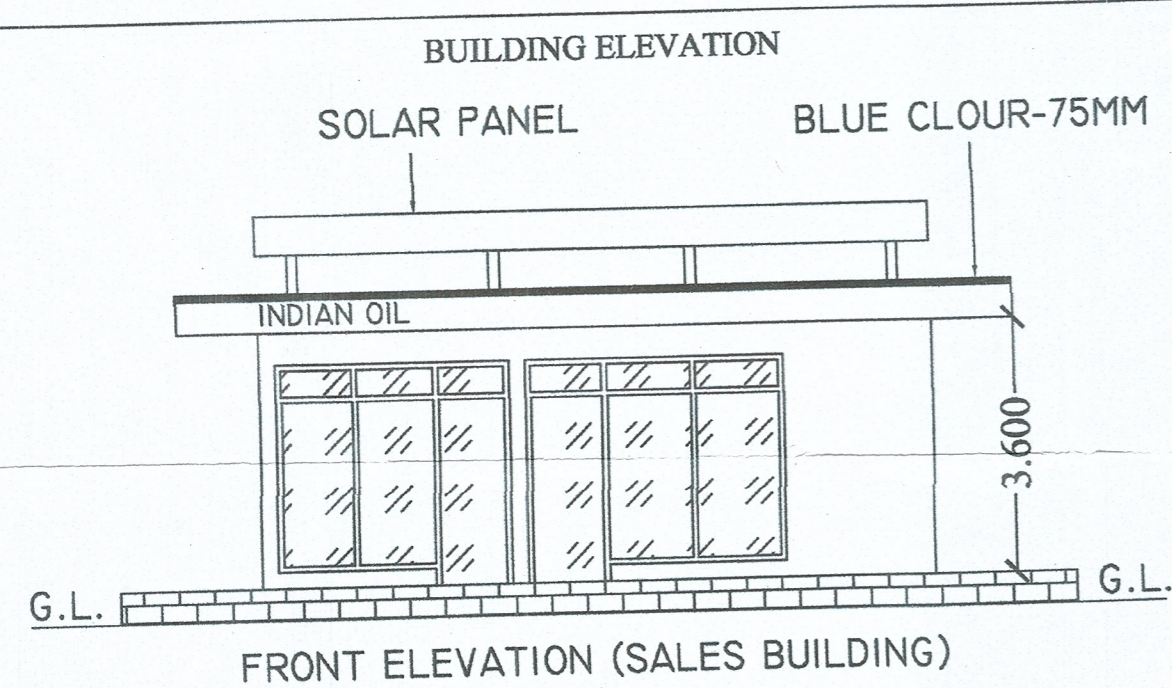

- REFERENCE:-**
 F : Tank Fill Point
 S : Tank Suction Point
 V : Tank Vent Point
 D : Tank Dip Point
 EFP : Extended Fill Pipe
 EVP : Extended Vent Pipe
 SAP : Single Arm Pole
 DAP : Double Arm Pole

REV. NO.	DESCRIPTION OF FACILITIES	DATE

TANK	SIZE OF TANK	MS SHELL	MS END	NO OF H.D.B.	VENT PIPE DIA.	SLAB TH. IN MM	TANK & PUMP MS	TANK & PUMP HSD
20 KL	2.1M X 6.25M. LONG	6mm	8mm	8	40	-	1+1	1+1

SITE DATA CHART	
LOCATION	MANAK TABRA
KHASRA NO.	79/10
KHEWAT NO.	613/569
KHATONI NO.	825
POLICE STN.	RAIPUR RANI
RAILWAY STN.	CHANDIMANDIR
TEHSIL	PANCHKULA
DISTT.	PANCHKULA
STATE	HARYANA
PIN CODE	134204

INDIAN OIL CORPORATION LIMITED, MARKETING DIVISION, PANIPAT DIVISIONAL OFFICE, PANIPAT.	
TITLE:- SITE/LAYOUT PLAN OF IOCL RETAIL OUTLET (KSK) SITUATED ON KOTBILA/NH-73 - RAIPUR RANI ROAD, AT VILLAGE MANAK TABRA, TEHSIL & DISTT. PANCHKULA (HARYANA).	
DRG. NO.PDO/KSK/MANAK TABRA	
DATE :01.06.2021	
DRAWN BY:- DEV SHREE TRADERS	CHECKED BY: [Signature]
	APPROVED BY: [Signature]

- GENERAL NOTES:**
- NO ROAD CROSSING WITHIN 100.00 M ON EITHER SIDE OF THE PLOT.
 - NO DRAIN SEWER OR STRUCTURE WITHIN 1.50 M FROM THE UNDER GROUND TANKS.
 - SUCTION, FILL & VENT PIPES UNDER THE DRIVEWAY TO BE HOUSED UNDER PIPE SLEEVES.
 - VENT PIPES 40 MM DIA 4.00 M HIGH FROM THE GROUND LEVEL AND 4.00 M CLEAR AROUND WITHIN THE PLOT FILLED WITH INVERTED "U" TYPE VENT HOOD COVERED WITH TWO LAYERS OF NON CORRODABLE MATTTEL WIRE GAUZE OF 11 MESH PER LINEAR CENTIMETER AT ITS OPEN ENDS.
 - D.P.S. BOARD FIXED ON THE WALL OF DEALER ROOM 1.500 M HIGH FROM ITS FLOOR LEVEL AND SHALL NOT BE KEPT UNDER LOCK AND KEY.
 - FILL POINTS ARE KEPT 3.650 M CLEAR AROUND.
 - "NO SMOKING" SIGN SHALL BE DISPLAYED AT THE PETROL PUMP.
 - 2 NOS. DCP TYPE FIRE EXTINGUISHERS AND DRY SAND BUCKET OF CAPACITY 10 KG FOR EACH DISPENSING PUMP, 2 NO. CO2 TYPE FIRE EXTINGUISHERS OF CAPACITY 4.50 KG EACH FOR ELECTRIC FIRE SHALL BE PROVIDED AT THE PUMP.
 - TANKS FED BY TANK LORRY.
 - BOTH THE TANKS SHALL NOT BE REPLENISHED AT THE SAME TIME.
 - FILL PIPES AND DIP PIPES ARE FITTED WITH LOCKING ARRANGEMENT.
 - ALL ELECTRIC FITTINGS SHALL CONFORM TO IS 2148 OR EQUIVALENT ISI SPECIFICATIONS.
 - NO HT LINE PASSING OVER KSK/RO LAND

- SPECIFICATIONS:-**
- CERTIFIED THAT UNDERGROUND MS TANKS SHALL BE FABRICATED AND INSTALLED AS APPROVED BY CCOE NAGPUR, VIDE LETTER NO. P-6 (3) 51 DATED 23.01.07.
- NOTES:-**
- CERTIFIED THAT THIS IS A NEW KSK/RO.
 - CERTIFIED THAT ALL THE CLEARANCES/APPROVALS FROM OTHER RELEVANT GOVT. DEPTT. SHALL BE OBTAINED.
 - CERTIFIED THAT M.S. CANOPY SHALL CONFIRM TO SOUND ENGG. SPEC. AND THERE IS NO CHANCE OF ITS EVER CAVING-IN UNDER NORMAL CIRCUMSTANCES.
 - CERTIFIED THAT ALL FACILITIES AS SHOWN IN THE DRAWING SHALL BE INSTALLED/PROVIDED AT ABOVE KSK/RO.
 - ALL DIMENSION IN METER OTHERWISE SPECIFIED.

Dimesh

[Signature]

Executive Engineer
 Prov. Divn. Haryana PWD B&R Br.
 Panchkula

GATI BODH JAHAL
 Divisional Retail Head
 Indian Oil Corporation Ltd.
 Panipat Divisional Office
 Panipat Refinery
 Panipat-132140