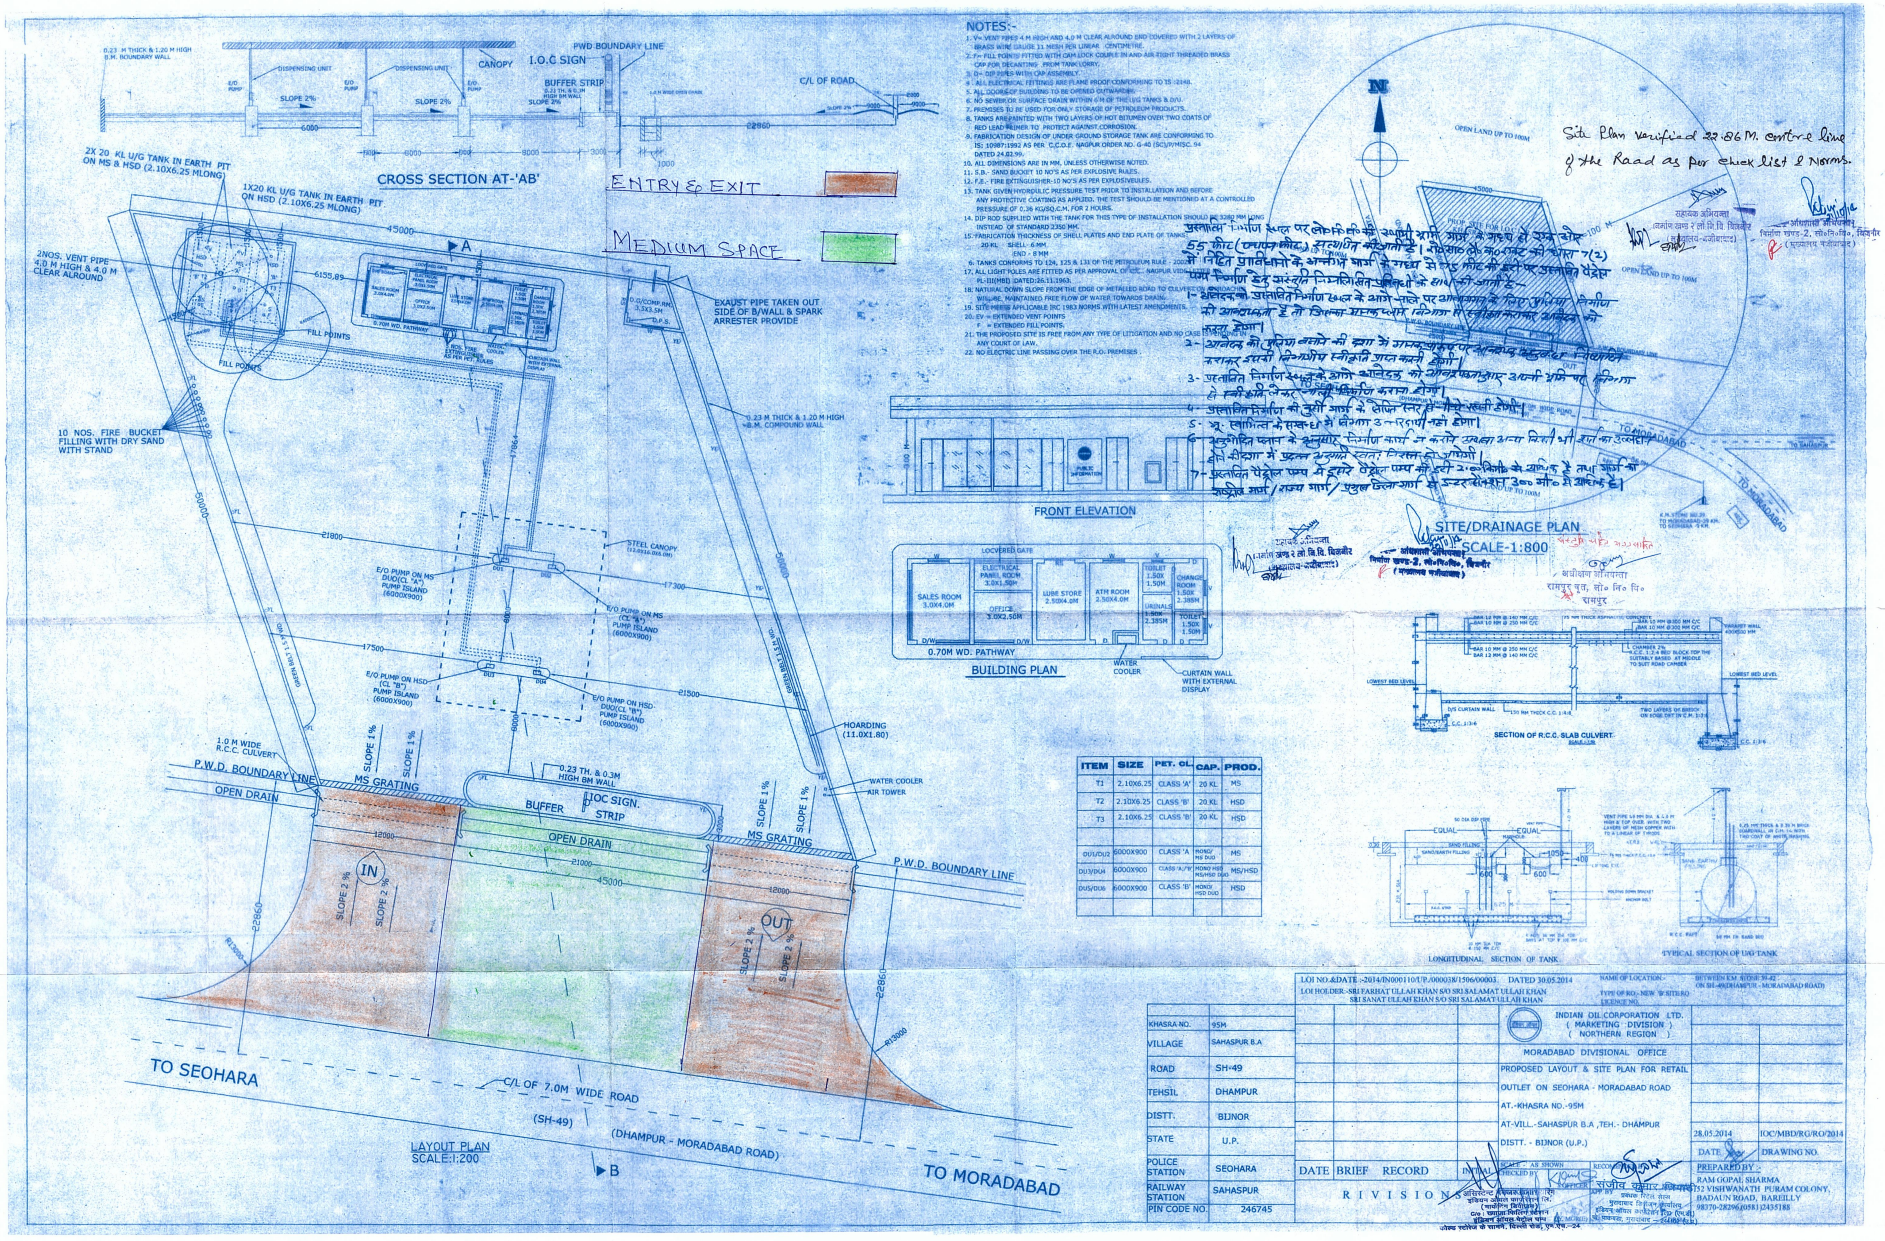

NOTES:-

1. V= VENT PIPES 4 M HIGH AND 4.0 M CLEAR ALROUND AND COVERED WITH 2 LAYERS OF BRASS WIRE GAUGE 11 MESH PER LINEAR CENTIMETRE.
2. F= FILL POINTS FITTED WITH QUIK LOCK COUPLE IN AND AIR TIGHT THREADED BRASS CAP FOR DECANTING FROM TANK LORRY.
3. D= DIP PIPES WITH CAP ASSEMBLY.
4. ALL ELECTRICAL FITTINGS ARE FLAME PROOF CONFORMING TO IS :2148.
5. ALL DOORS OF BUILDING TO BE OPENED OUTWARDS.
6. NO SEWER OR SURFACE DRAIN WITHIN 6 M OF THE U/G TANKS & D/U.
7. PREMISES SHALL BE USED FOR ONLY STORAGE OF PETROLEUM PRODUCTS.
8. TANKS ARE PAINTED WITH TWO LAYERS OF HOT BITUMEN OVER TWO COATS OF RED LEAD PRIMER TO PROTECT AGAINST CORROSION.
9. FABRICATION DESIGN OF UNDER GROUND STORAGE TANK ARE CONFORMING TO IS: 10987:1992 AS PER C.C.O.E. NAGPUR ORDER NO.: G-40 (SC)/P/MISC. 94 DATED 24.03.95.
10. ALL DIMENSIONS ARE IN MM, UNLESS OTHERWISE NOTED.
11. S.B.- SAND BUCKET 10 NO'S AS PER EXPLOSIVE RULES.
12. F.E.- FIRE EXTINGUISHER-10 NO'S AS PER EXPLOSIVE RULES.
13. TANK GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING AS APPLIED. THE TEST SHOULD BE MENTIONED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ.C.M. FOR 2 HOURS.
14. DIP ROD SUPPLIED WITH THE TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3382 MM LONG INSTEAD OF STANDARD 2350 MM.
15. FABRICATION THICKNESS OF SHELL PLATES AND END PLATE OF TANKS:
    20 KL SHELL- 6 MM
    END - 8 MM
16. TANKS CONFORMS TO 124, 125 & 131 OF THE PETROLEUM RULE - 2002.
17. ALL LIGHT POLES ARE FITTED AS PER APPROVAL OF C.C.O.E., NAGPUR VIDE NO. P/L-81(MISC) DATED:26.11.1993.
18. NATURAL DOWN SLOPE FROM THE EDGE OF METALLED ROAD TO CULVERT OR BEYOND WILL BE MAINTAINED FREE FLOW OF WATER TOWARDS DRAIN.
19. SITE WILL BE APPLICABLE INC (NS) NORMS WITH LATEST AMENDMENTS.
20. EV = EXTENDED VENT POINTS
    F = EXTENDED FILL POINTS.
21. THE PROPOSED SITE IS FREE FROM ANY TYPE OF LITIGATION AND NO CASE IS PENDING IN ANY COURT OF LAW.
22. NO ELECTRIC LINE PASSING OVER THE R.O. PREMISES.

Site Plan Verified as per Check List & Norms.

उपरोक्त निर्माण स्थल पर लोहे की बाड़ी भाग, गार्ड के गेट से 25 मीटर और 55 मीटर (एक्सक्लूसिव) सुरक्षित की जाती है। नक्शा के कंडीशन की शर्त 7(2) में वर्णित प्रावधानों के अन्तर्गत शर्त के संबंध में इसे पेट्रोल पंप निर्माण हेतु अस्थायी निम्नलिखित प्रतिबंधों के साथ दी जाती है:-

1- आवेदक को प्रस्तावित निर्माण स्थल के आगे वाले पार्ट पर वाहनों के लिए पूर्ण या निर्माण की आवश्यकता है तो जिला प्रशासन/पी.डब्ल्यू.डी. से स्वीकृति कराकर आवेदक को करना होगा।

2- आवेदक को पूर्वोक्त बनाने की दशा में ग्राम पंचायत पर अस्थायी पेट्रोल पंप निर्माण कराकर उसकी जिम्मेदारी सहित गठन करनी होगी।

3- प्रस्तावित निर्माण स्थल के आगे आवेदक को अपने खर्च पर अपनी भूमि पर ड्रेनेज है की कार्य नेचर नाली निर्माण कराना होगा।

4- प्रस्तावित निर्माण की पूर्वी भाग के लेफ्ट साइड में नाली रखनी होगी।

5- भू-लावित के संबंध में विभाग उत्तरदायी नहीं होगा।

6- अनुमोदित प्लान के अनुसार निर्माण कार्य न करने तथा अन्य किसी भी शर्त का उल्लंघन होने की दशा में प्रदत्त अनुमति स्वतः निरस्त हो जायेगी।

7- प्रस्तावित पेट्रोल पम्प में दूसरे पेट्रोल पम्प की दूरी 2.00 किमी के समान है तथा राष्ट्रीय राजमार्ग/राज्य मार्ग/प्रमुख जिला मार्ग से 5.00 मीटर से 300 मी० से अधिक है।

सहायक अभियन्ता (नगरीय कार्य र.सं.वि.वि. बिजनौर)

अधिशासी अभियन्ता विपणि खण्ड-2, सं०नि०वि०, बिजनौर (मध्यमार्ग मंडलालय)

अधिशासी अभियन्ता रामपुर कस्ट, मो० नि० वि० रामपुर

ITEM	SIZE	PET. CL	CAP.	PROD.
T1	2.10X6.25	CLASS 'A'	20 KL	MS
T2	2.10X6.25	CLASS 'B'	20 KL	HSD
T3	2.10X6.25	CLASS 'B'	20 KL	HSD
DU1/DU2	6000X900	CLASS 'A'	HONDO HSD DUO	MS
DU3/DU4	6000X900	CLASS 'A/B'	HONDO HSD DUO	MS/HSD
DU5/DU6	6000X900	CLASS 'B'	HONDO HSD DUO	HSD

LOI NO.&DATE :-2014/IN00010/UP/000038/1596/00003 DATED 30.05.2014
LOI HOLDER:-SRI FARHAT ULLAH KHAN S/O SRI SALAMAT ULLAH KHAN
SRI SANAT ULLAH KHAN S/O SRI SALAMAT ULLAH KHAN

NAME OF LOCATION:-
TYPE OF RO:- NEW R SITE RO
LICENCE NO.:-

BETWEEN KM SIDE SH-49 ON SH-49(DHAMPUR - MORADABAD ROAD)

INDIAN OIL CORPORATION LTD.
(MARKETING DIVISION)
NORTHERN REGION)

MORADABAD DIVISIONAL OFFICE

PROPOSED LAYOUT & SITE PLAN FOR RETAIL OUTLET ON SEOHARA - MORADABAD ROAD
AT.-KHASRA NO.-95M
AT-VILL.-SAHASPUR B.A ,TEH.- DHAMPUR
DISTT. - BIJNOR (U.P.)

KHASRA NO.	95M
VILLAGE	SAHASPUR B.A
ROAD	SH-49
TEHSIL	DHAMPUR
DISTT.	BIJNOR
STATE	U.P.
POLICE STATION	SEOHARA
RAILWAY STATION	SAHASPUR
PIN CODE NO.	246745

DATE: 28.05.2014
DRAWING NO.: IOC/MBD/RG/RO/2014

DATE BRIEF RECORD
R I V I S I O N

DRAWN BY: AS SHOWN
CHECKED BY:
RECOMMENDED BY:
APPROVED BY:

PREPARED BY :-
RAM GOPAL SHARMA
(A) VISHWANATH PURAM COLONY, BADAUN ROAD, BAREILLY
98370-28296,0581)2435188