
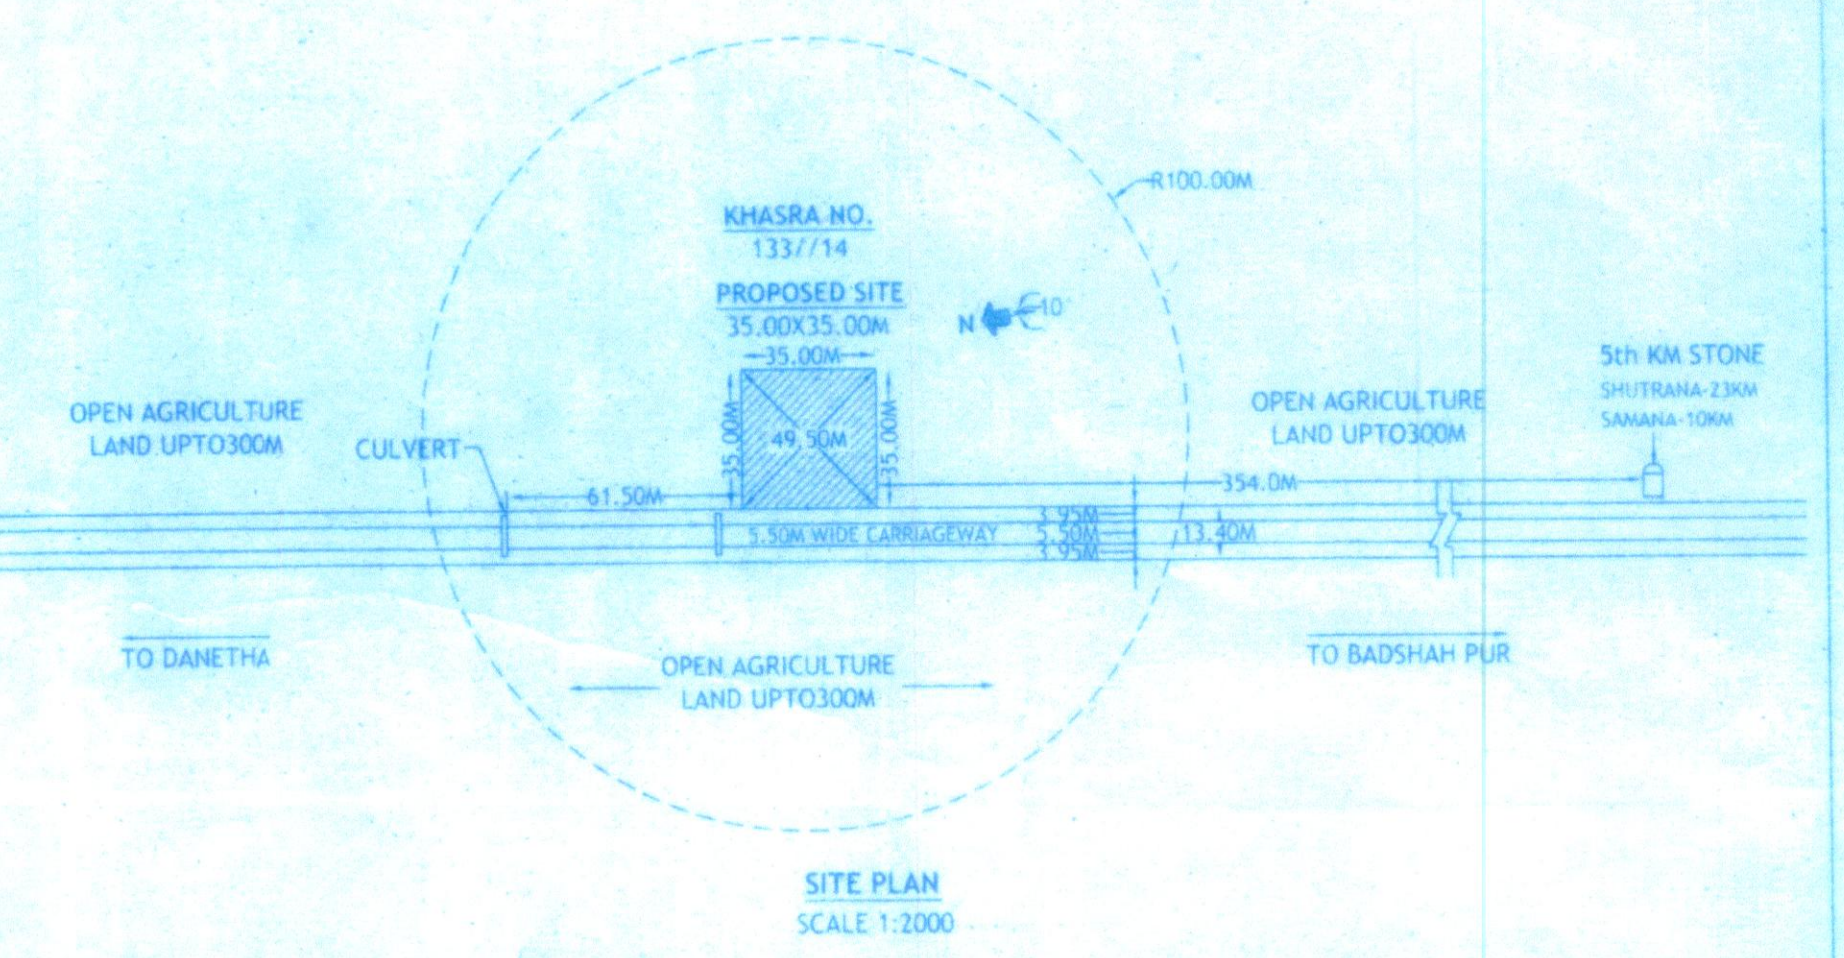
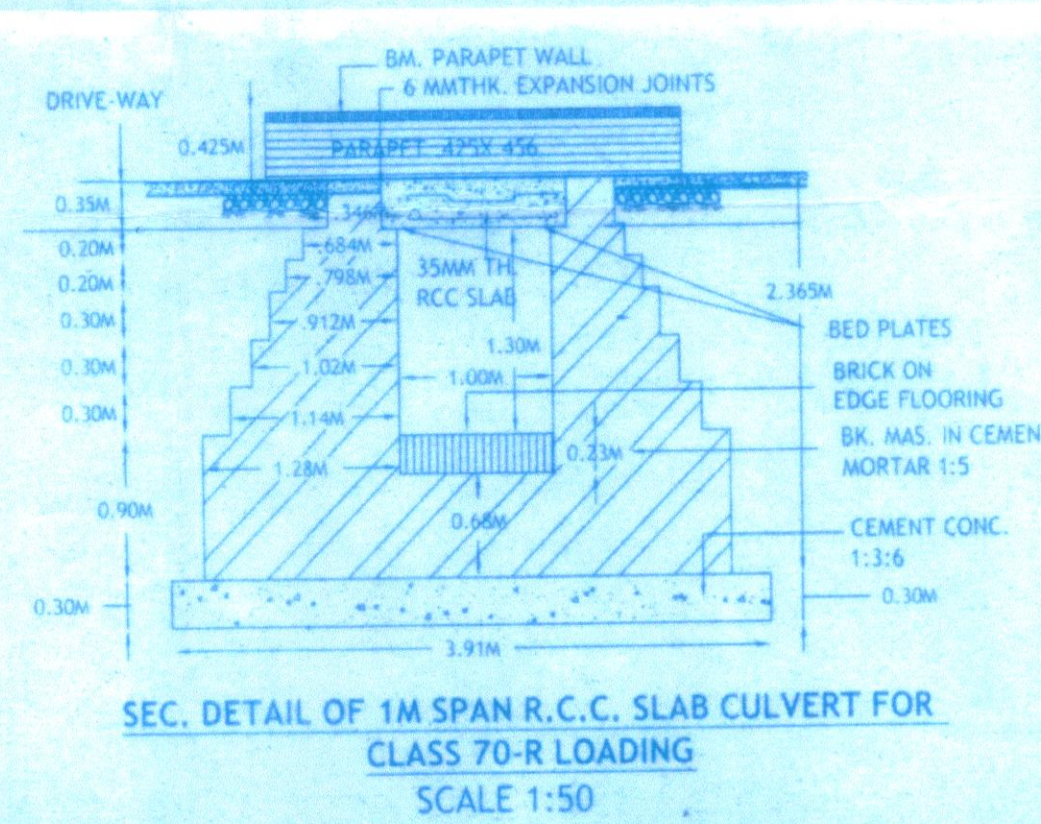
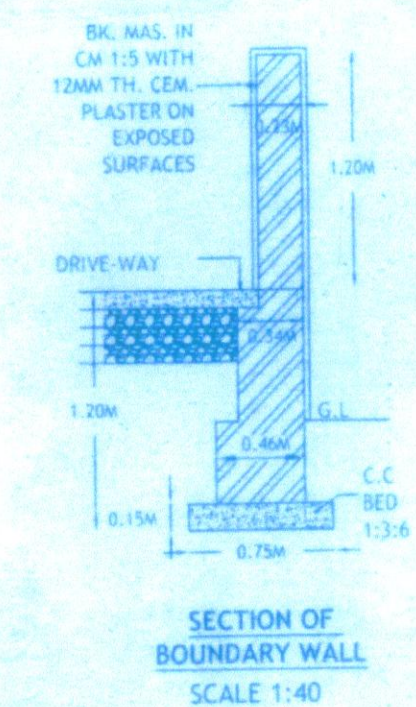
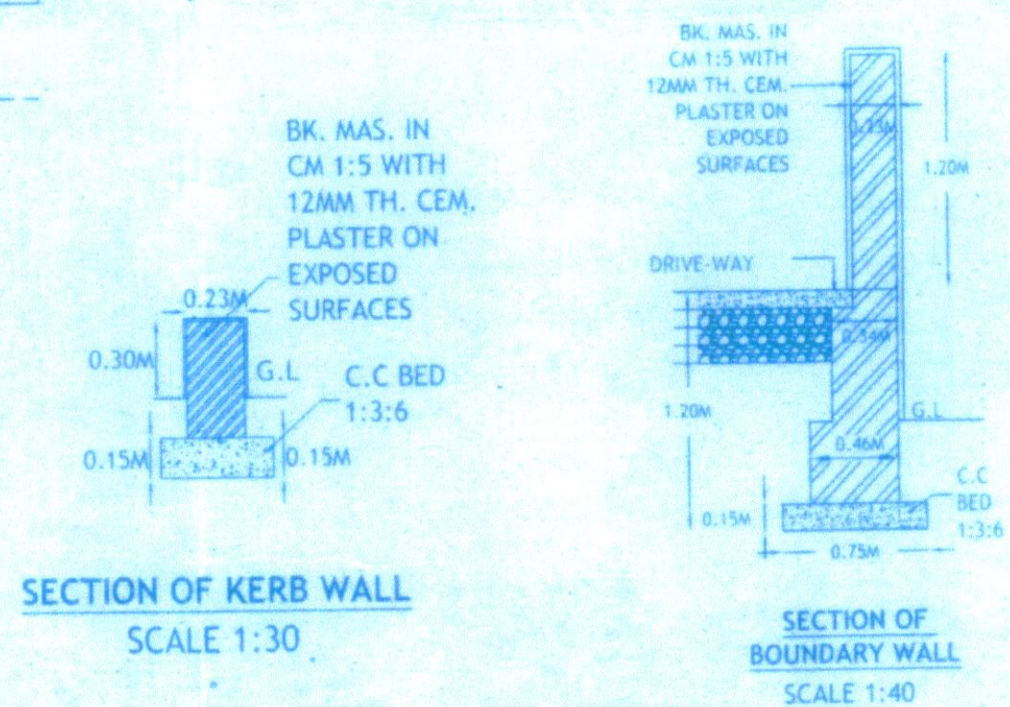
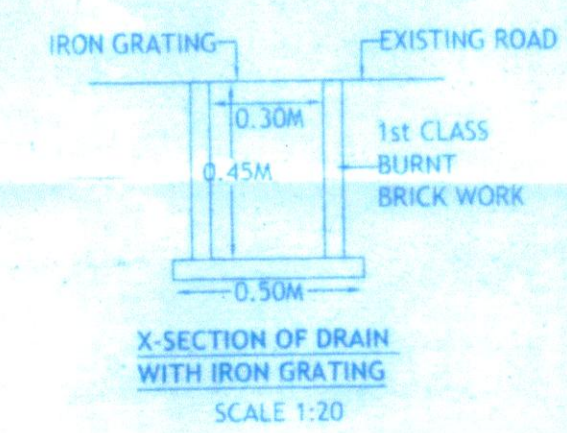
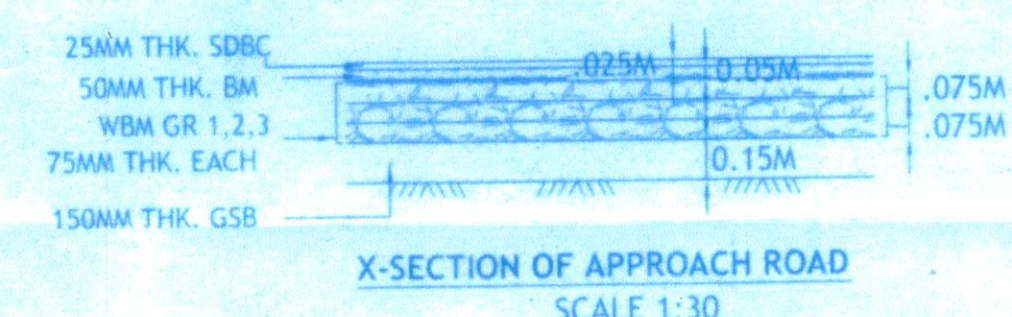
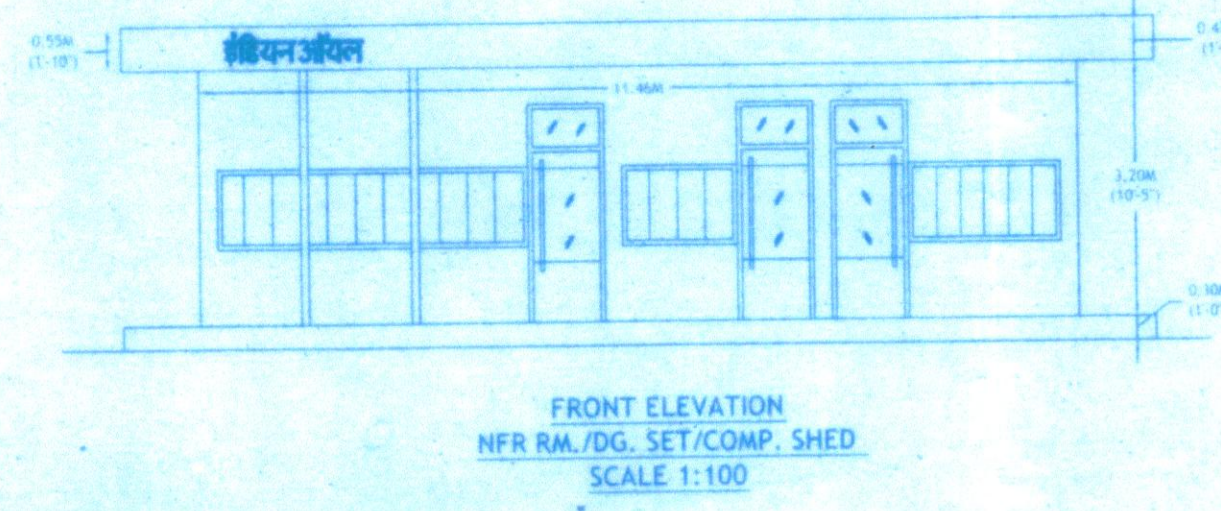
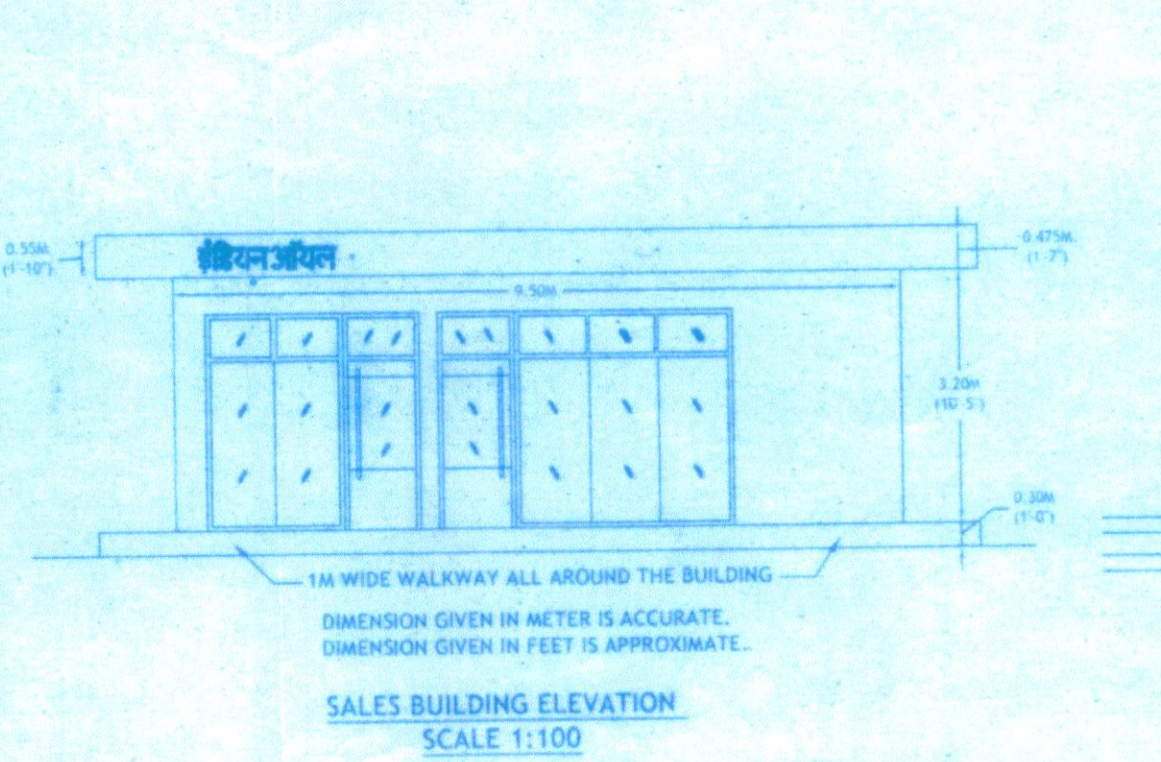
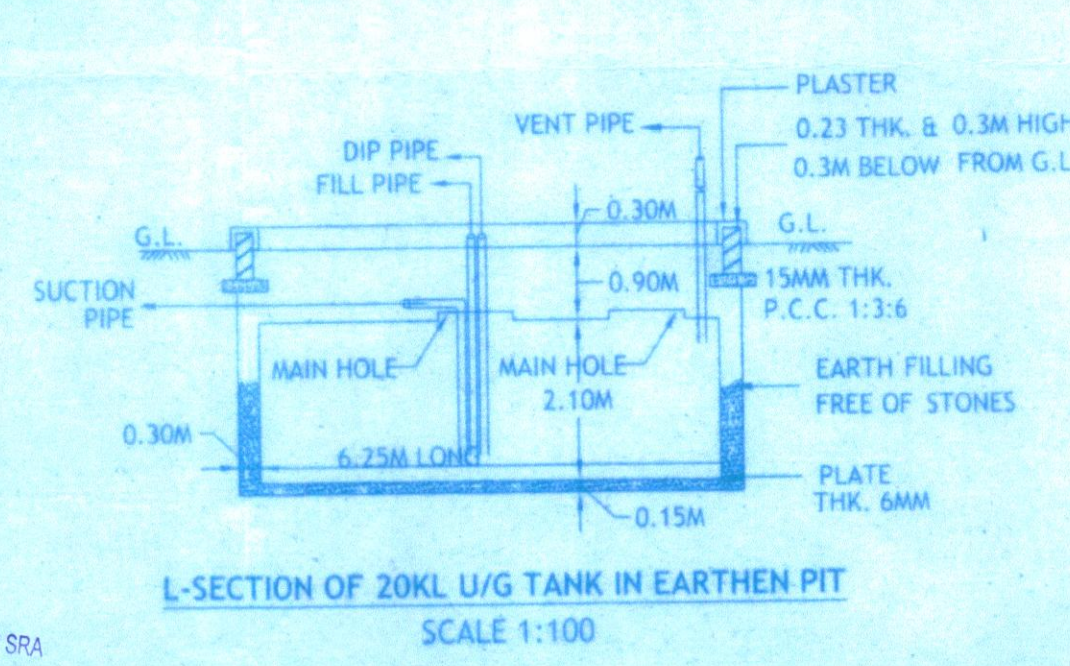
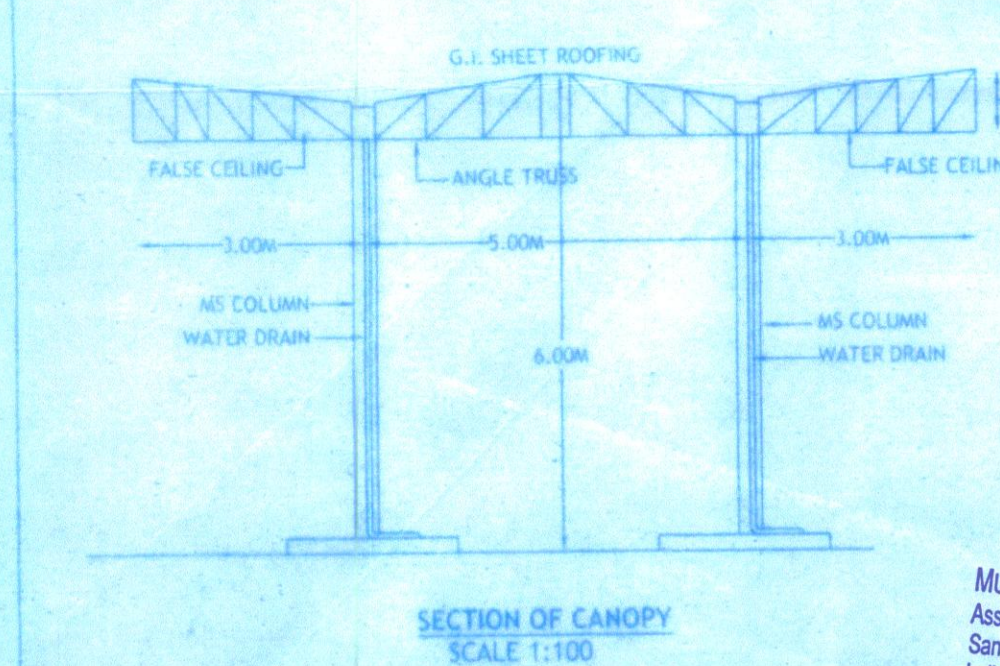
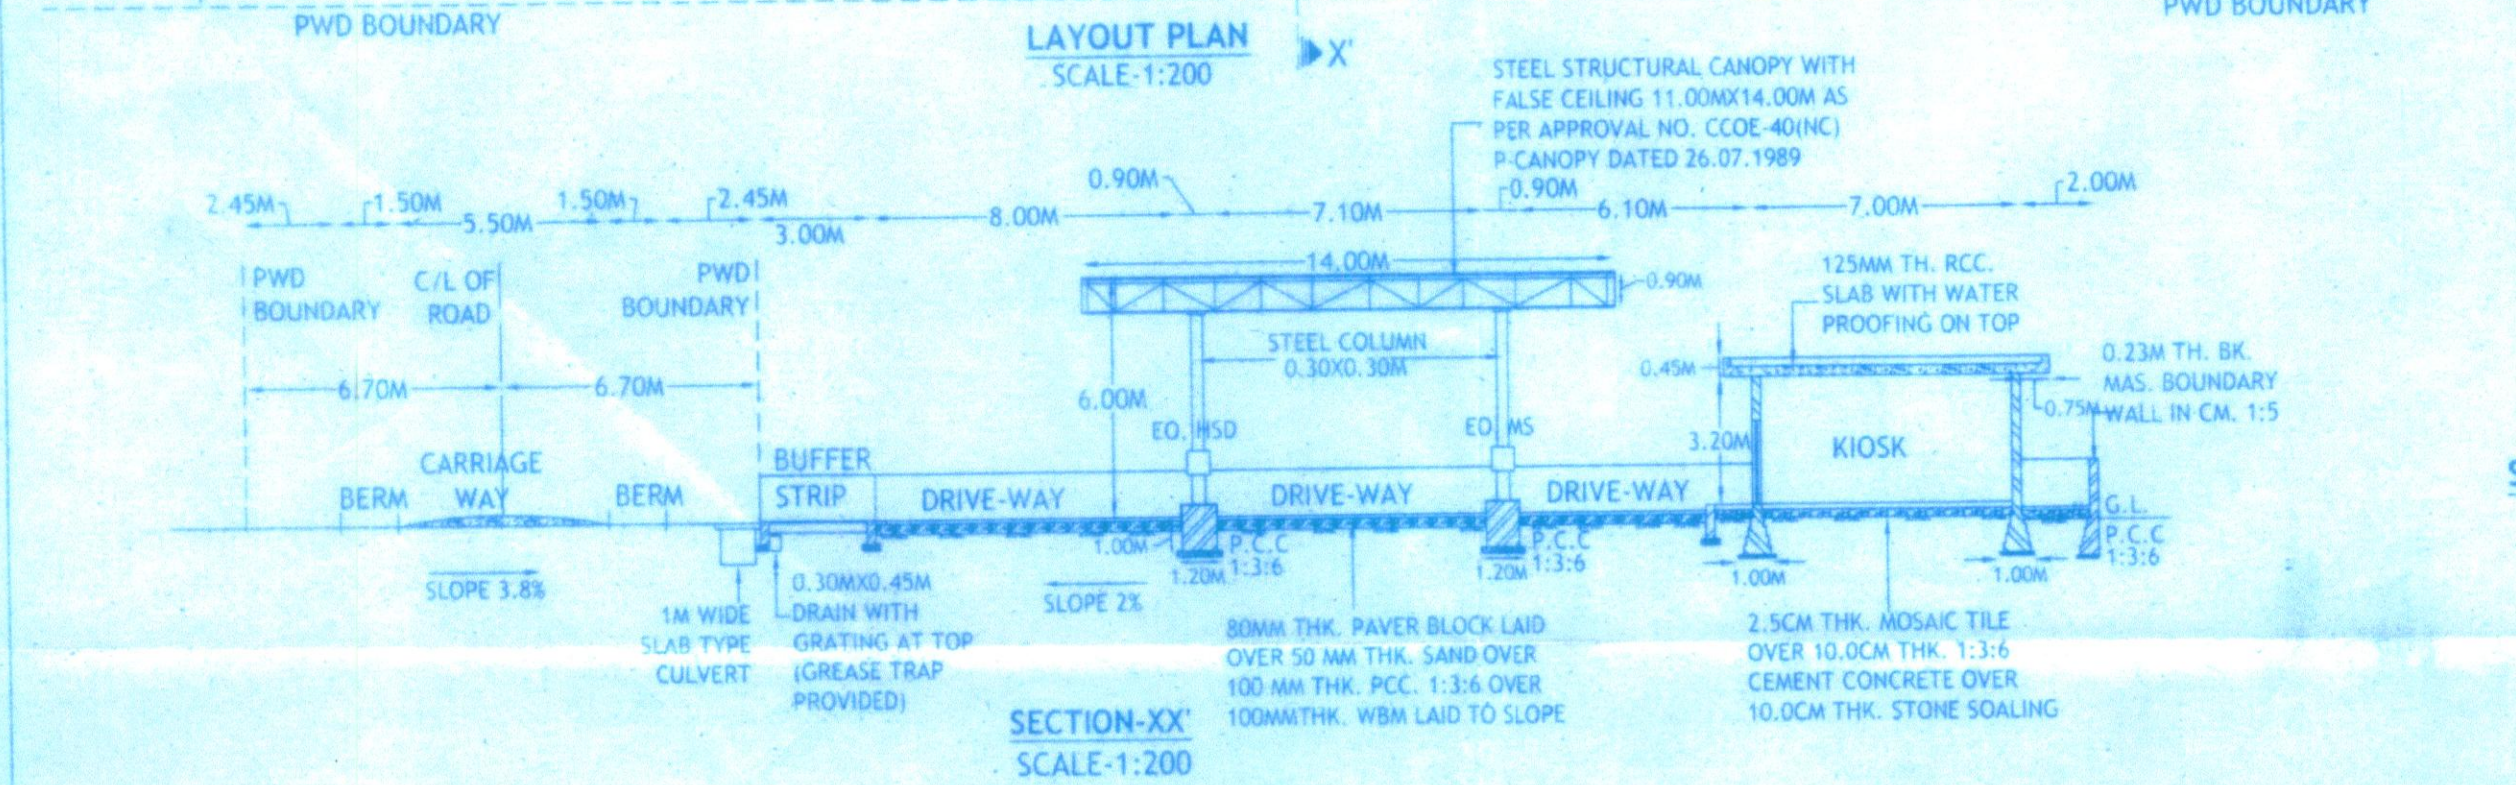


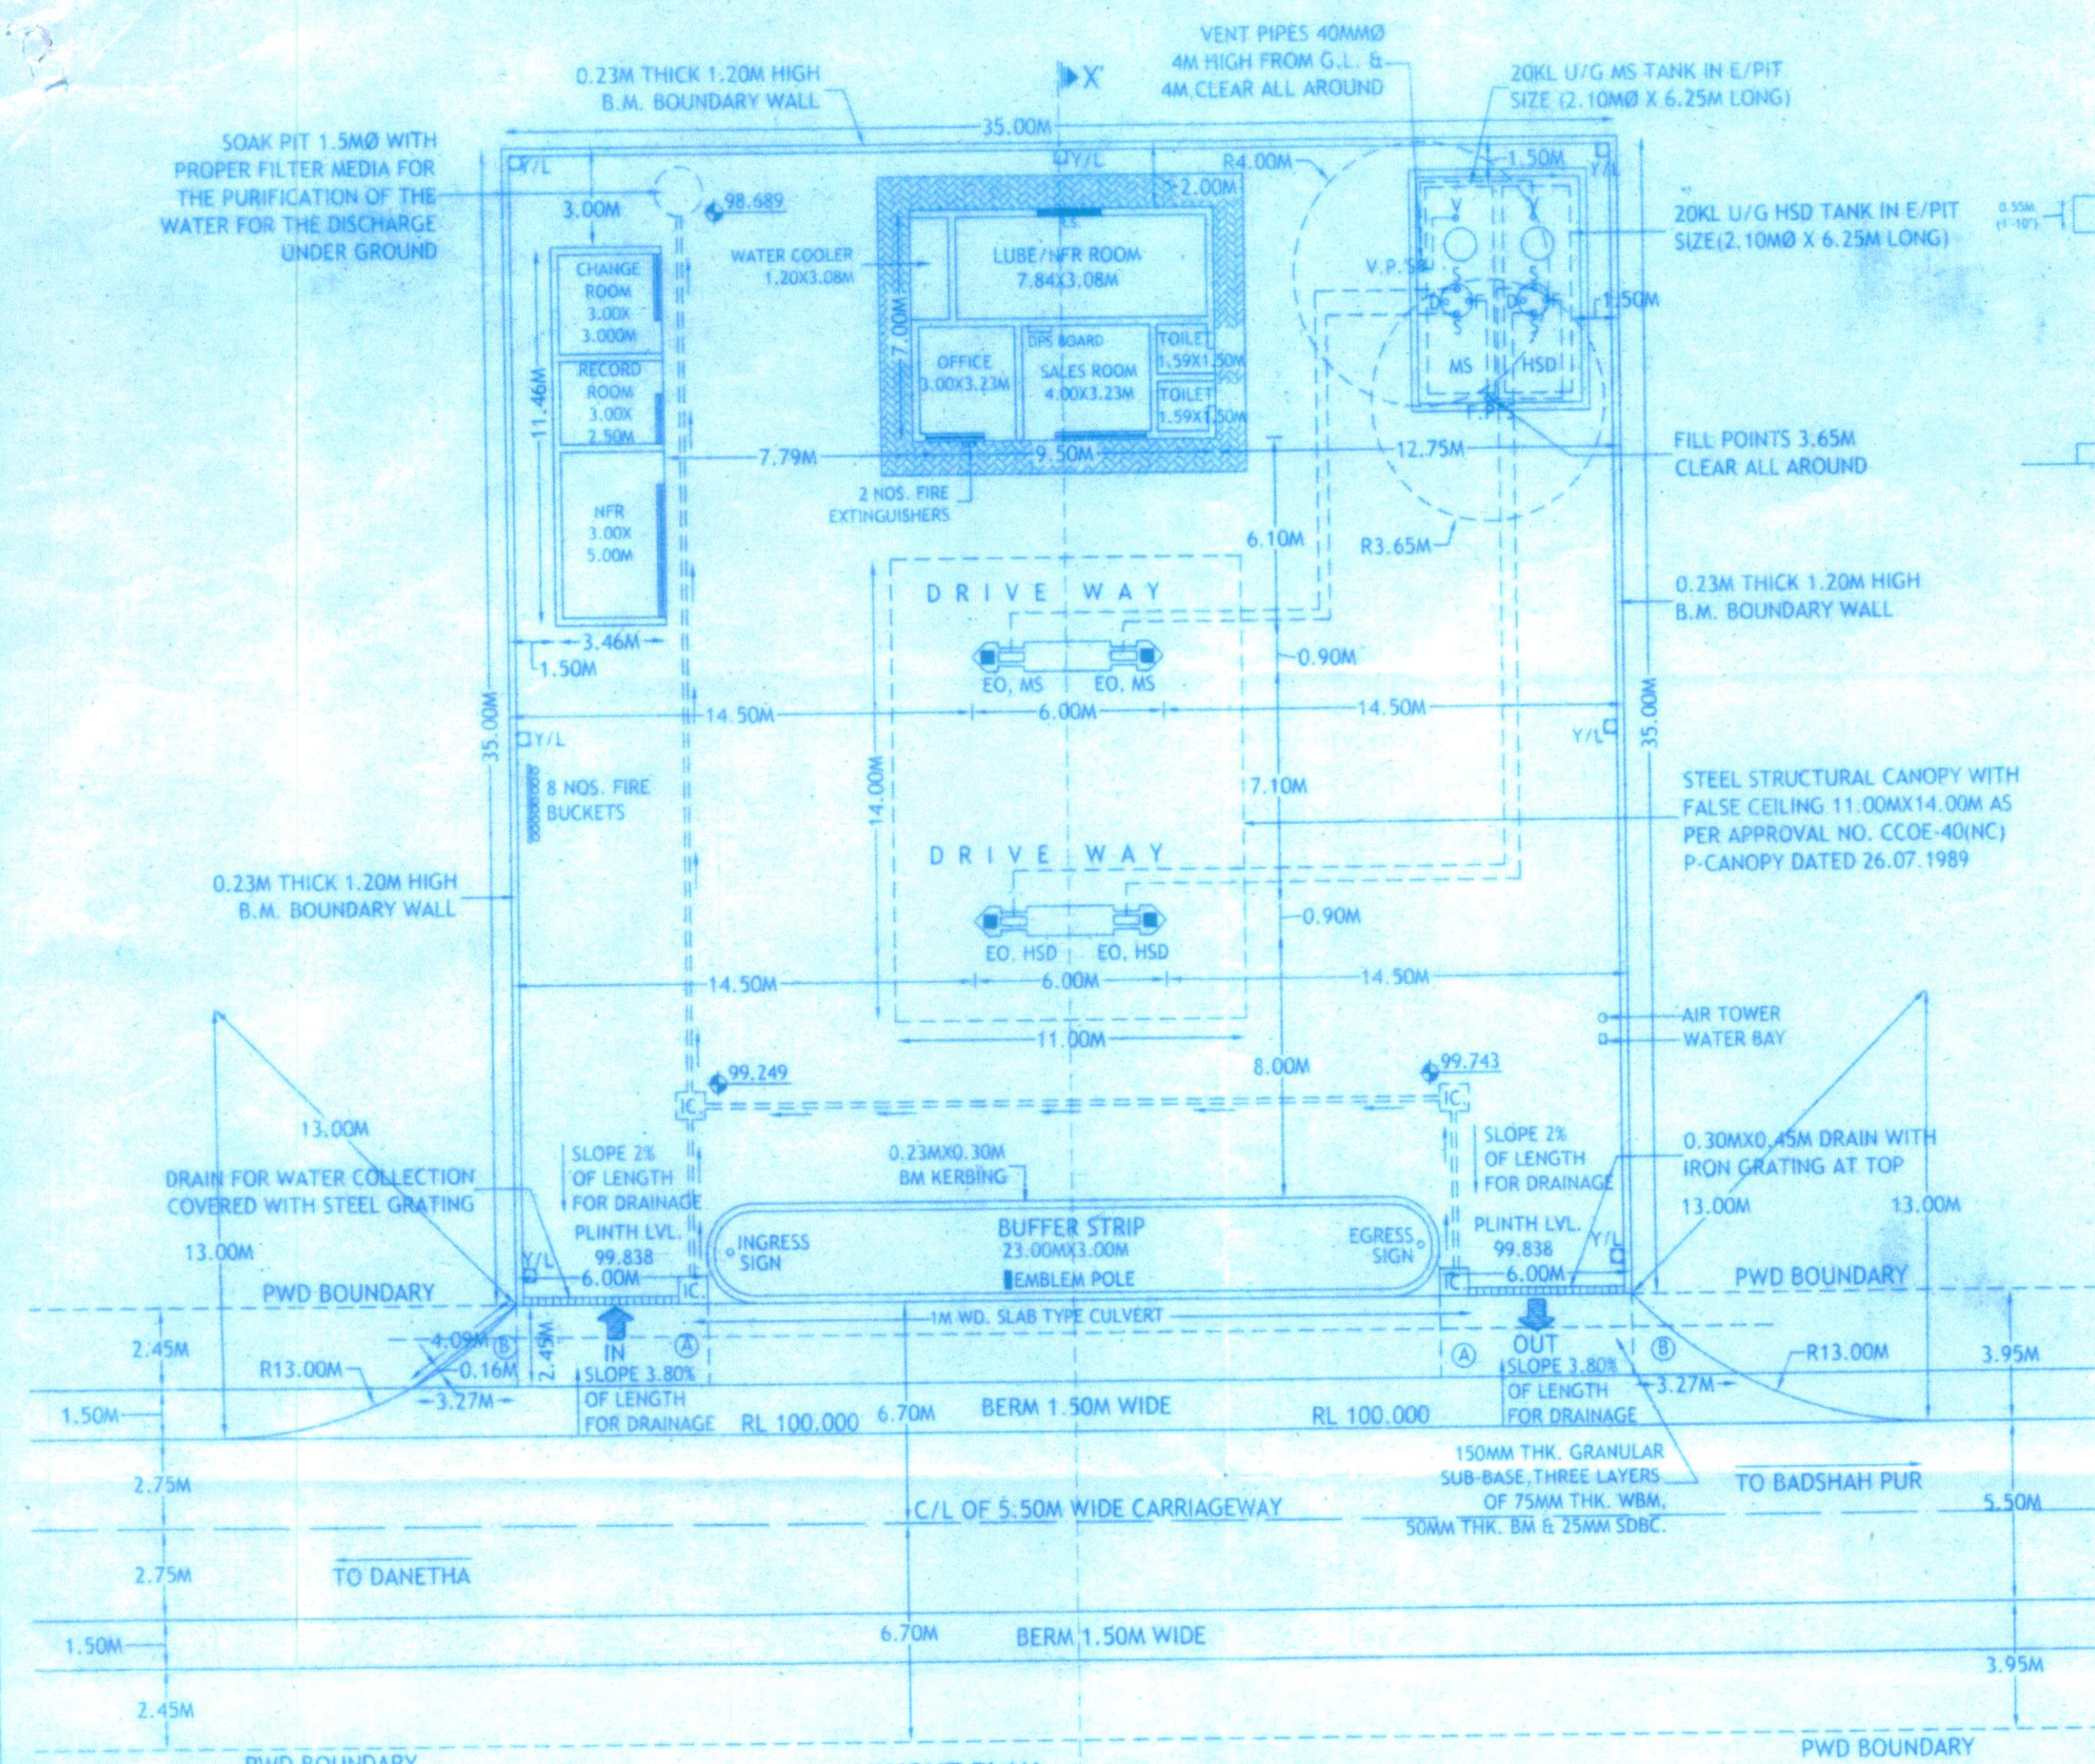

DETAIL OF DISPENSORS			
S.NO.	CLASS	PRODUCT	NOZZLES
1	A	2 X EO, MS	2
2	B	2 X EO, HSD	2

DETAIL OF TANKS					
PRODUCT	CAPACITY	DIA Ø	LENGTH	NOS.	TYPE OF TANKS
MS	20KL	2.10M	6.25M	1	EARTH PIT TANK
HSD	20KL	2.10M	6.25M	1	EARTH PIT TANK

- | NOTES | |
|-------|--|
| 1. | CERTIFIED THAT NO OTHER STRUCTURE WILL BE ERECTED FOR ANY OTHER SERVICES RENDERED EXCEPT THAT CONNECTED WITH THE PETROL PUMP WITHOUT THE PRIOR APPROVAL OF P.W.D |
| 2. | CERTIFIED THAT THERE IS NO ROAD CROSSING WITHIN 100M BETWEEN THE TANGENT POINT OF THE CURVES OR THE SIDE ROAD & THAT OF THE FUEL- FILLING PUMP. |
| 3. | CERTIFIED THAT ALL THE STANDARD CONDITIONS HAVE BEEN SATISFIED. |
| 4. | CERTIFIED THAT THE BERM PORTION IS NOT INCLUDED IN THE AREA OF THE LAND TO BE LEASED FROM P.W.D FOR APPROX ROAD BUT IT IS TO BE METALLED. |
| 5. | CERTIFIED THAT THERE IS NO OBJECTION FROM ROAD POINT OF VIEW FOR INSTALLATION OF THIS FUELING PUMP. THE PROPOSAL WILL NOT EFFECT FUTURE IMPROVEMENT OF THIS ROAD. |
| 6. | CERTIFIED THAT ALL CONDITIONS LAID DOWN BY GOVT. OF INDIA AND THE IRC FROM TIME TO TIME WITH REGARD TO THE LOCATION OF THE ROAD SIDE FUEL-FILLING STATION HAVE BEEN COMPLIED WITH. |
| 1. | NO DRAIN,SEWER OR STRUCTURE TO EXIST WITH IN 1.5M FROM U/G TANKS. |
| 2. | SUCTION PIPES UNDER DRIVE WAY TO BE HOUSED IN PIPE/SLEEVES. |
| 3. | ELECTRIC FITTINGS TO CONFORM TO I.S. NO. 2148 FOR DISPENSING PUMPS ONLY |
| 4. | 40 MM. VENT PIPE, 4M HIGH FROM G.L. & 4M CLEAR ABOVE THE OPEN END OF PIPE TO BE COVERED WITH TWO LAYERS OF NON CORRODIBLE METAL WIRE GAUGE OF 1/2 MESH PER LINEAR CM. |
| 5. | D.P.S. BOARD TO BE FIXED 1'5M ABOVE G.L. & WILL BE KEPT UNDER LOCK & KEY. |
| 6. | TANKS TO BE FED BY TANK LORRY ONLY. |
| 7. | CERTIFIED THAT THE DRAINS PROVIDED IN THE PLAN ARE SUFFICIENT FOR DRAIN OF WATER. |
| 8. | NO STRUCTURE OR HOARDING EXCEPT APPROVED STANDARD IDENTIFICATION SIGN ON POLES PROVIDING A CLEARANCE OF ATLEAST 3M. ABOVE GROUND LEVEL SHOULD BE ERECTED ON BUFFER STRIP. |
| 1. | NO HEDGES AND PLANTS MORE THAN 0.6M HIGH SHALL BE GROWN ALONG THE BUFFER STRIP. |
| 2. | THERE SHALL BE SUFFICIENT STANDING SPACE WITHIN THE STN. FOR VEHICLES TO WAIT FOR THEIR TURN. |
| 3. | 'IN' AND 'OUT' SIGN SHALL BE PUT UP TO GUIDE VEHICLES DURING THE DAY AND SHALL BE PROPERLY LIT UP TO GUIDE THEM AT NIGHT. |
| 4. | 'NO SMOKING' SIGN, FIRE EXTINGUISHERS & FIRE BUCKETS SHALL BE PROVIDED AT SITE. |
| 5. | LEVEL OF THE RETAIL OUTLET WILL BE KEPT 2 % BELOW ROAD LEVEL. |
| 6. | KERB WALL ATLEAST 225MM HIGH WALL SHOULD BE CONSTRUCTED ON THE PERIPHERY OF THE BUFFER STRIP. |
| 1. | CERTIFIED THAT THE BUFFER SHALL NOT HAVE ANY INSTALLATION i.e. U/G TANKS ETC. |
| 2. | CERTIFIED THAT THE KERBING ALONG BUFFER IS TO BE MADE BY CORPORATION. |
| 3. | CERTIFIED THAT THE METALLING OF BERM AT THE COST OF COMPANY IS TO BE PROVIDED. |
| 4. | CERTIFIED THAT THERE WILL NOT BE ANY HINDERANCE FROM OVER HEAD LINES/POLES. |
| 5. | CERTIFIED THAT THE SURPLUS WATER WILL NOT BE DISPOSED OF IN P.W.D. LAND. |
| 6. | CERTIFIED THAT ALL CLEARANCE/APPROVALS FROM M.O.P./I.R.C. AND OTHER RELEVANT GOVT. DEPARTMENT HAVE ALREADY BEEN OBTAINED |
| 7. | CERTIFIED THAT THERE IS NO COURT CASE PENDING IN ANY COURT OF INDIA AGAINST THIS PREMISES. |
| 8. | 20% STEEL TANKS FABRICATED AS PER DRG. APPD. BY CCE HAGPUR VIDE HIS LETTER NO. P-63(DATED 23-01-2001) TO BE USED FOR STORAGE. IS SPECIFICATION NO. IS 10987. |
| 9. | CERTIFIED THAT THIS IS NOT A RESTEMENT CASE. |
| 10. | CERTIFIED THAT CASHIQA MEASURING 11,00X14,00M CONFORMS TO SOUND ENGINEERING SPECIFICATIONS AND THERE IS NO CHANCES OF ITS EVER CAVING IN UNDER NORMAL CIRCUMSTANCES. |
| 11. | CERTIFIED THAT THE HIGHWAY IS STRAIGHT AT THE LOCATION OF THE RETAIL OUTLET. |
| 12. | CERTIFIED THAT THE SPACE FROM THE OUTER EDGE OF THE BUFFER STRIP TO THE EDGE OF ROAD WILL BE TURFED. |

VILLAGE	DANETHA
KHASRA NO.	133/114
KHEWAT NO.	233/228
KHATAUNI NO.	#66
NEAREST POLICE STATION	GHAGGA
NEAREST RAILWAY STATION	PATIALA
TEHSIL	SAMANA
DISTT.	PATIALA
PIN CODE	147101
STATE	PUNJAB
AREA DETAILS:-	
TOTAL PLOT AREA	: 1225.00SQ.M.
AREA UNDER SALES BUILDING	: 66.50SQ.M(5.43%)
AREA UNDER NFR/DG. RM.	: 39.65SQ.M(3.23%)
AREA UNDER CANOPY	: 154.00SQ.M(12.57%)
TOTAL COVERED AREA	: 260.15SQ.M(21.23%)

AREA OF APPROACHES (TO BE LEASED)

1. AREA OF 2A = $2 \times 6.00 \times 2.45$
= 29.40 SQ.M.

2. AREA OF 2B = $2(1/2 \times 2.45 \times 3.27$
- $2/3 \times 4.09 \times 0.91)$ *जम*
= 3.56 SQ.M. *एकरो (1/2)*

TOTAL = 32.96 SQ. M. *अधिक (3)*

LIC. NO.  INDIAN OIL CORPORATION LTD.
(MARKETING DIVISION) NORTHERN REGION

LAYOUT & SITE PLAN OF KISSAN SEWA KENDRA
AT VILLAGE DANETHA, ON DANETHA - BADSHAH
PUR ROAD, NEAR KM STONE NO. 5, TEHSIL
SAMANA, DISTT. PATIALA (PB). PIN CODE 147101

MUKESH GUPTA
Asstt. Manager (RS) Sangrur-III SR
Sangrur Divisional Office
Indian Oil Corporation Limited
SANGRUR-148001 (Punjab)

MGR(E) *[Signature]* *[Signature]* *[Signature]* *[Signature]* *[Signature]*
 SDRSM *[Signature]* *[Signature]* *[Signature]* *[Signature]* *[Signature]*
 the CYBER SPACE
 #6, PAL MARKET,
 PUTTLIGHAR,
 ANURTSAR.