


Layout Plan of Proposed Diversion Area for Alignment of 400 kv S/C Dulhasti-Kishenpur TL B/W Tower No. 42-48 at Drabshalla -Kishtwar

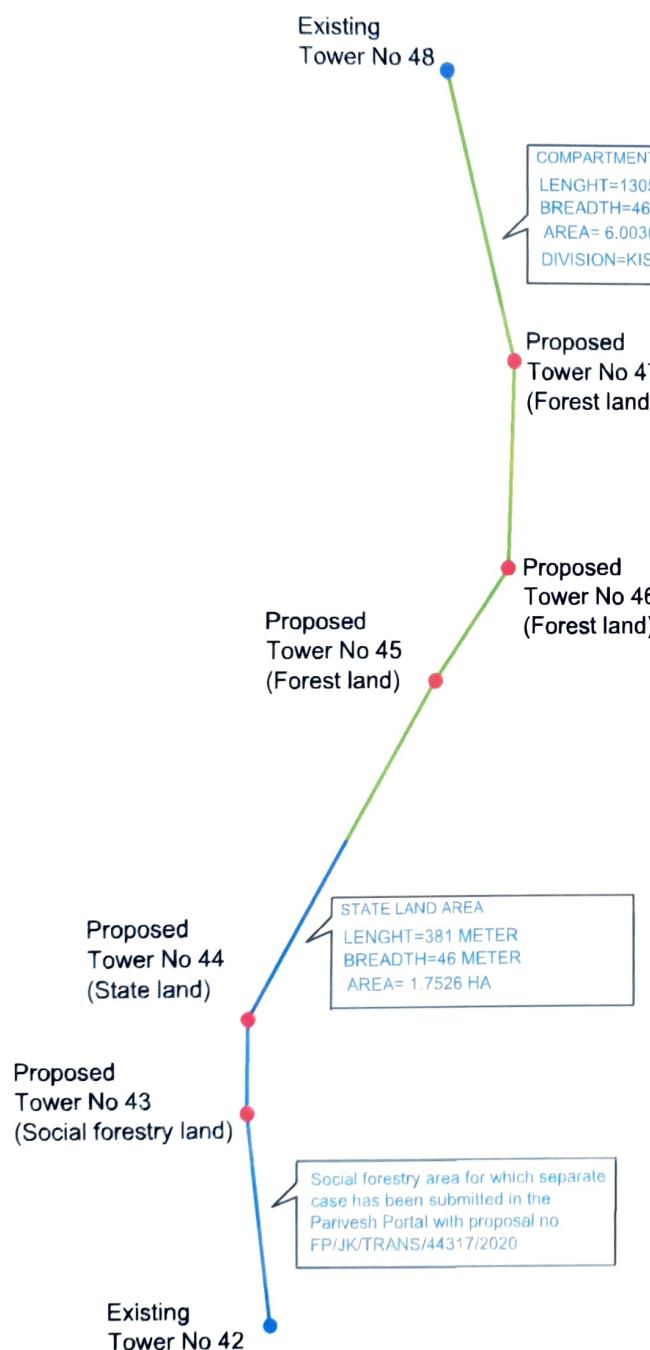

Legend	
Sheet No:-1 of 1	
Proposed Route	—
Forest	—
Right of Way	46 Meter
Final Route For Stretch 42-48 400kv S/C DULHASTI-KISHENPUR TL	
User Agency	Power Grid Corporation of India
Surveyed By:-	Vinay Construction Company


 Chief Manager - Electrical
 Power Grid Corporation of India Ltd
 Behind Hill View Hotel
 RATOTE (J&K)-18214