


LINE ROUTE OF 132 KV U/G POWER CABLE BETWEEN 132 KV TELIARGANJ AND MINTO PARK S/S AT ALLAHABAD

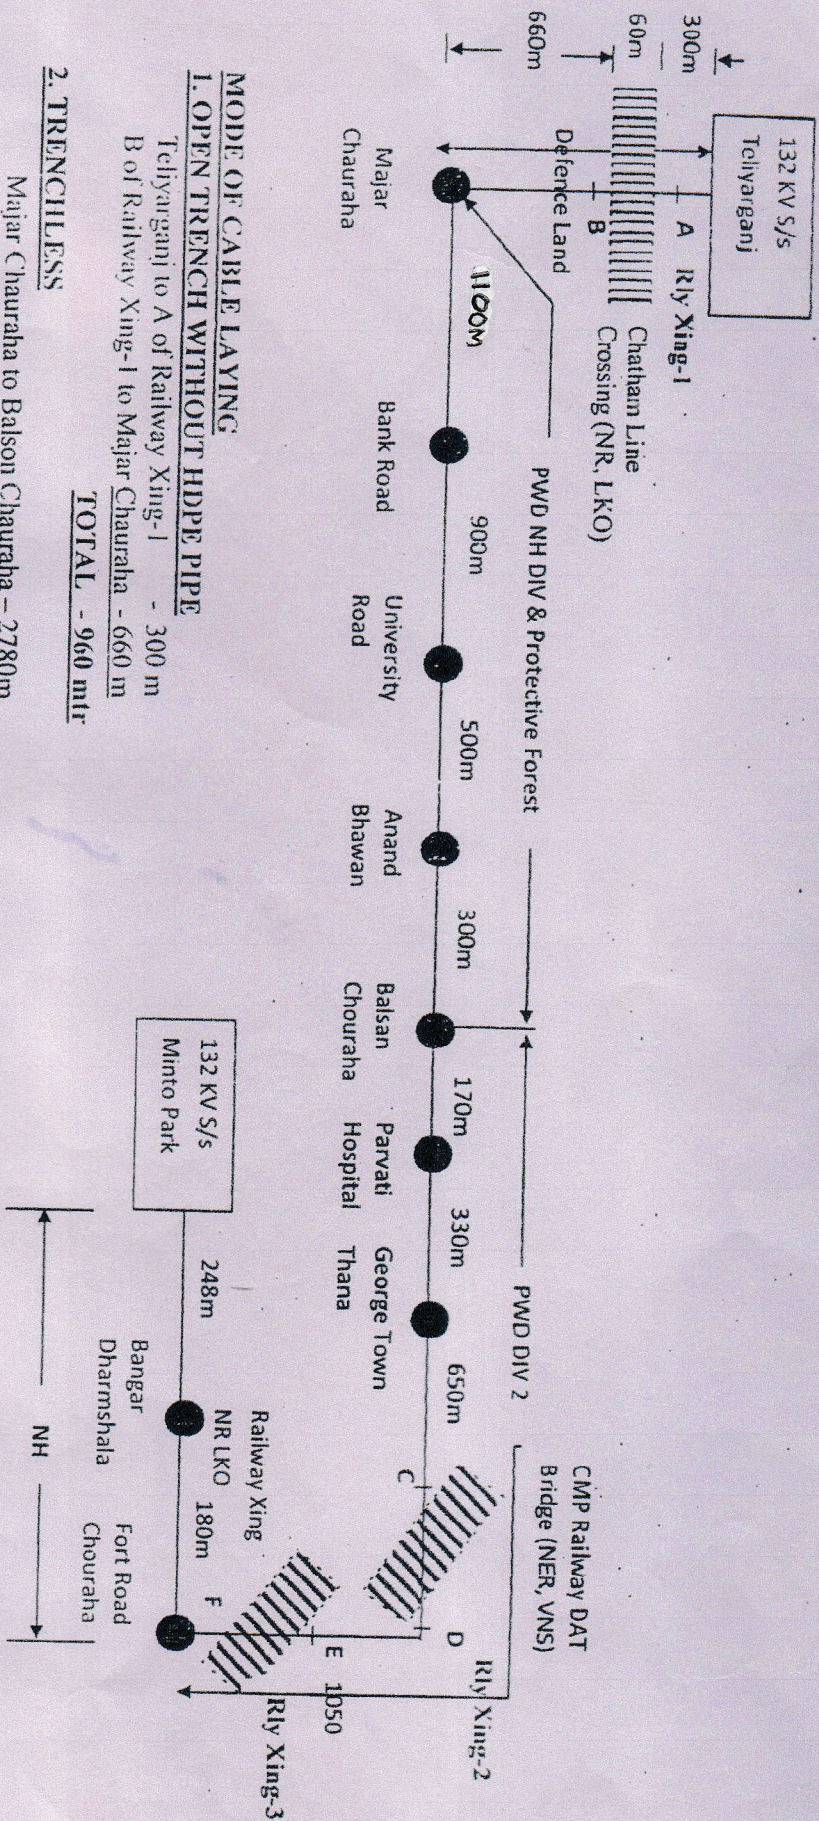

MODE OF CABLE LAYING

1. OPEN TRENCH WITHOUT HDPE PIPE

Teliarganj to A of Railway Xing-1 - 300 m
B of Railway Xing-1 to Majar Chauraha - 660 m

TOTAL - 960 mtr

2. TRENCHLESS

Majar Chauraha to Balsan Chauraha - 2780m

Railway Xing-1 A to B - 60 m

Railway Xing-2 C to D - 60m

Railway Xing-3 E to F - 60m

Bangar Dharmshala to Minto Park - 248m

TOTAL - 3208 mtr

3. OPEN DUCT WITH HDPE PIPE

Balsan Chauraha to Bangar Dharmshala = 2380 - 120 (for 02 nos. Railway Xing @ 60m each which is trenchless)

TOTAL - 2260 mtr

GRAND TOTAL - 6428 Mtr

DRG - NTS

Executive Engineer
ETD-II, Allahabad

Superintending Engineer
ETD-II, Allahabad

13/5/18
Executive Engineer
ETD-II, U.P.P.T.C. Ltd.
Allahabad