
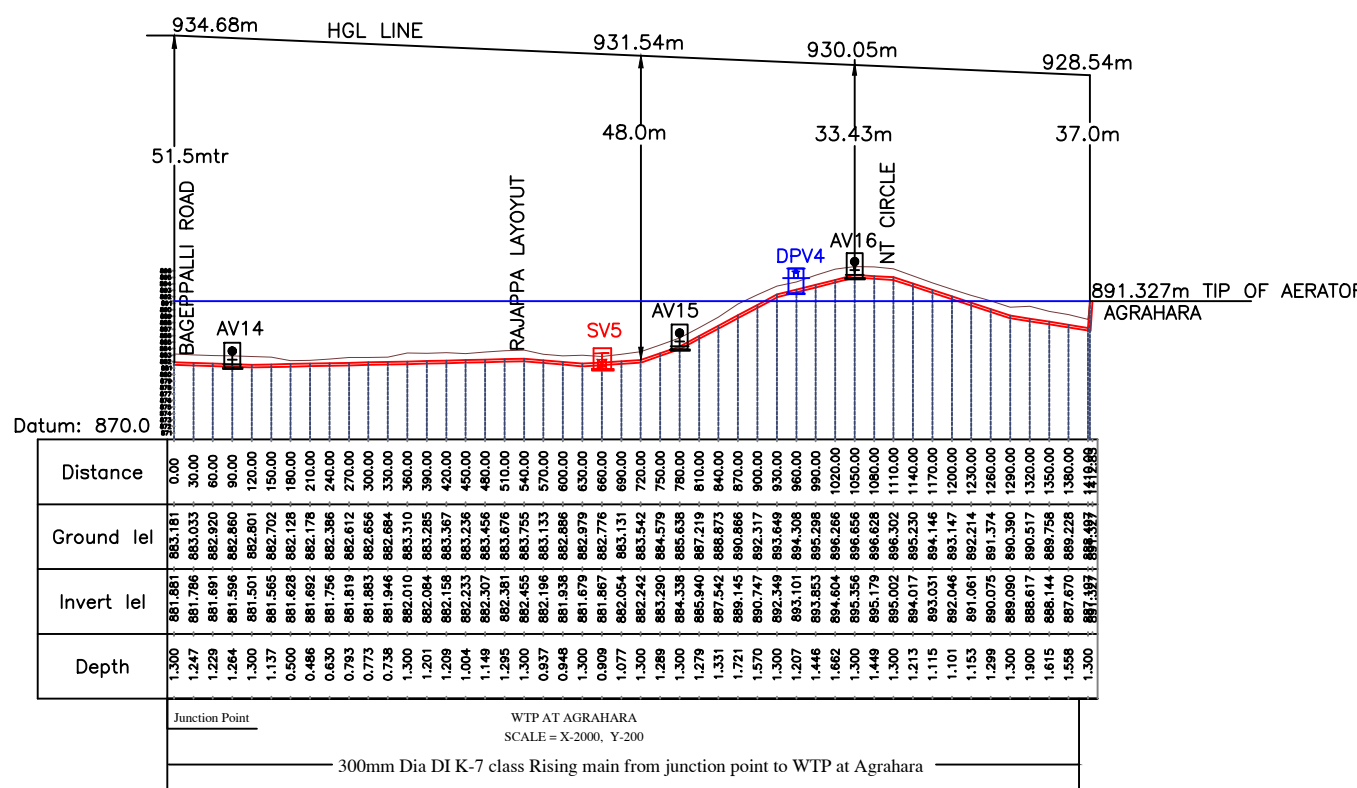
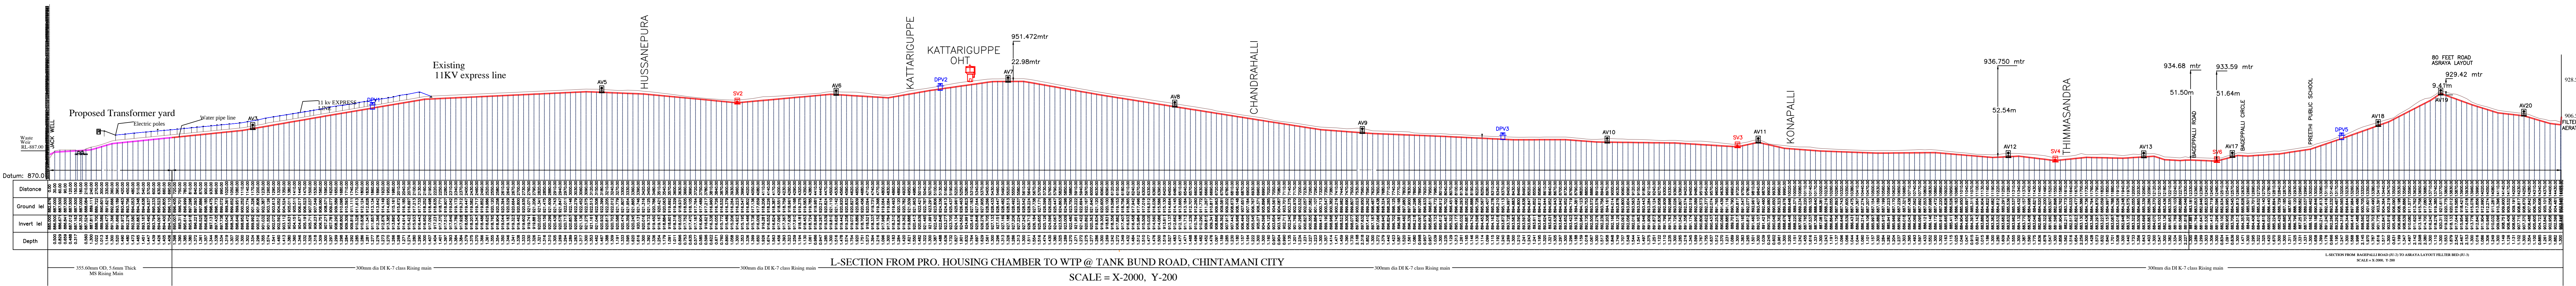


DRAWING SHOWING THE PLAN AND CROSS SECTION OF WATER PIPELINE AND 11 KV EXPRESS LINE AT FOREST AND NON FOREST AREA

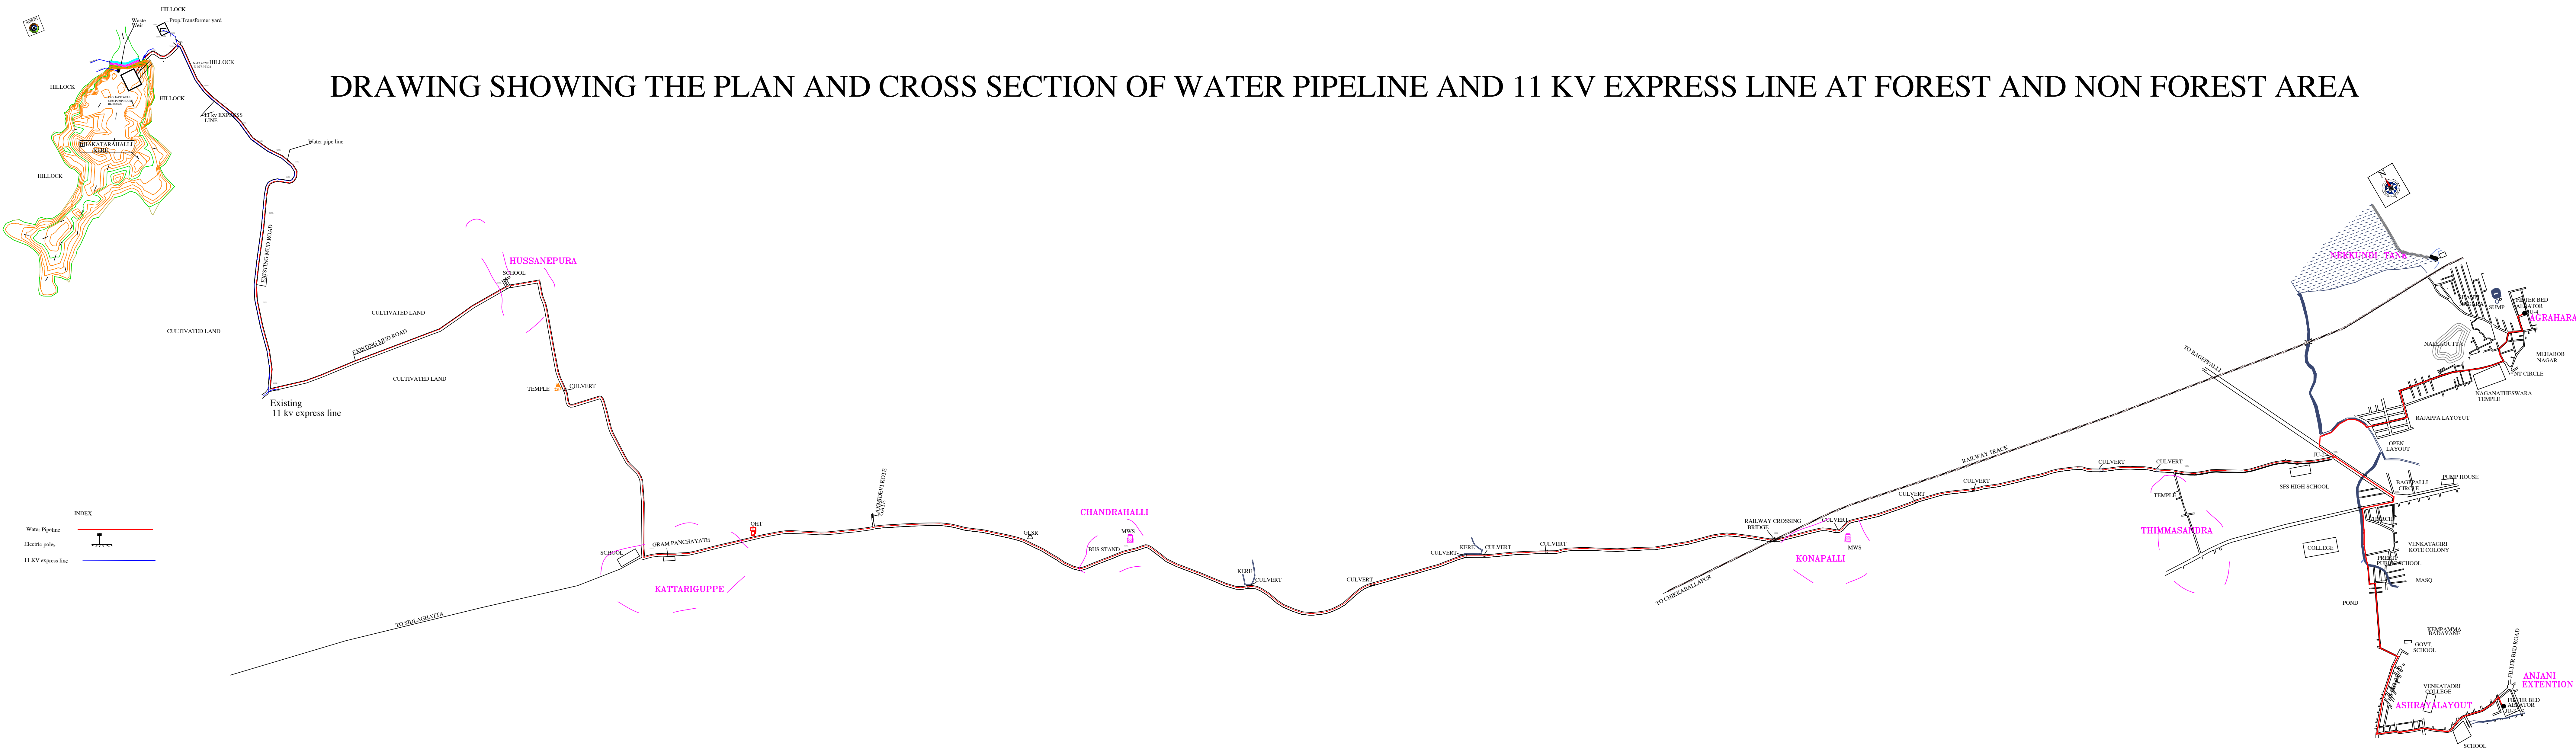

INDEX		
AIR VALVE CHAMBER - 80 MM Ø	30 NOS.	
SCOUR VALVE CHAMBER -150 MM Ø	10 NOS.	
DUAL PLATE CHECK VALVE -300 MM Ø	3 NOS.	
355.66 MM Ø M.S. RISING MAIN		
300 MM Ø DI RISING MAIN - K-7		
300 mm dia sluice valve	3 NOS.	

CLIENT:	K U W S & D B SUB-DIVISION CHIKKABALLAPUR
TITLE:	PLAN AND L-SECTION OF PROPOSED 300 MM DIA DI & 355.6 MM MS RISING MAIN FROM BHAKTHARAHALLI ARASI KERE TO EXISTING WTPs IN CHINTAMANI.