

66 KV D/C LINE FROM 220 KV S/STN RAIWALI TO 66 KV S/STN HSIIDC BARWALA

IN Panchkula District

Date of Proposal:-.....

CHECK LIST SERIAL NUMBER:-18(a)

Length and width of Transmission Line passing through forest and non-forest area.

1	Total Length (Forest & Non-Forest) of T/L in Panchkula Forest Division	14.765 Mtr
2	Total width required for 132 KV Electric Transmission Line (ROW)	18.00 Mtr.
3	Total area (Forest & Non Forest) involved of T/L in Panchkula Forest Division	26.577 Hac
4	Total Length Passing through Forest Area of Panchkula Forest Division	112 Mtr
5	Total Forest Area involved in Panchkula Forest Division	0.2016 Hac
6	Total Length Passing through Non -Forest Area of Panchkula Forest Division	14.653 Mtr
7	Total Non-Forest Area involved in Panchkula forest Division	26.3754 hac

For Details of the breakup of the area in Panchkula Forest division please refer check list serial No.-18(a) for reference

Place :- Panchkula

Date:-.....

66 KV D/C LINE FROM 220 KV S/STN RAIWALI TO 66 KV S/STN HSIIDC BARWALA

S NO.	Name of forest area	Width of Line (In Mtr)	Width of forest (In Mtr)	Total Forest Area to be used(in sq. Mtr)	Total Forest Area to be used(In Hac.)	COORDINATE
1	Barwala - Toda Road L	18	8	144	0.0144	N 29°25'42.27"
	Barwala - Toda Road R	18	8	144	0.0144	E 74°49'57.77"
2	Barwala - Raipur rani Road L	18	8	144	0.0144	N 30°32'43.62
	Barwala - Raipur rani Road R	18	11	198	0.0198	E 76°57'34.08"
3	Bandh L	18	4	72	0.0072	N 30°32'54.16"
	Bandh R	18	4	72	0.0072	E 76°57'40.64"
4	Barwala - Rehore Road L	18	2	36	0.0036	N 30°33'52.73"
	Barwala - Rehore Road R	18	2	36	0.0036	E 76°57'29.38"
5	Panchkula - Shahzadpur Road L	18	26	468	0.0468	N 30°34'4.59"
	Panchkula - Shahzadpur Road R	18	19	342	0.0342	E 76°57'27.52"
6	Rehore - Khatauli Road L	18	3	54	0.0054	N 30°34'48.37"
	Rehore - Khatauli Road R	18	3	54	0.0054	E 76°57'40.43"
7	Rehore - Khatauli Road L	18	10	180	0.018	N 30°34'55.44"
	Rehore - Khatauli Road R	18	4	72	0.0072	E 76°57'42.43"
			112	2016	0.2016	
	Total forest area (in hac)					


FOREST PROPOSAL

66 KV D/C LINE FROM 220 KV S/STN RAIWALI TO 66 KV S/STN HSIIDC BARWALA

IN PANCHKULA DISTRICT

Crossing Between:- Tower No. 12 - Tower No. 13

TL.NO.13

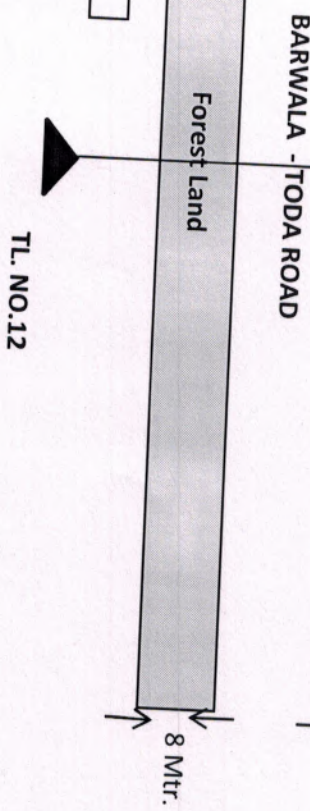

Side	Length in Mtr.	Width in Mtr.	Area Sq. Mtr.	Area in Hac.
Left	8	18	144	0.0144
Right	8	18	144	0.0144
	TOTAL		288	0.0288

Place- PANCHKULA

Date-.....

FOREST PROPOSAL

66 KV D/C LINE FROM 220 KV S/STN RAIWALI TO 66 KV S/STN HSIIDC BARWALA


IN PANCHKULA DISTRICT
Crossing Between:- Tower No. 35 - Tower No. 36

TL.NO.36

BARWALA - RAIPUR RANI ROAD

NO. OF TREES = 2 BABUL
NO. OF TREES = 14 EUCALYPTUS
NO. OF TREES = 2 SHEESHAM

TL. NO.35

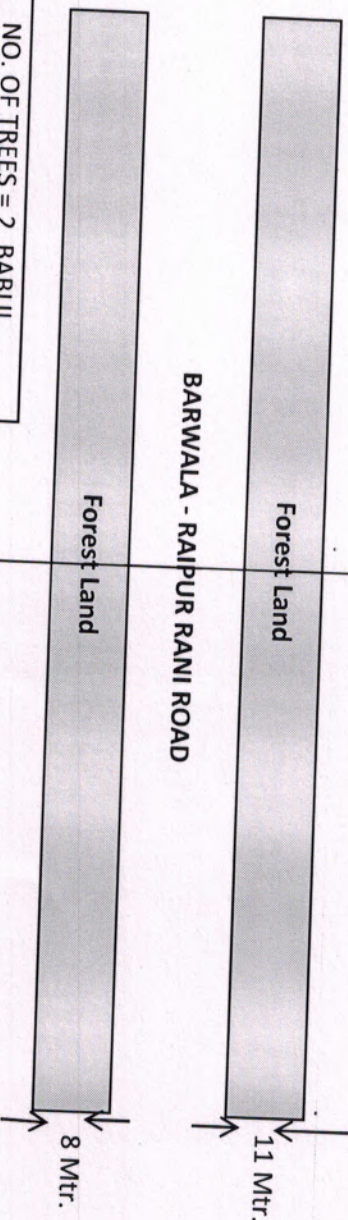

Side	Length in Mtr.	Width in Mtr.	Area Sq. Mtr.	Area in Hac.
Left	8	18	144	0.0144
Right	11	18	198	0.0198
TOTAL			342	0.0342

Place- PANCHKULA

Date-.....


FOREST PROPOSAL

66 KV D/C LINE FROM 220 KV S/STN RAIWALI TO 66 KV S/STN HSIIDC BARWALA

IN PANCHKULA DISTRICT

Crossing Between:- Tower No.38 - Tower No. 39

TL.NO.39

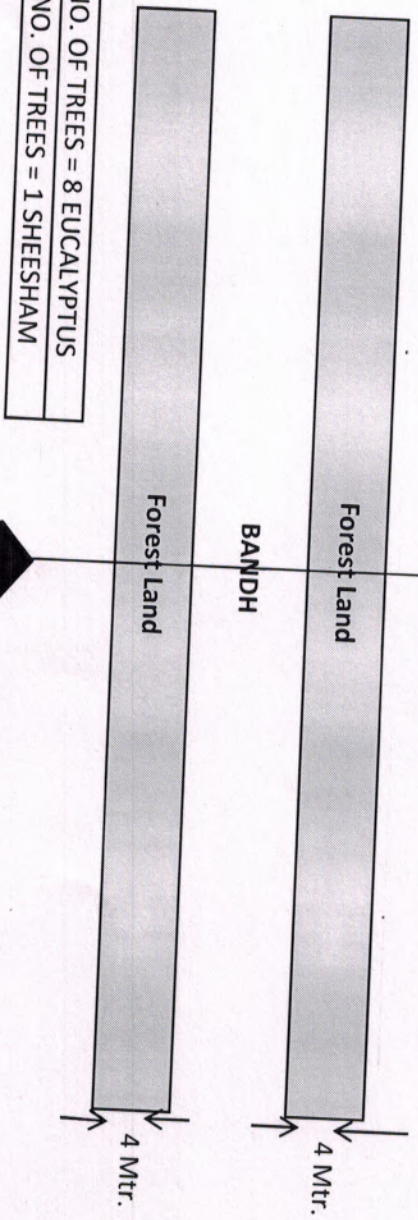

Side	Length in Mtr.	Width in Mtr.	Area Sq. Mtr.	Area in Hac.
Left	4	18	72	0.0072
Right	4	18	72	0.0072
TOTAL			144	0.0144

Place- PANCHKULA

Date-.....

FOREST PROPOSAL


66 KV D/C LINE FROM 220 KV S/STN RAIWALI TO 66 KV S/STN HSIIDC BARWALA

IN PANCHKULA DISTRICT

Crossing Between:- Tower No. 45 - Tower No. 46

TL.NO.46

TL. NO.45

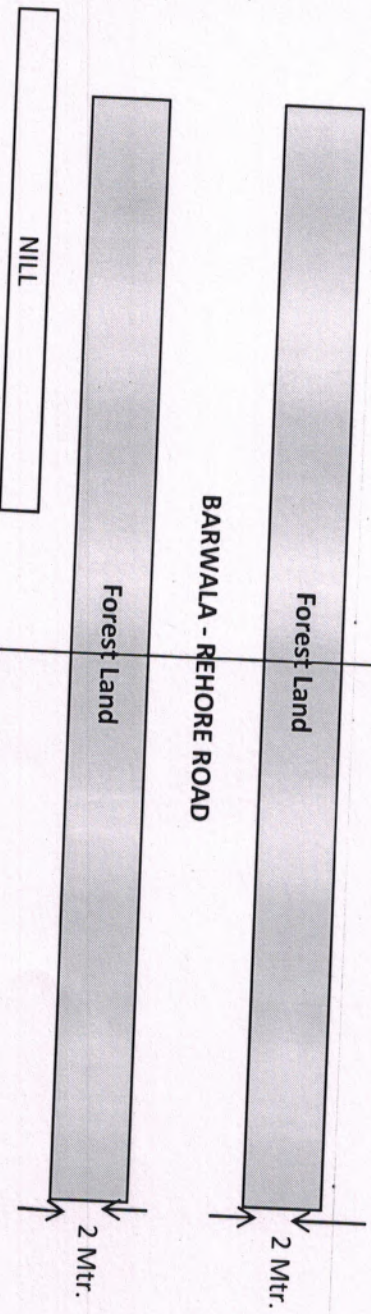

Side	Length in Mtr.	Width in Mtr.	Area Sq. Mtr.	Area in Hac.
Left	2	18	36	0.0072
Right	2	18	36	0.0072
	TOTAL		72	0.0144

Place- PANCHKULA

Date-.....

FOREST PROPOSAL


66 KV D/C LINE FROM 220 KV S/STN RAIWALI TO 66 KV S/STN HSIIDC BARWALA

IN PANCHKULA DISTRICT

Crossing Between:- Tower No. 47 - Tower No. 48

TL.NO.48

PANCHKULA-SHAHZADPUR ROAD

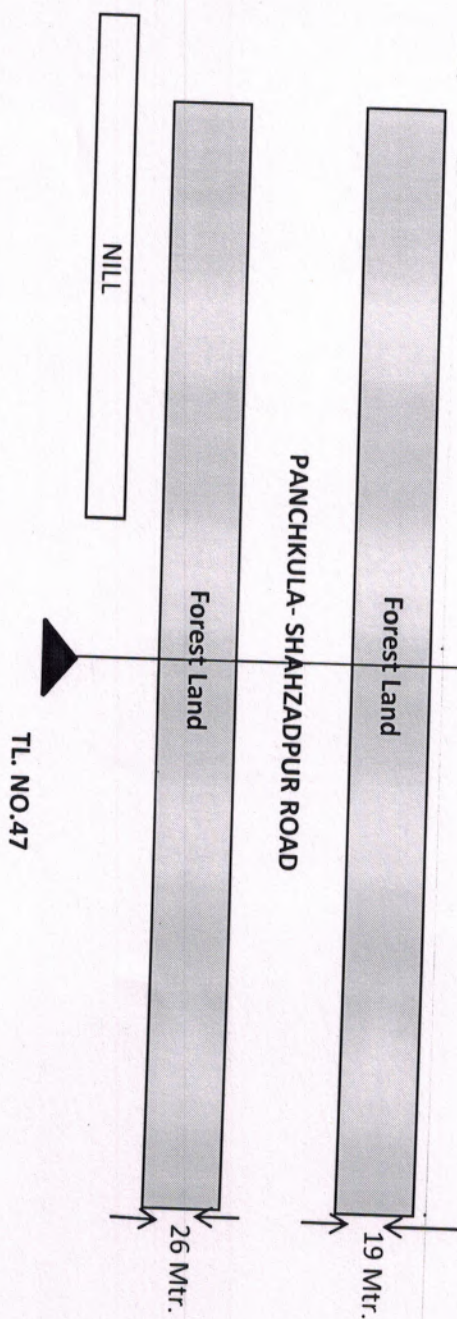

Side	Length in Mtr.	Width in Mtr.	Area Sq. Mtr.	Area in Hac.
Left	26	18	468	0.0468
Right	19	18	342	0.0342
TOTAL			810	0.081

Place- PANCHKULA

Date-.....

FOREST PROPOSAL


66 KV D/C LINE FROM 220 KV S/STN RAIWALI TO 66 KV S/STN HSIIDC BARWALA

IN PANCHKULA DISTRICT

Crossing Between:- Tower No. 52 - Tower No. 53

TL.NO.53

REHORE - KHATAULI ROAD

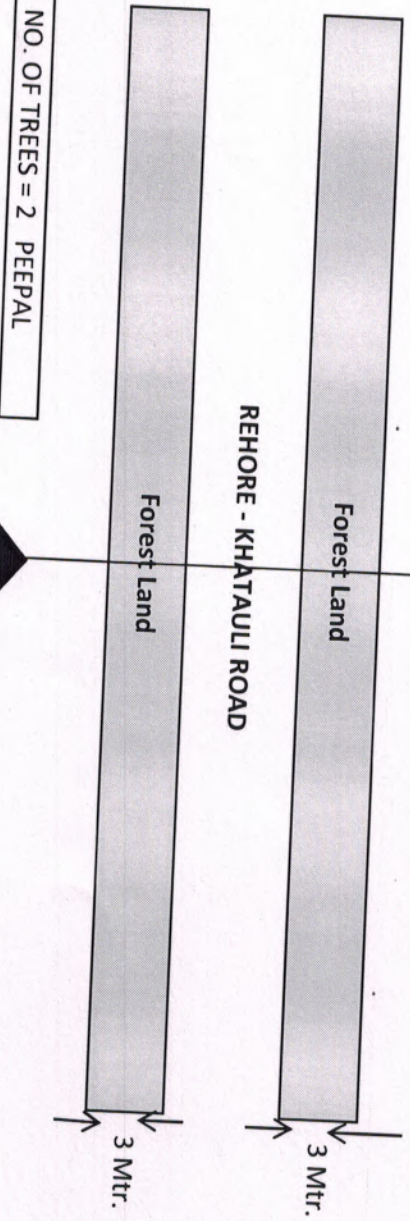

TL. NO.52

Side	Length in Mtr.	Width in Mtr.	Area Sq. Mtr.	Area in Hac.
Left	3	18	54	0.0054
Right	3	18	54	0.0054
TOTAL			108	0.0108

Place- PANCHKULA

Date-.....

FOREST PROPOSAL


66 KV D/C LINE FROM 220 KV S/STN RAIWALI TO 66 KV S/STN HSIIDC BARWALA

IN PANCHKULA DISTRICT

Crossing Between:- Tower No. 56 - Tower No. 57

TL.NO.57

REHORE - KHATAULI ROAD

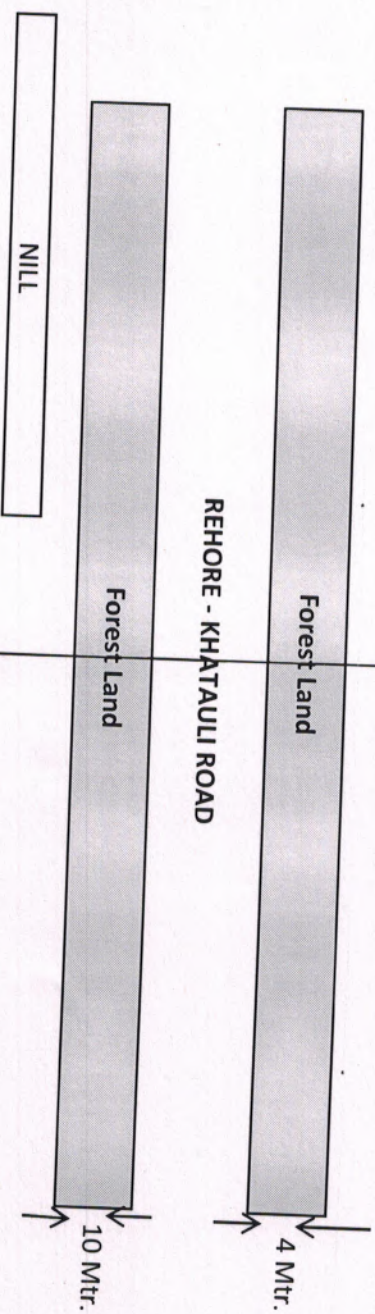

TL. NO.56

Side	Length in Mtr.	Width in Mtr.	Area Sq. Mtr.	Area in Hac.
Left	10	18	180	0.018
Right	4	18	72	0.0072
	TOTAL		252	0.0252

Place- PANCHKULA

Date-.....