


AREA DETAIL	
TOTAL PLOT AREA	= 3879.99 sq.mt.
TOTAL BUILDING AREA	= 8140 sq.mt.
PHASIA NO.	= 810/8/2
VILLAGE	= CHAITALA
NEAREST POLICE STATION	= SAGAR DABWALI
NEAREST RAILWAY STATION	= DABWALI
TDSIL	= DABWALI
DISTRICT	= SIRSA (HARYANA)




GENERAL NOTES:-

- NO ROAD CROSSING WITHIN 300M ON EITHER SIDE OF THE PLOT.
- NO DRAIN, SEWER OR STRUCTURE WITHIN 1.5M FROM THE LAND BOUNDARY.
- THE PLOT SHALL BE FENCED WITH 1.5M HIGH GALVANIZED IRON PIPE SLEEVE.
- VENT PIPE SHALL BE PROVIDED FOR EACH TANK.
- 4.00MTR. CLEAR ALLROUND WITHIN THE PLOT FITTED WITH INVERTED 'U' TYPE VENT HOOD.
- VENT HOOD SHALL BE PROVIDED WITH 11 MESH PER LINEAR CENTIMETER AT ITS OPEN END.
- CO-ORDINABLE METALLURGY GAUGE OF 11 MESH PER LINEAR CENTIMETER ON THE WALL OF ROOM 1.50MTR. HIGH FROM ITS FLOOR LEVEL AND 50 CM. ABOVE THE GROUND LEVEL.
- FILL POINTS ARE KEPT 3.5M CLEAR ALLROUND.
- NO FILL POINT SHALL BE PROVIDED AT THE PETROL PUMP FOR EACH TANK.
- NO FILL POINT SHALL BE PROVIDED AT THE PETROL PUMP FOR EACH TANK.
- PETROLEUM FIRE-2 NO. 00 TYPE FIRE EXTINGUISHERS OF CAPACITY 3KGS EACH SHALL BE PROVIDED AT THE PETROL PUMP.
- NO FILL POINT SHALL BE PROVIDED AT THE PETROL PUMP FOR EACH TANK.
- NO FILL POINT SHALL BE PROVIDED AT THE PETROL PUMP FOR EACH TANK.
- BOTH THE TANKS SHALL NOT BE REPLENISHED AT THE SAME TIME.
- FILL PIPE AND OIL PIPES ARE FITTED WITH LOCKING CAP.
- ALL ELECTRICAL FITTINGS SHALL CONFORM TO IS 2145 OR EQUIVALENT IS SPECIFICATION.

SPECIFICATIONS

- MS TANK OF 200L CAPACITY FABRICATED AS PER IRC APPROVED BY C.E. NAUPUR VIDE LETTER NO. P-46(1) DT 01.12.01-2007.
- NOTE.
- CERTIFIED THAT THIS IS A NEW RETAIL OUTLET & NOT RESTATEMENT CASE.
- CERTIFIED THAT NO GAS OR FLAME PENDING IN ANY COURT OF AREA AGAINST THIS SITE/DEALERSHIP.
- CERTIFIED THAT THE TANKS HAVE BEEN APPROVED BY APPROVALS FROM MCP/VRC AND OTHER RELEVANT GOVT. DEPT. THE TANKS SHALL BE MEASURING 12.0 M X 17.0 M SHALL CONFORM TO THE SPECIFICATION OF THE GOVT. DEPT. THERE IS NO CHANGE OF ITS EVER CAVING-IN UNDER NORMAL CIRCUMSTANCES.
- STEEL CANOPY APPROVAL NO. CCE G-40 (M2) P-CANOPY DT 26.07.89.
- PROVIDED AT ABOVE P.V.O.

DATE	REV. NO.	BRIEF DESCRIPTION OF REVISIONS MADE
	REV.-1	NEW PROPOSAL
	REV.-2	
	REV.-3	
TITLE:- PROPOSED RETAIL OUTLET MS/HSD FUELS.		
NAME OF RETAIL OUTLET		
PROJECT:-		
PROPOSED NEW RETAIL OUTLET(S) AT VILLAGE CHAITALA, ON DABWALI-CHAITALA/ ROAD, DIST. SIRSA (HRY). PHASE NO. 810/8/2, SIRSA (HRY).		
DRAWN BY:- SATISH KUMAR		
DRAWING NO. DNO/MS/04/15		
EPOCH. LGND. New		
DATE: 15-04-2016		
SCALE:- AS SHOWN		
Chief Engineer		

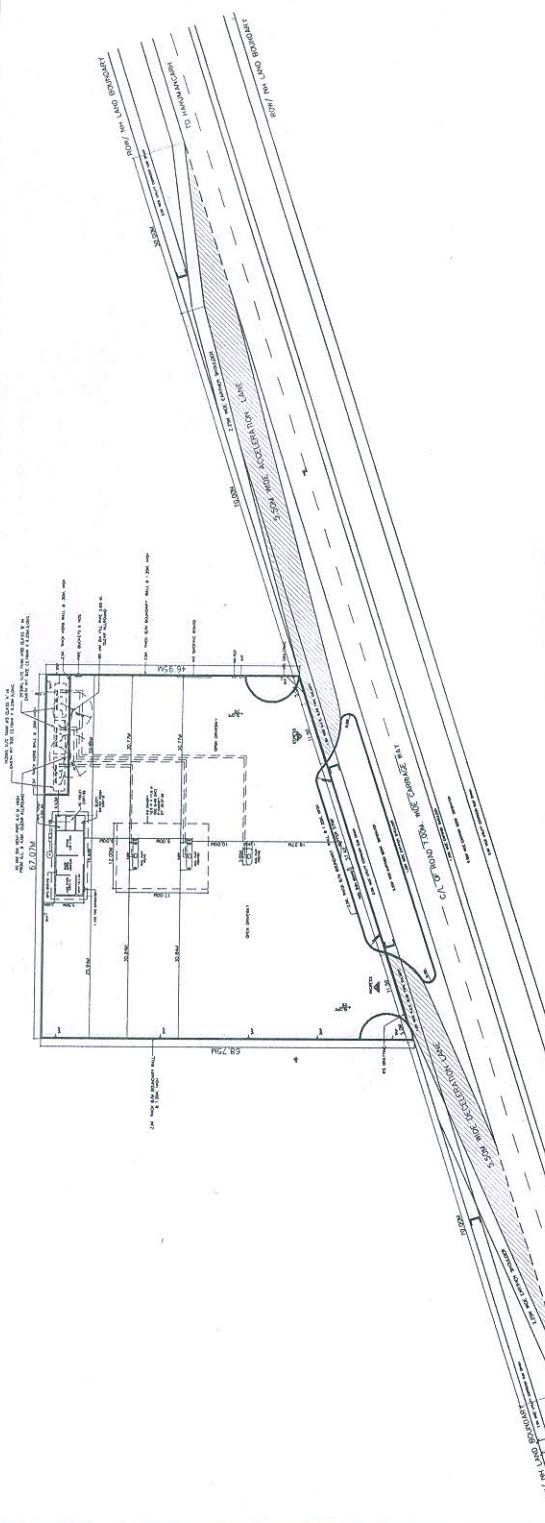

APPROACH ROAD AREA







1. AREA OF DECELERATION LANE = 329.86 sq.mt.

2. AREA OF ACCELERATION LANE = 539.90 sq.mt.

TOTAL AREA = 329.86 + 539.90 = 869.76 sq.mt.

= 0.0570 Hectare.

TANK	SIZE OF TANK	MS PLATES	NO. OF	VENT PIPE	SLAB IN	TANKS	PUMPS
		SHALL END	H.O.B.	DA	IN	MS	MS
200L	2.10M X 6.25M	6mm	8mm	8	40	325	1
							2
							4

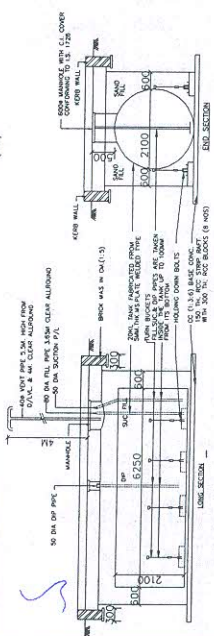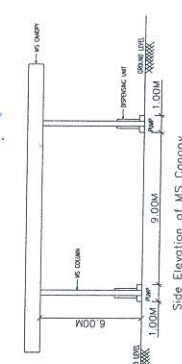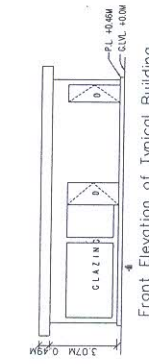

एस. क. राजपाल/S.K. Rajpal
 प्रबंधक (रिटेल सेल्स)/Manager (R.S.)
 हिंसार मण्डल कार्यालय
 Hissar Divisional Office
 इंडियन ऑयल कॉर्पोरेशन लि.
 Indian Oil Corporation Ltd.
 हिंसार-125005/Hissar - 125005