


DO NOT SCALE

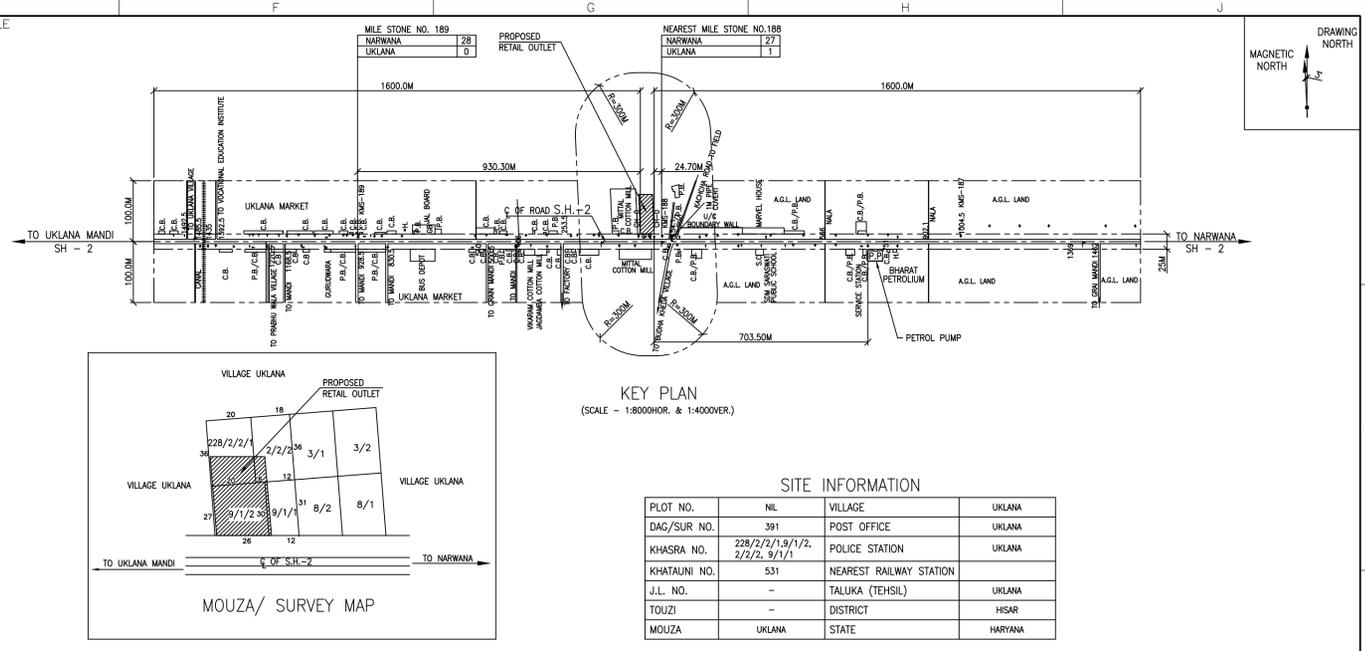

SITE INFORMATION

PLOT NO.	NIL	VILLAGE	UKLANA
DAG/SUR NO.	391	POST OFFICE	UKLANA
KHASRA NO.	228/2/2, 1/9/1/2, 2/2/2, 9/1/1	POLICE STATION	UKLANA
KHATAUNI NO.	531	NEAREST RAILWAY STATION	UKLANA
J.L. NO.	-	TALUKA (TEHSIL)	UKLANA
TOUZI	-	DISTRICT	HSAR
MOUZA	UKLANA	STATE	HARYANA

DETAIL OF TANKS

SR. NO.	ITEM	QTY.	DIMENSION	CAPACITY OF TANKS IN LITRES					
				PRODUCT	CLASS 'A'	CLASS 'B'	LICENCE		
1	UNDERGROUND TANK 1	1	1900ø x 8036L	MS	21800	1800	20000	-	-
2	UNDERGROUND TANK 2	1	2400ø x 10044L	HSD	-	-	43430	3430	40000
3	UNDERGROUND TANK 3	1	2400ø x 10044L	HSD	-	-	43430	3430	40000


EQUIPMENT LIST

SR. NO.	ITEM	QTY.	DIMENSION / CAPACITY	REMARKS
1	DISPENSING UNIT HSD / MS (h/m // h/m)	1	2 DISPLAY x 4 HOSES	
2	DISPENSING UNIT HSD (H // H)	2	2 DISPLAY x 2 HOSES	
3	SUBMERSIBLE TURBINE PUMP (STP)	3	1 NO. FOR MS, 2 NOS. FOR HSD	
4	AUTO TANK GAUGING (ATG) SYSTEM	3	-	


SALES KIOSK

SR. NO.	FACILITY	QTY.	DIMENSION (INTERNAL)
1	CUSTOMER DEALING ROOM	1	12190 x 3950
2	STORE ROOM	1	2135 x 2050
3	ELECTRICAL ROOM	1	3615 x 2050
4	IT ROOM	1	3050 x 2050
5	ACCOUNTS ROOM	1	2700 x 2050
6	AIR COMPRESSOR ROOM	1	1730 x 2500
7	TOILET	2	1500 x 1200
8	WATER COOLER	1	1500 x 785
9	STORAGE SPACE	1	1500 x 430

- GENERAL NOTES:-**
- ALL DIMENSIONS ARE IN MM AND LEVELS IN METRES UNLESS OTHERWISE STATED.
 - DISPENSING UNIT, AUTOMATIC TANK GAUGING AND SUBMERSIBLE TURBINE PUMP ETC. CONFORMS TO SPECIFICATIONS APPROVED BY COCE.
 - BOTH THE TANKS SHALL NOT BE REPLENISHED AT THE SAME TIME.
 - TANKS SHALL BE FED BY TANK LORRY ONLY.
 - "NO SMOKING" SIGN SHALL BE DISPLAYED AT PROMINENT LOCATION.
 - THERE SHALL BE 4.0M CLEAR SPACE ALL AROUND THE TANK POINT WITH LOCKING CAP ARRANGEMENT.
 - EMERGENCY STOP SWITCH SHALL BE PROVIDED AT ACCESSIBLE LOCATION.
 - FUEL PIPE IS LAID IN TRENCHES TO ENSURE THAT VEHICLE LOAD IS NOT TRANSMITTED TO PIPE.
 - IN THE BUFFER ZONE NO HEDGE AND PLANT SHALL BE TALLER THAN 0.6M.
 - THE LICENSED PREMISES SHALL BE USED ONLY FOR THE PURPOSE FOR WHICH IT IS LICENSED FOR.
 - TWO NUMBERS OF 10 KG. CAPACITY DRY CHEMICAL TYPE (DCP) FIRE EXTINGUISHERS AT THE RO AND TWO NUMBERS OF SAND BUCKETS SHALL BE PROVIDED FOR EACH DISPENSING UNIT.
 - NO DRAIN, SEWER OR STRUCTURE WITHIN 1.5M. FROM UNDERGROUND TANK.
 - ELECTRICAL FITTINGS CONFORM TO IS-2148 INSTALLED IN HAZARDOUS AREA ZONE 1.
 - THE OPEN END OF VENT PIPE SHALL BE COVERED WITH TWO LAYERS OF NON CORROSIVE WIRE MESH OF 11 MESH PER LINEAR CENTIMETRE. HEIGHT OF VENT PIPE WILL BE 4.0M (MIN) OR 1.5M ABOVE TOP OF SALES BUILDING / KIOSK.
 - EXHAUST PIPE OF GENERATOR SET SHALL BE FITTED WITH SPARK ARRESTOR.
- SPECIAL NOTES:-**
- CERTIFIED THAT ALL APPLICABLE NORMS AND REQUIREMENTS AS PER IRC - 1983 (WITH LATEST AMENDMENT) WILL BE COMPLIED WITH.
 - CERTIFIED THAT THE CANOPY DESIGN CONFIRMS TO SOUND ENGINEERING SPECIFICATIONS AND THERE IS NO CHANCE OF CAVING UNDER NORMAL CIRCUMSTANCES.
 - CERTIFIED THAT THE SITE IS FREE FROM ANY LITIGATION & NO CASE IS PENDING IN ANY COURT OF LAW.
 - CERTIFIED THAT FRP TANKS HAVE TYPE APPROVAL FROM CHIEF CONTROLLER OF EXPLOSIVES, MARRUR VIDE LETTER REF. NO. P.6(5) Misc/2003 DATED 12/09/2003.
 - ATG CONTROL PANEL AND DISPLAY SHALL BE INSTALLED AS PER TYPE APPROVAL OBTAINED FROM COCE VIDE REF. P.3(9)/22/99/1 DTD. 05.05.2003 AND DRAWING NUMBERS 20-200-ES-71-01 & 20-200-ES-72-01.
 - NO ELECTRICAL LINE IS PASSING OVER THE PROPOSED RETAIL OUTLET.

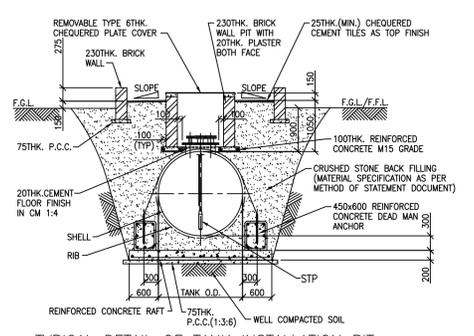

TYPICAL DETAIL OF TANK INSTALLATION PIT AWAY FROM DRIVEWAY - EARTHEN PIT (APPROVED BY COCE VIDE LETTER REF. NO. P.6(5) Misc/2003 DTD. 12-09-2003)

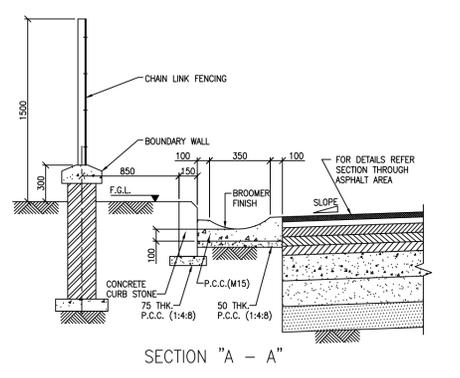

SECTION "A - A"

Executive Engineer
Provincial Divn. No. 1
FWD B&R Dr. HSAR

- LEGEND:-**
- EMERGENCY STOP SWITCH
 - FUEL DISPENSER TYPES:-
 - m - MOTOR SPIRIT 40 L/MIN.
 - h - DIESEL 40 L/MIN.
 - H - DIESEL 80 L/MIN.
 - SIGNAGE TYPES:-
 - TOTEM SIGN
 - ENTRY/EXIT SIGN
 - YARD LAMP
 - AIR LOCATION SIGN

REV.	NO.	REVISION DESCRIPTION	DRWEN	CHK	APPROVED	DATE
05	ISSUED FOR STATUTORY APPROVAL	SAG	SA	SR	-	25.04.03
04	MINOR NAME CHANGE FROM RL TO PPMAL	ACB	AKA	SR	-	28.02.03
03	ISSUED FOR STATUTORY APPROVAL	TPN	LD	ABA	-	10.03.04
02	ISSUED FOR STATUTORY APPROVAL	MCS	LSM	MJD	JAD	25.11.03
01	ISSUED FOR STATUTORY APPROVAL	US	MS	SNB	-	07.08.03
00	ISSUED FOR STATUTORY APPROVAL	AMS	SST	SSJ	JJD	25.04.03

THIS DRAWING AND/OR ITS CONTENTS, INFORMATION AND PRINCIPLES OF DESIGN ARE THE EXCLUSIVE PROPERTY OF JACOBS H&G LIMITED AND IS SUBMITTED TO YOU WITH THE AGREEMENT THAT IT IS NOT TO BE REPRODUCED IN ANY MANNER, COPIED, OR WHOLLY OR IN PART TO BE RELIED ON FOR OR IN CONNECTION WITH ANY OTHER PROJECT OR INDIVIDUAL FOR ANY OTHER PROJECT EXCEPT BY WRITTEN AGREEMENT WITH JACOBS H&G PRIVATE LIMITED. ACCEPTANCE OF THIS DRAWING SHALL BE CONSIDERED AS AN AGREEMENT TO THIS STATEMENT.

JACOBS H&G
ENGINEERS AND CONSTRUCTORS

JACOBS H&G PRIVATE LIMITED.
H&G HOUSE,
PLOT NO. 12, SECTOR 11, CENTRAL BUSINESS DISTRICT,
BELAPUR, NEW DELHI - 400 814
TEL. (91-22) 7573046 / 7573047 FAX. (91-22) 7573049

A MEMBER OF THE JACOBS ENGINEERING GROUP, INC.

Reliance
Infrastructure Limited

RETAIL OUTLET: HRF017 (ULKANA MANDI)

AT DAG/SURVEY NO. : 391 ON : SH-2 NEAR MILE STONE -KMS-188
VILLAGE : UKLANA TALUKA /TEHSIL: UKLANA
DISTRICT : HSAR STATE : HARYANA

PRELIM. NO. : BC 271802 DRAWING NO. : HRF017-NS-F00-P3-03-05 REV. : 05
PLT. SIZE : 1:200