


Tower Details of 132kV S/C Khonsa-Changlang T/L showing Right of Way corridor, width clearance for tree felling, minimum ground clearance for bottom conductor.

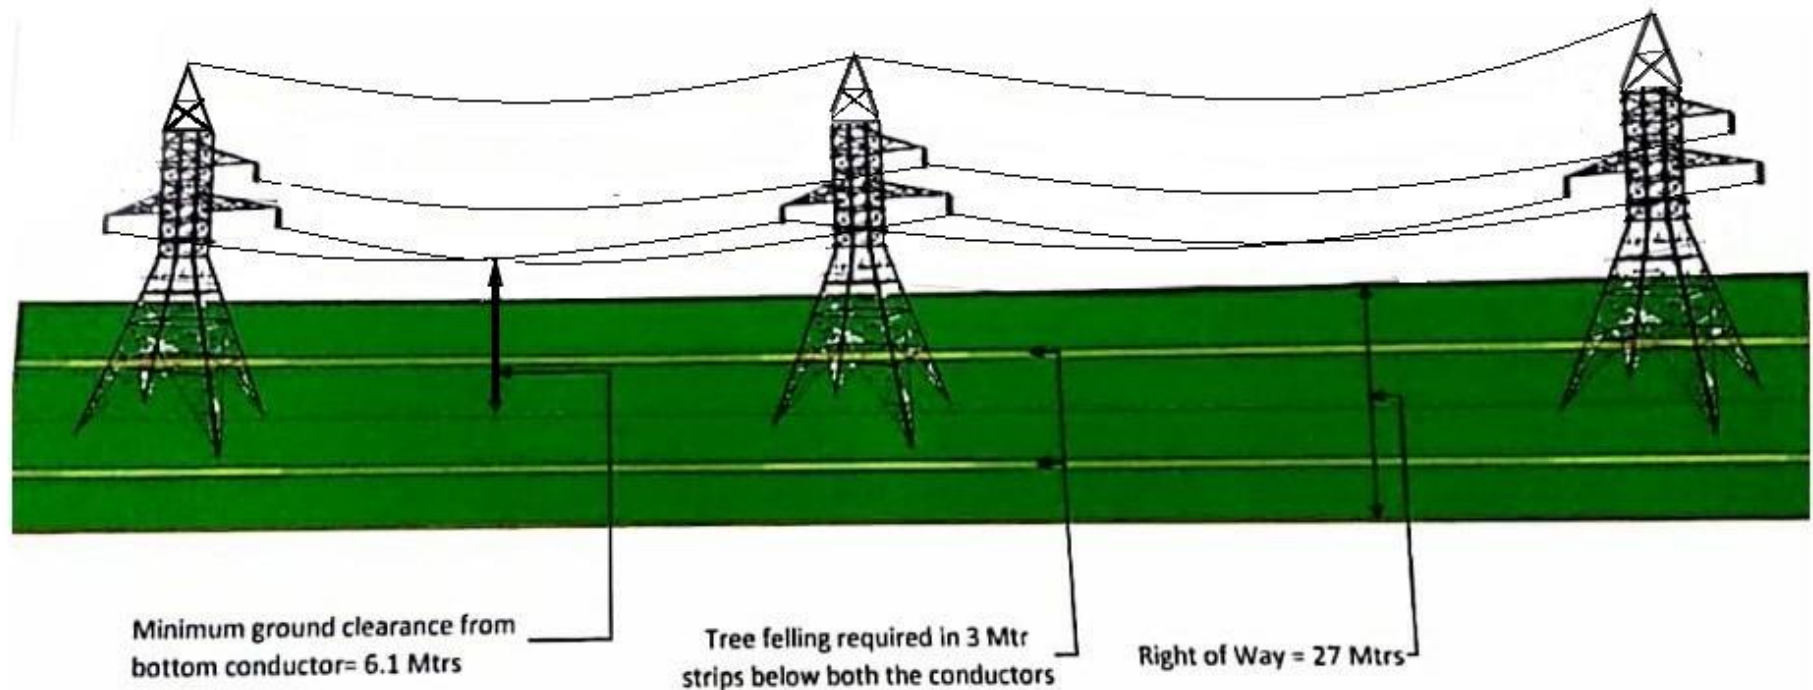


Submitted by:

PLS-CADD Overlay

132kV Khonsa Changlang T/L

3D Tower Model (Changlang FD)

Legend

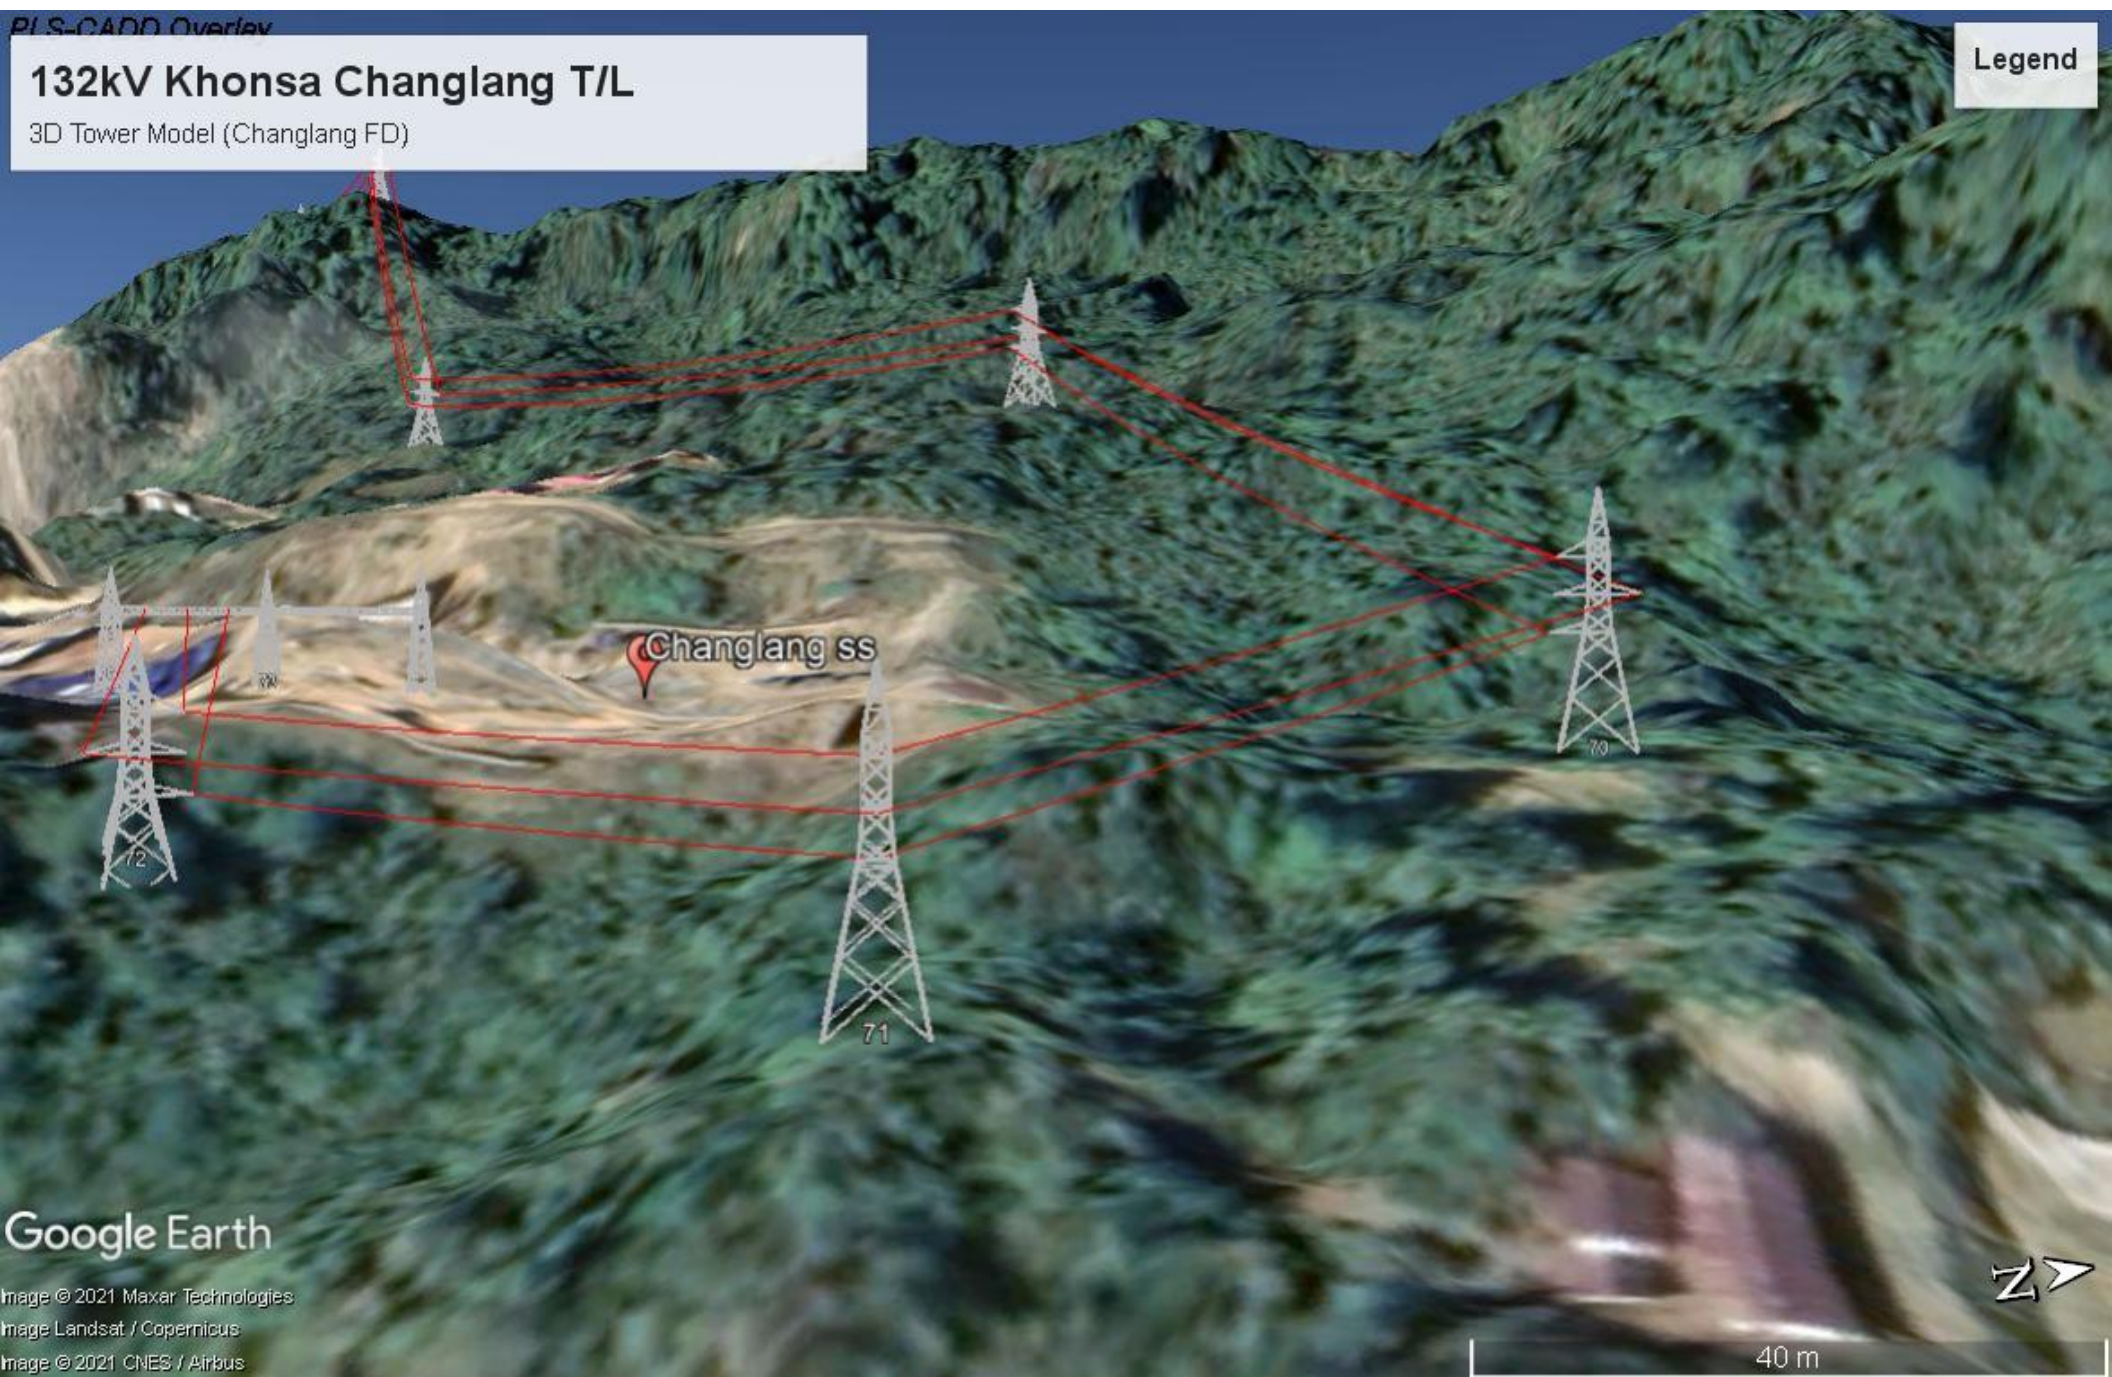


PLS-CADD Overlay

Legend

132kV Khonsa Changlang T/L

3D Tower Model (Changlang FD)

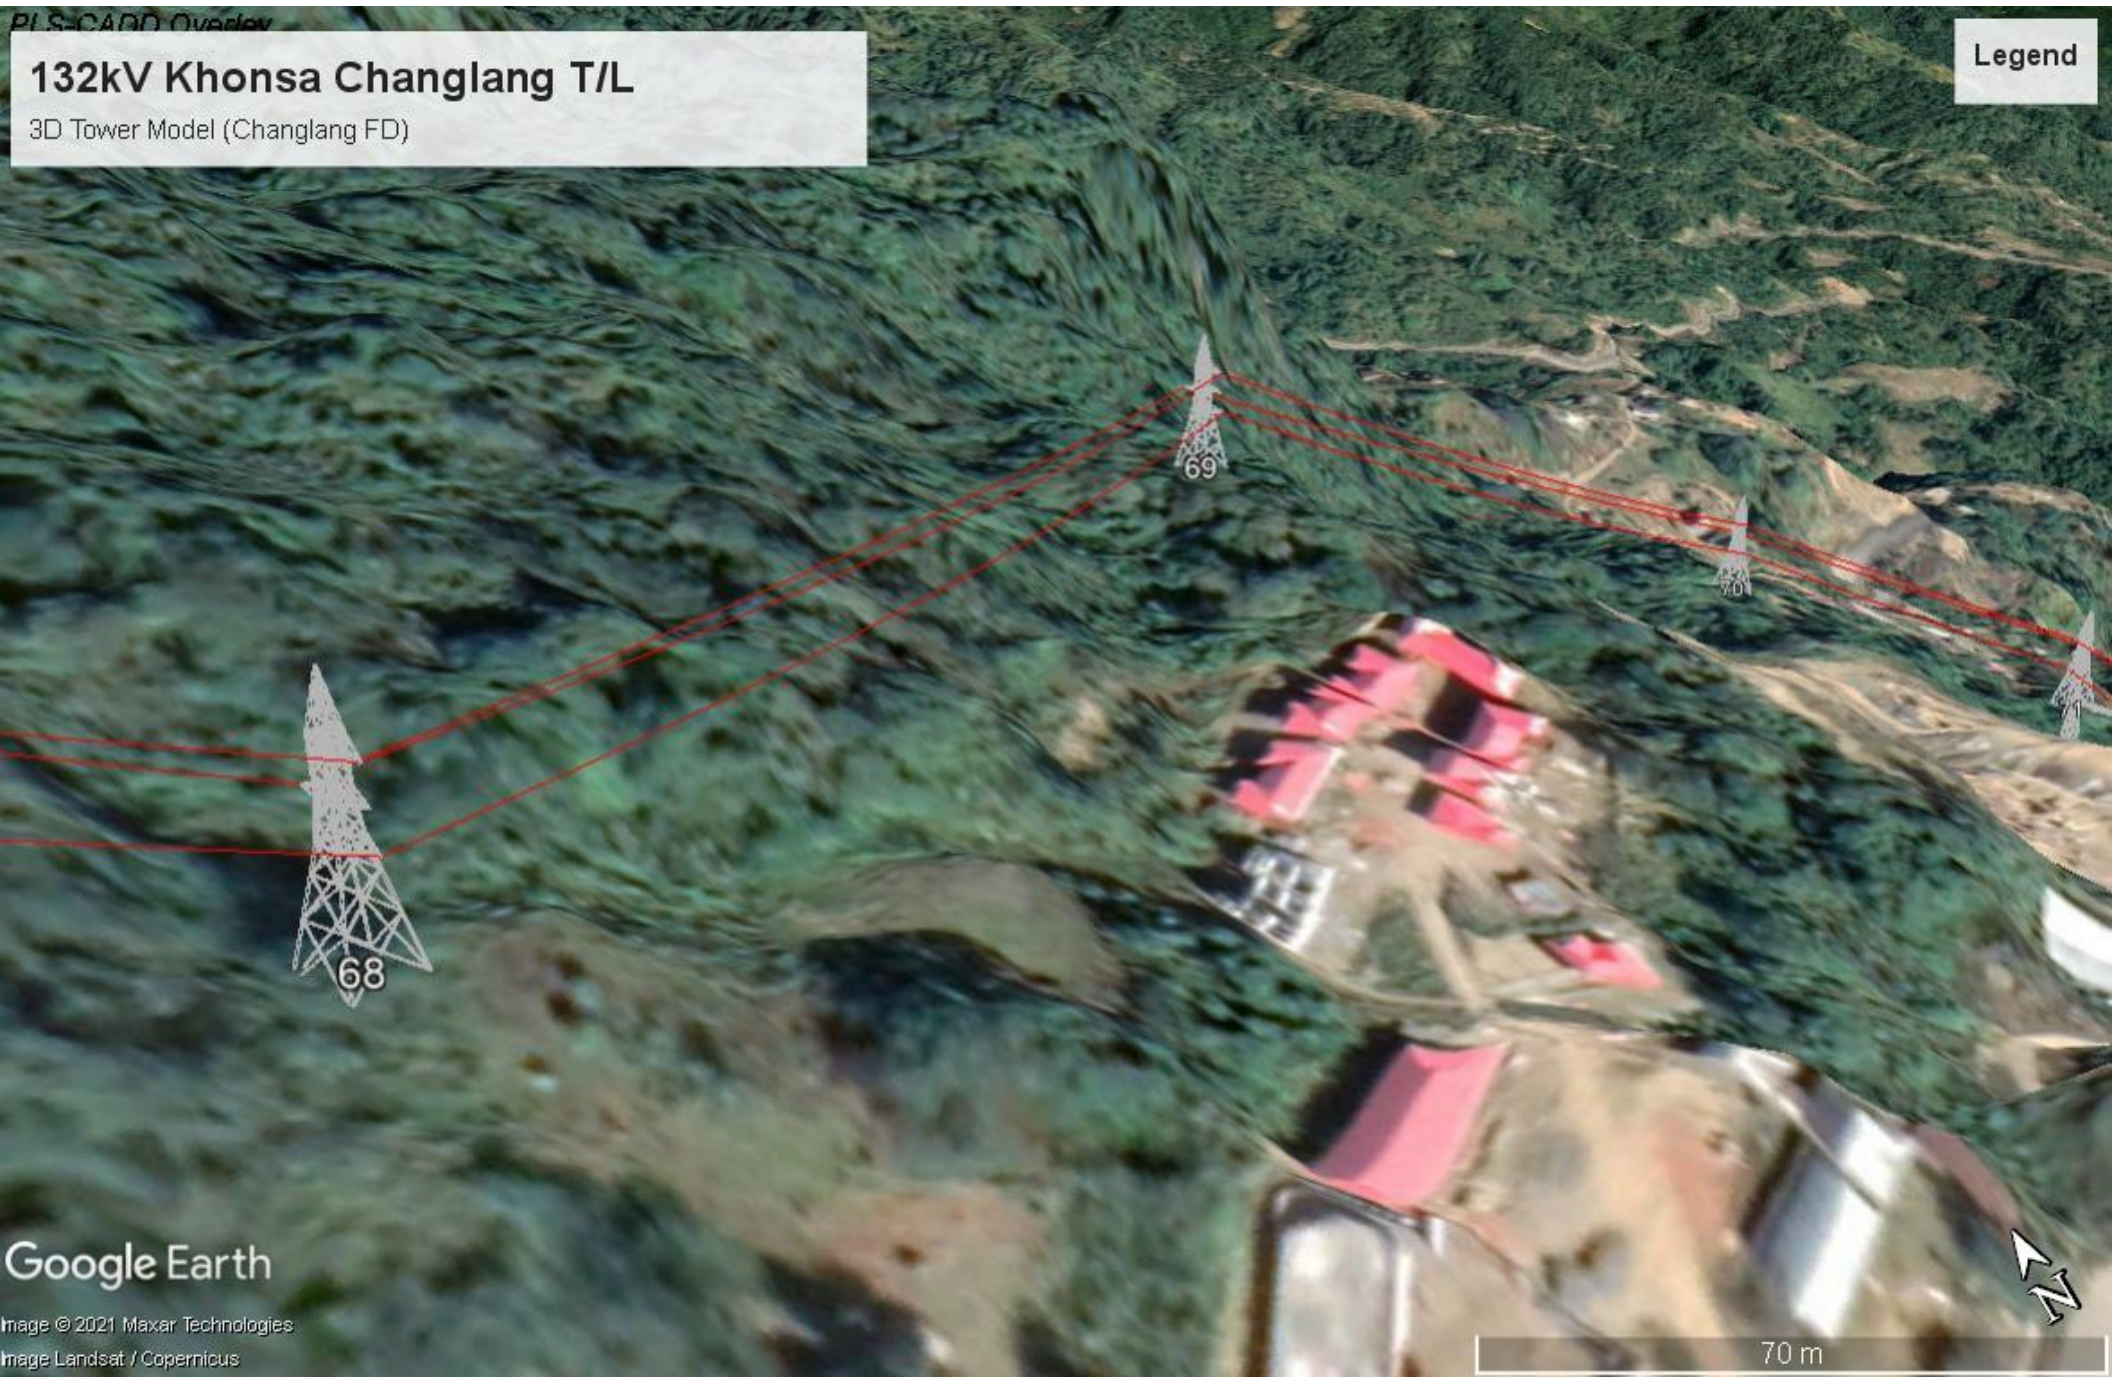


Google Earth

Image © 2021 Maxar Technologies
Image Landsat / Copernicus

132kV Khonsa Changlang T/L

3D Tower Model (Changlang FD)

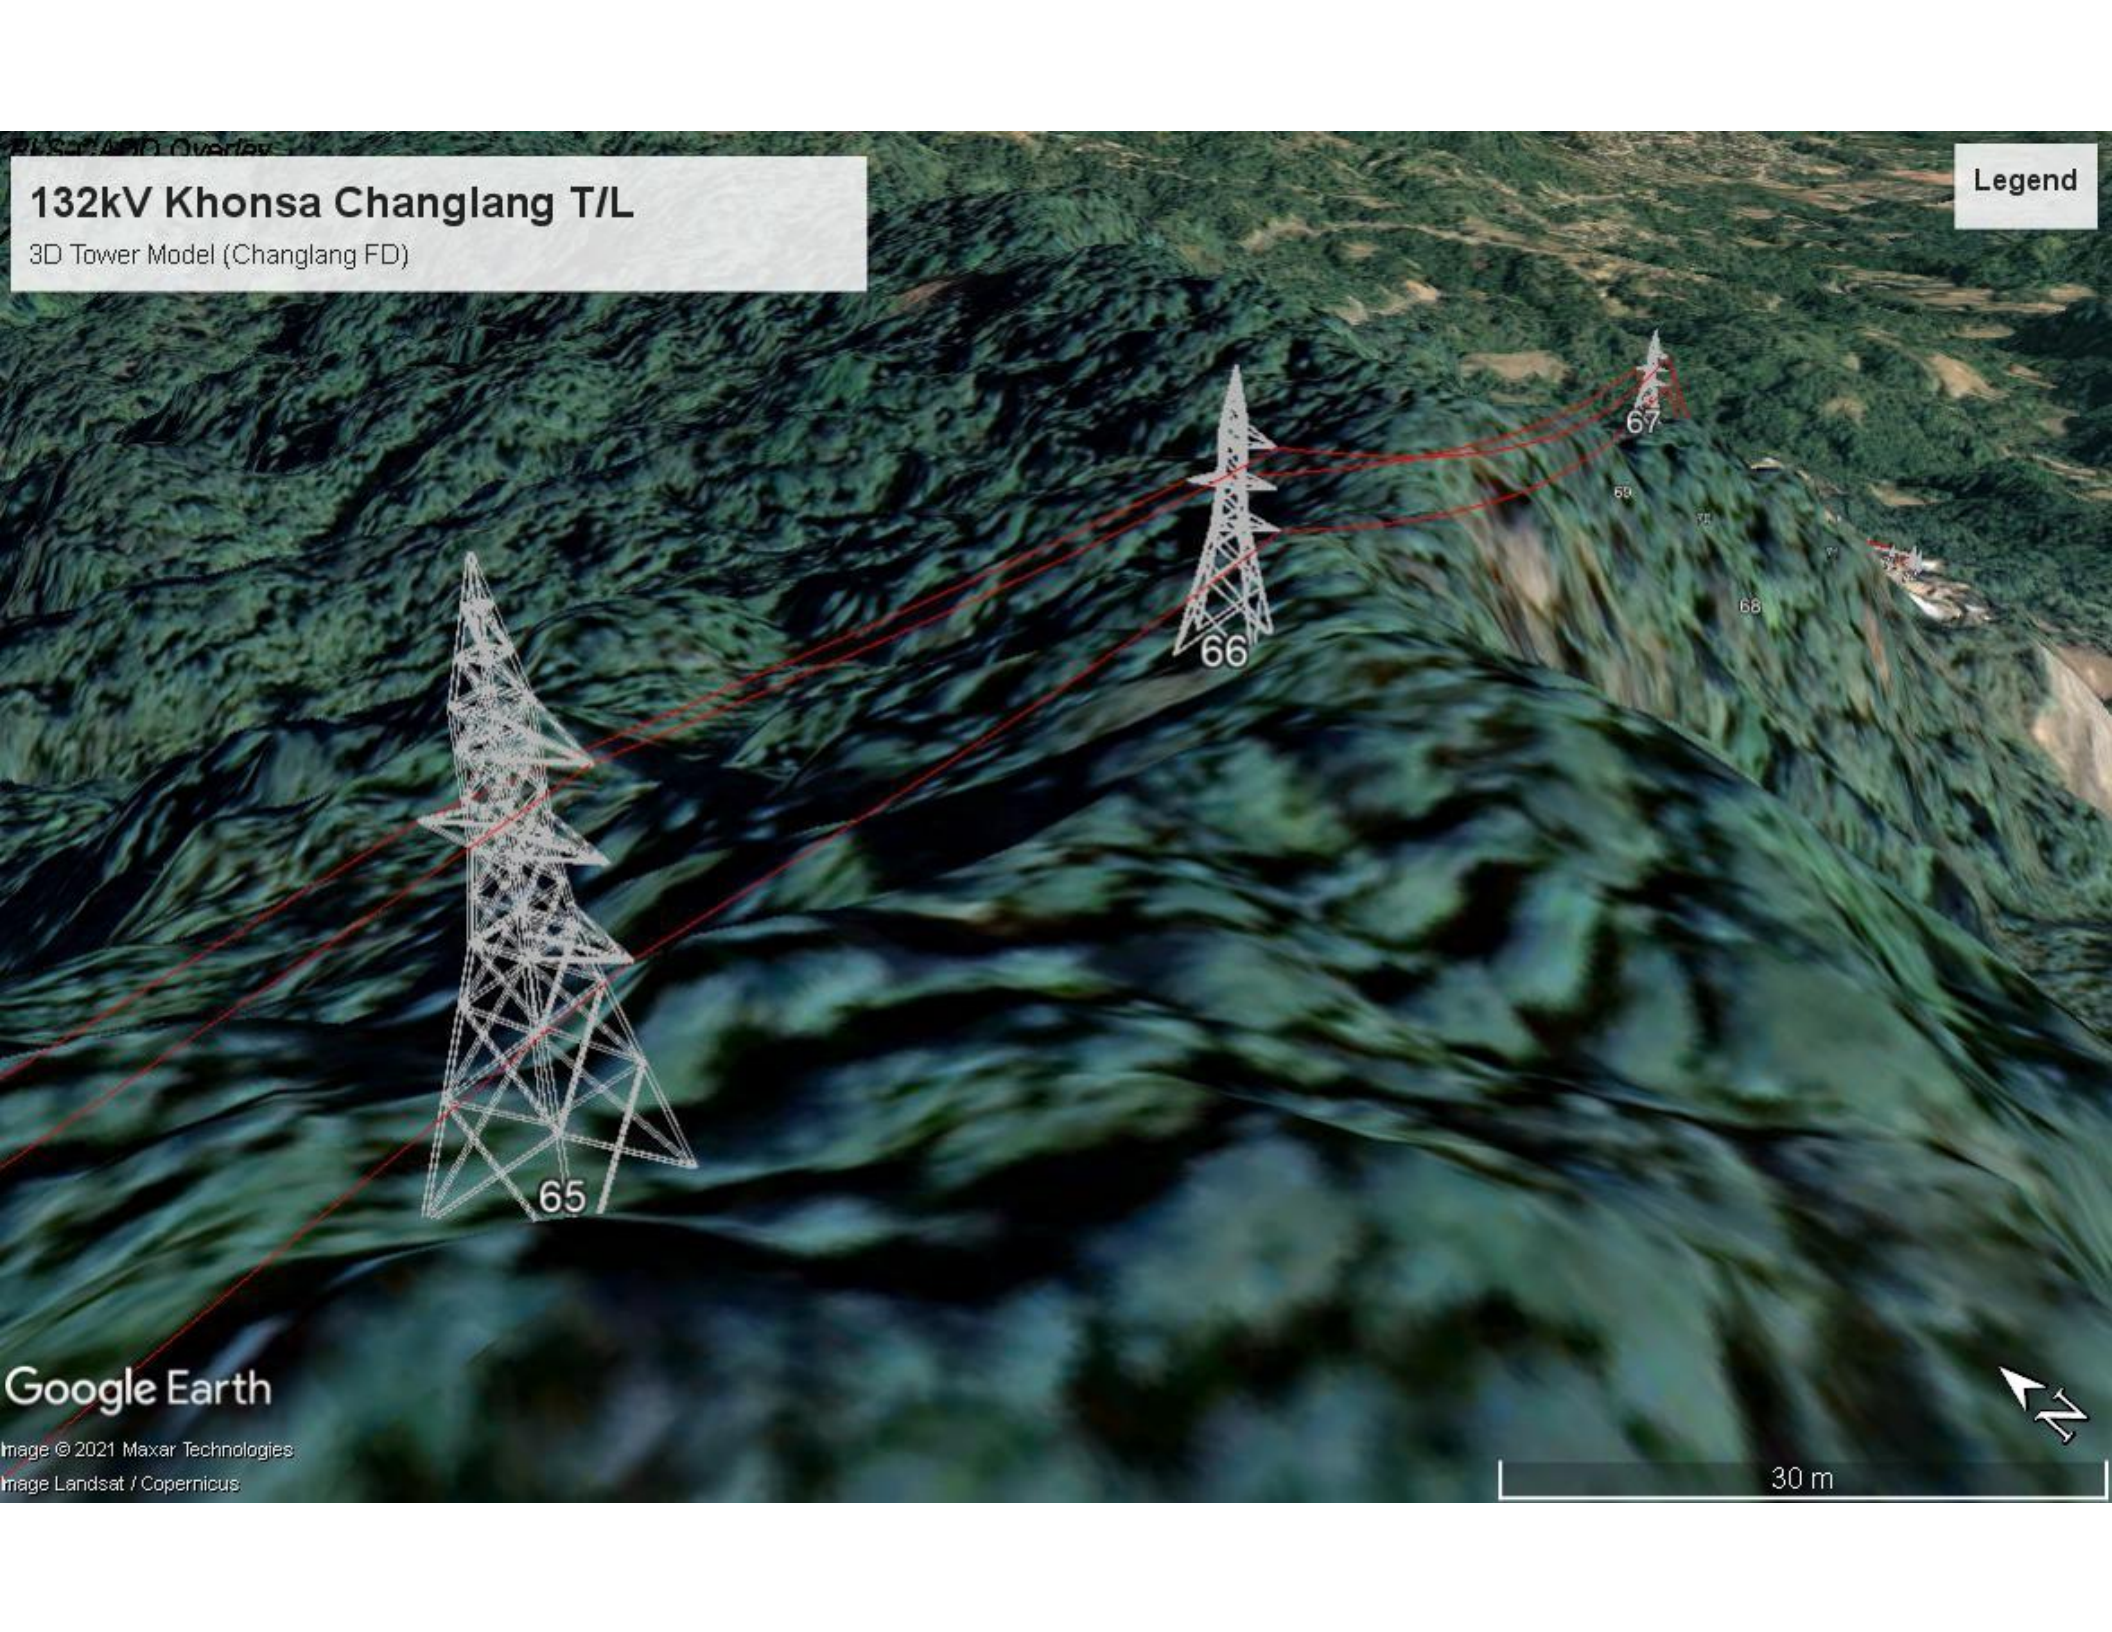


3D CADD Overlay

Legend


132kV Khonsa Changlang T/L

3D Tower Model (Changlang FD)

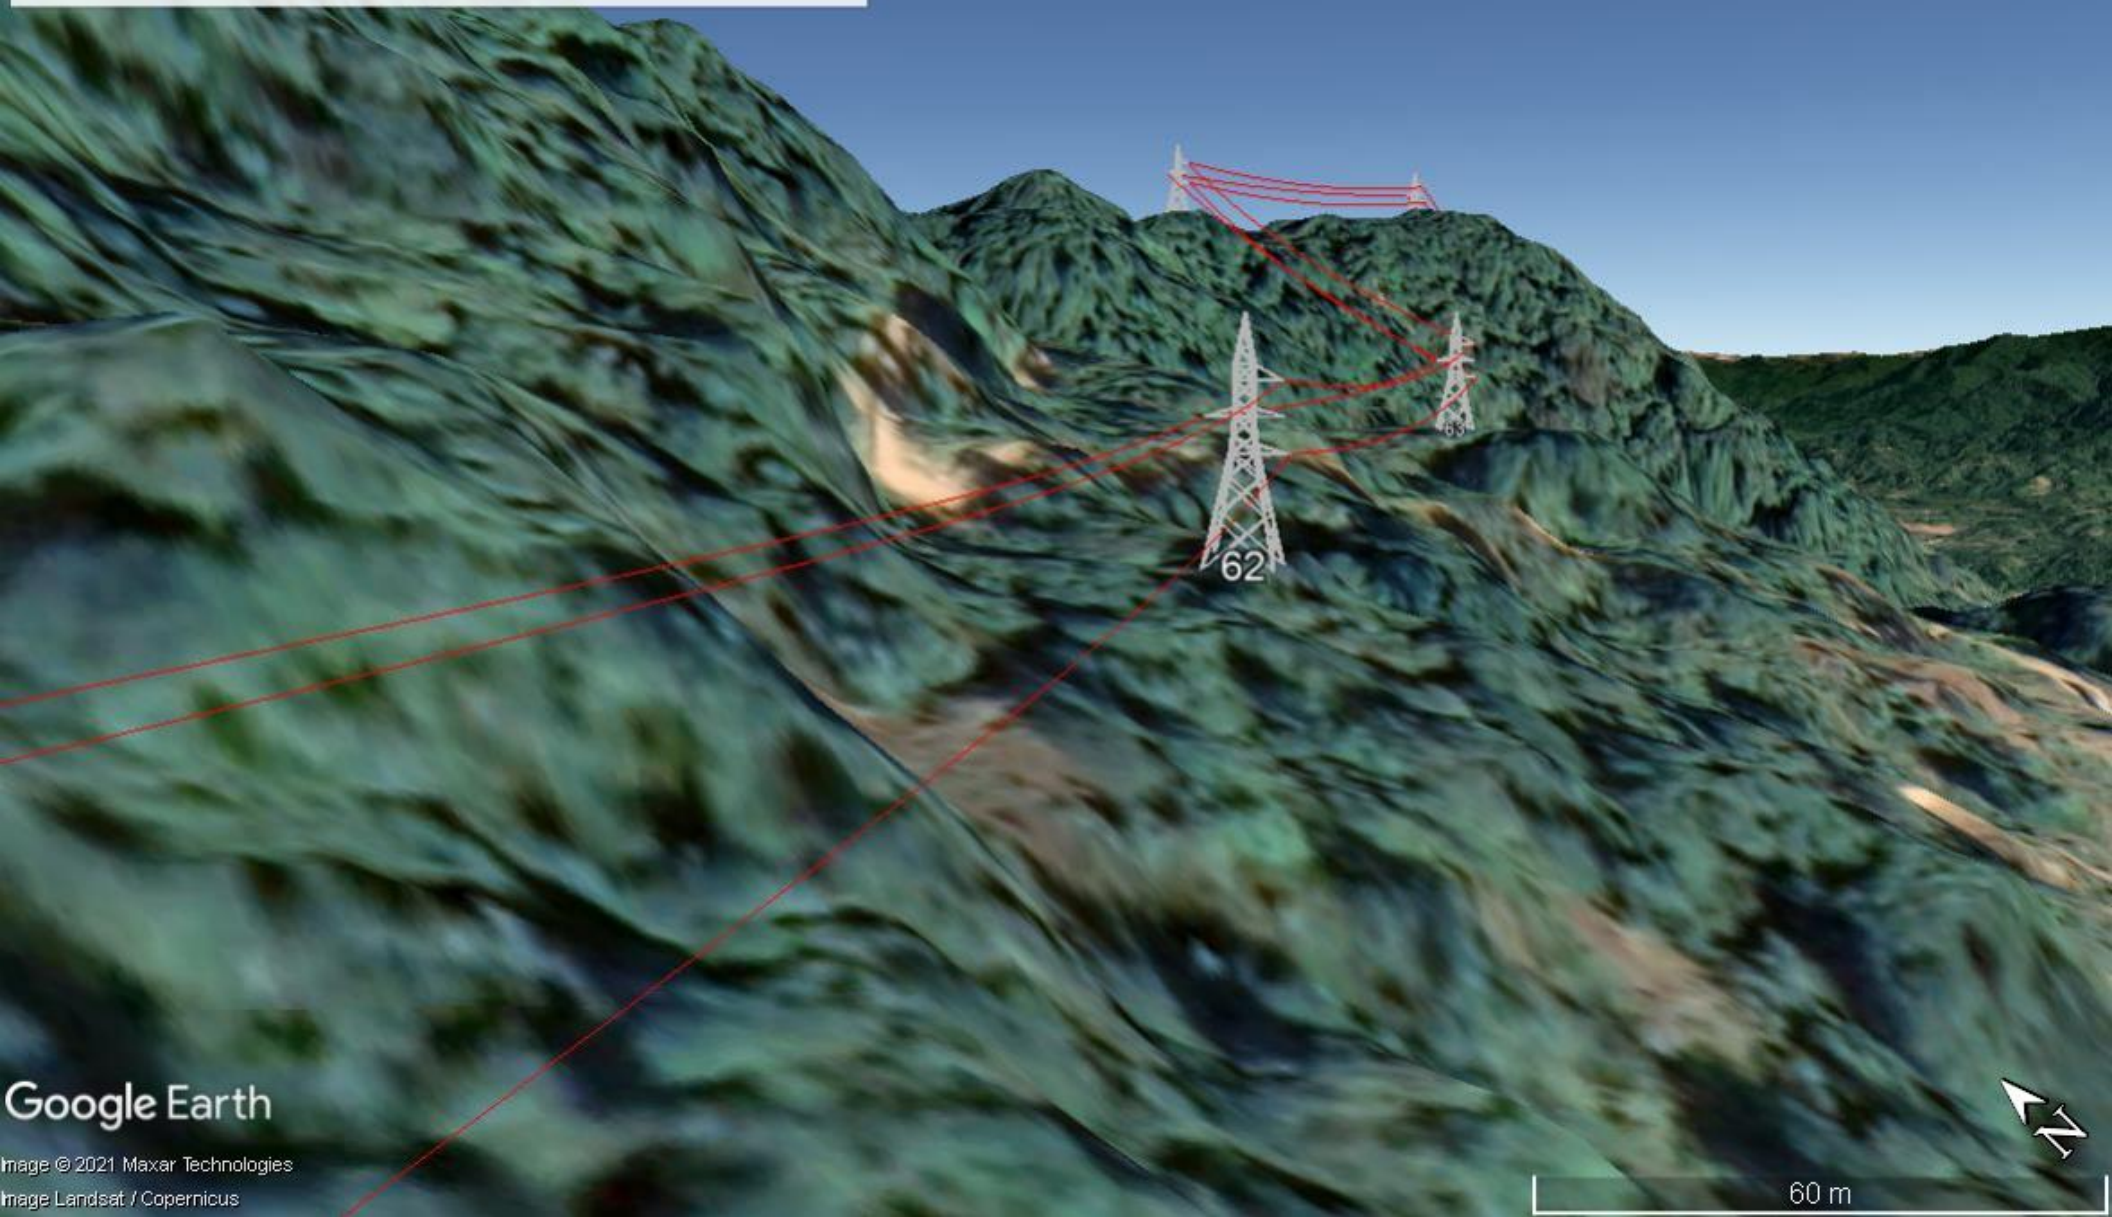

Google Earth

Image © 2021 Maxar Technologies
Image Landsat / Copernicus

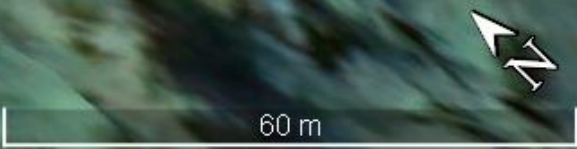

PLS-CADD Overlay

Legend

132kV Khonsa Changlang T/L

3D Tower Model (Changlang FD)

