



Dhikauli Pumping Water Supply Scheme

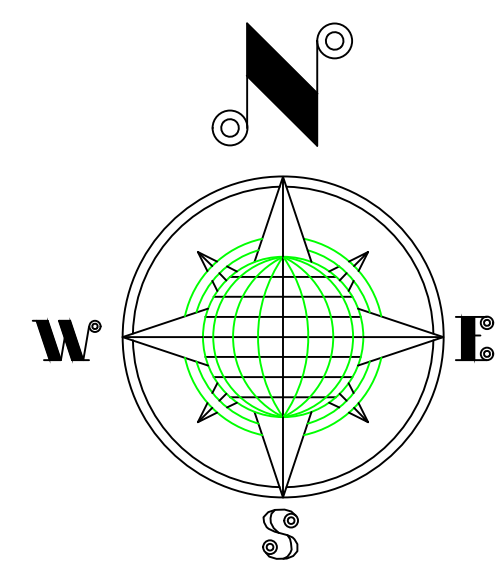

Pipe Abstract of Distribution System for Dhikuli Pumping Water Supply Scheme												
Zone	GI Pipe										DI K7 Pipe	
	20mm	25mm	32mm	40mm	50mm	65mm	80mm	100mm	125mm	150mm	200mm	250mm
Length	3012	1196	1945	386	413	320	0	1091	820	2343	0	0
Total	3012	1196	1945	386	413	320	0	1091	820	2343	0	0
%	26.1%	10.4%	16.9%	3.3%	3.6%	2.8%	0.0%	9.5%	7.1%	20.3%	0.0%	0.0%

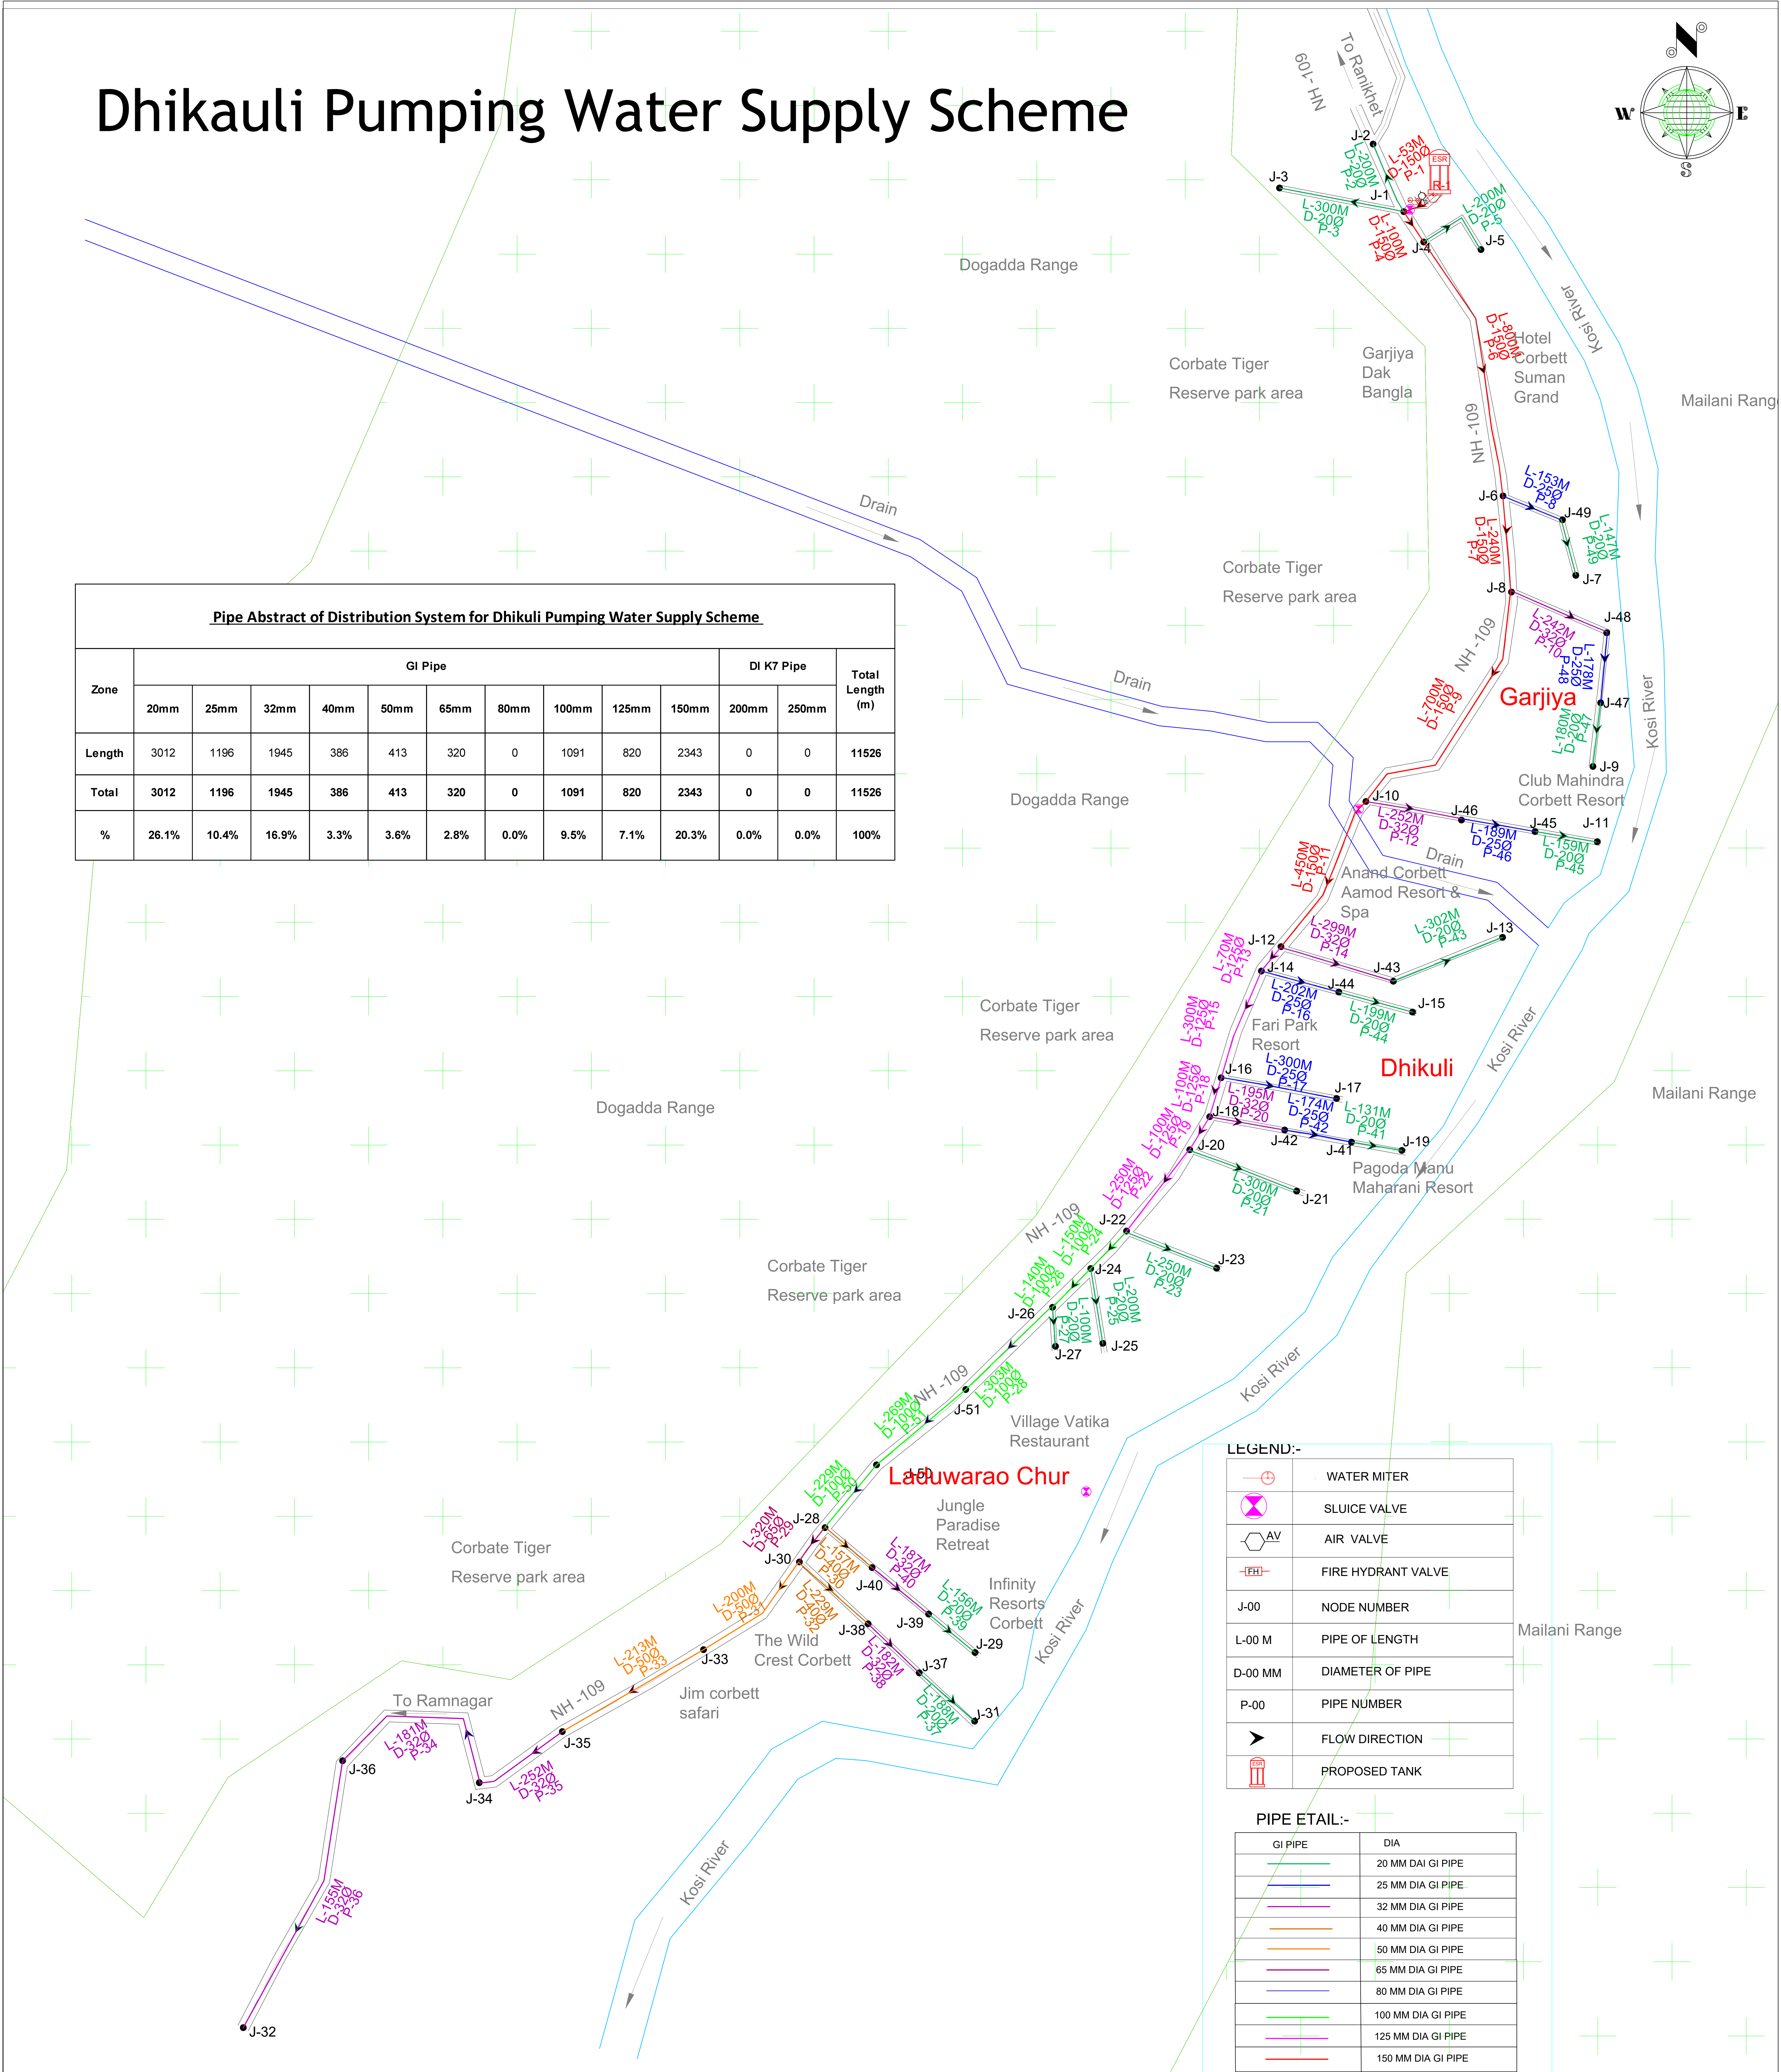

LEGEND:-	
	WATER MITER
	SLUICE VALVE
	AIR VALVE
	FIRE HYDRANT VALVE
J-00	NODE NUMBER
L-00 M	PIPE OF LENGTH
D-00 MM	DIAMETER OF PIPE
P-00	PIPE NUMBER
	FLOW DIRECTION
	PROPOSED TANK

PIPE ETAIL:-	
GI PIPE	DIA
	20 MM DIA GI PIPE
	25 MM DIA GI PIPE
	32 MM DIA GI PIPE
	40 MM DIA GI PIPE
	50 MM DIA GI PIPE
	65 MM DIA GI PIPE
	80 MM DIA GI PIPE
	100 MM DIA GI PIPE
	125 MM DIA GI PIPE
	150 MM DIA GI PIPE

CLIENT
UTTRAKHAND PEY JAL SANSADHAN
VIKAS EVAM NIRMAN NIGAM RAMNAGAR

PROJECT
Dhikuli Pumping Water
Supply Scheme

DWG NO. : 01 Feb- 2021
SCALE: N.T.S
DRN BY : PRAVEEN KUMAR

DRAWING NAME
Dhikauli Pumping
Water Supply Scheme

Submitted by (Computer)	Survey Checked by (A.A.E.)	Dwg. & Design Checked by (A.E.)
Recommended by (E.E.)	Approved by (S.E.)	

CONSULTANT :-

WSD Consultant Pvt. Ltd
Flat No. 103, Block no.-63, Brahmaputra Enclave,
Sector - 10, Siddharth Vihar, Ghaziabad - 201009
Contact No. +91 8596010400
Email ID: info@wdsconsultant.com
Website: www.wdsconsultant.com