


UTILISING THE EXISTING 230 KV TRANSMISSION
CORRIDOR (SINCE 1965) FROM PARALI PH 3 TO LOC.56 IN
NELLITHURAI RESERVED FOREST OF COIMBATORE DIVISION
FOR ERECTION OF 400 KV DC LINE ON DC TOWERS WITH HTLS

GPS COORDINATES
INDICATION SKETCH

LE - Left Exit
Li - Left Inner
Ri - Right Inner
RE - Right Exit

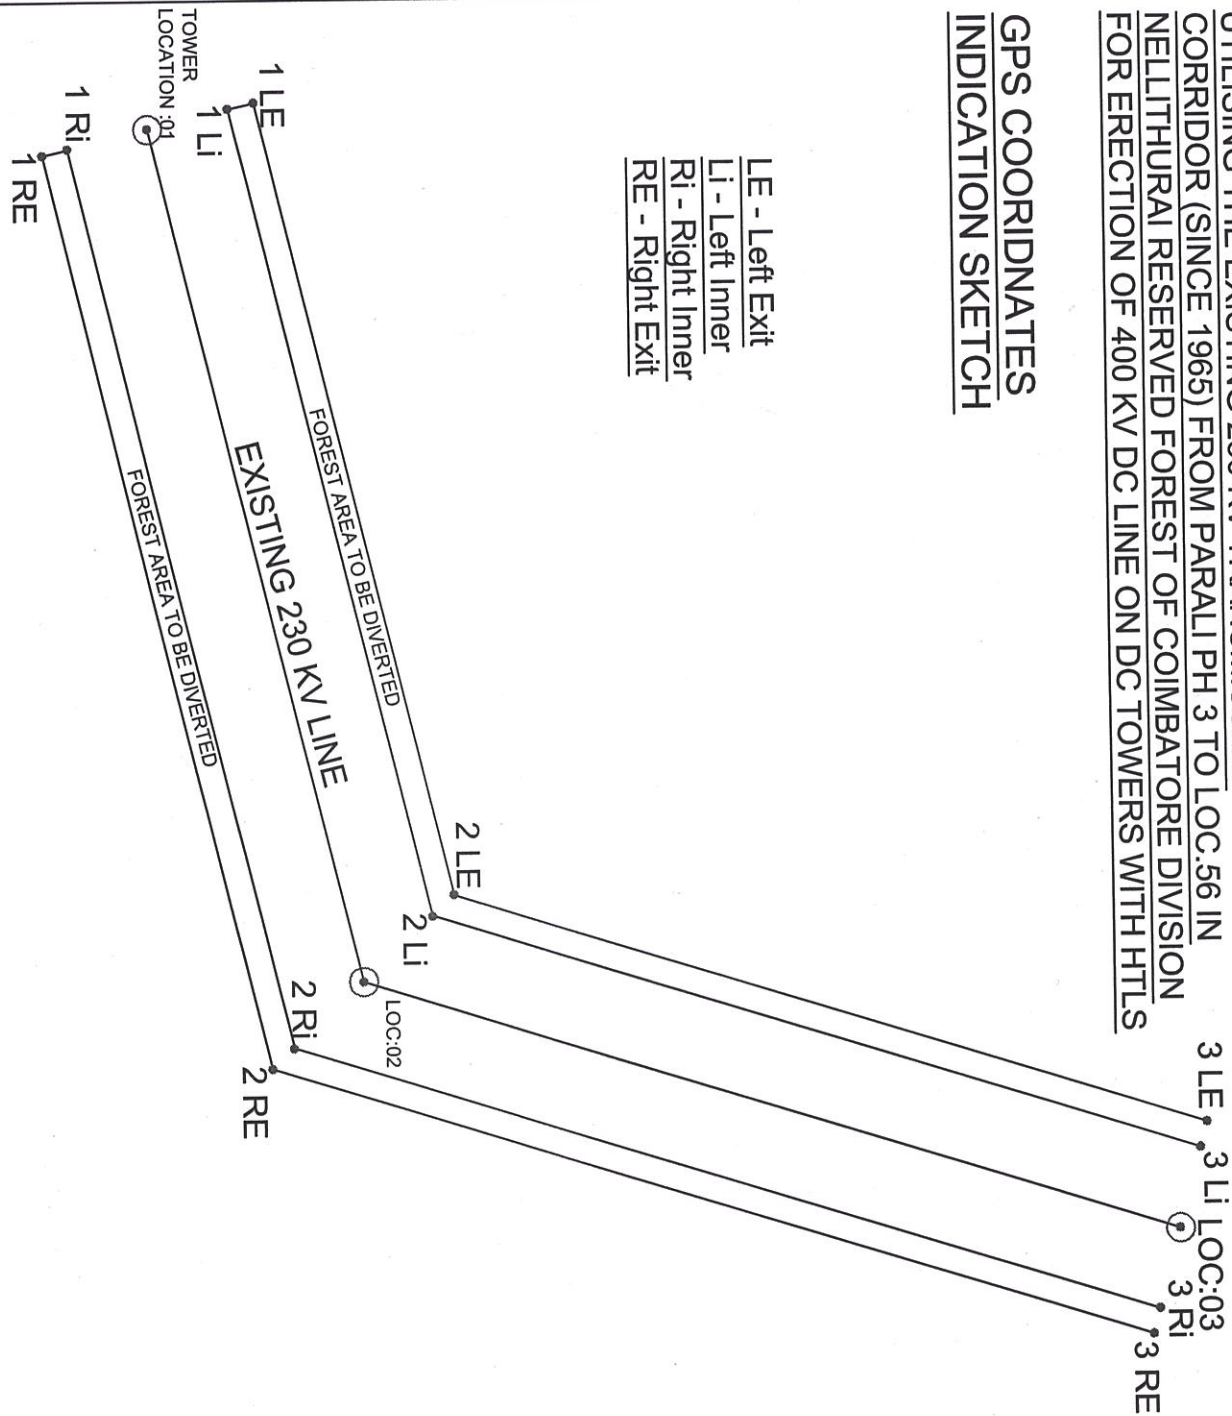

Dr. B. Anand
SE/GCC/CBE
5/7/13