


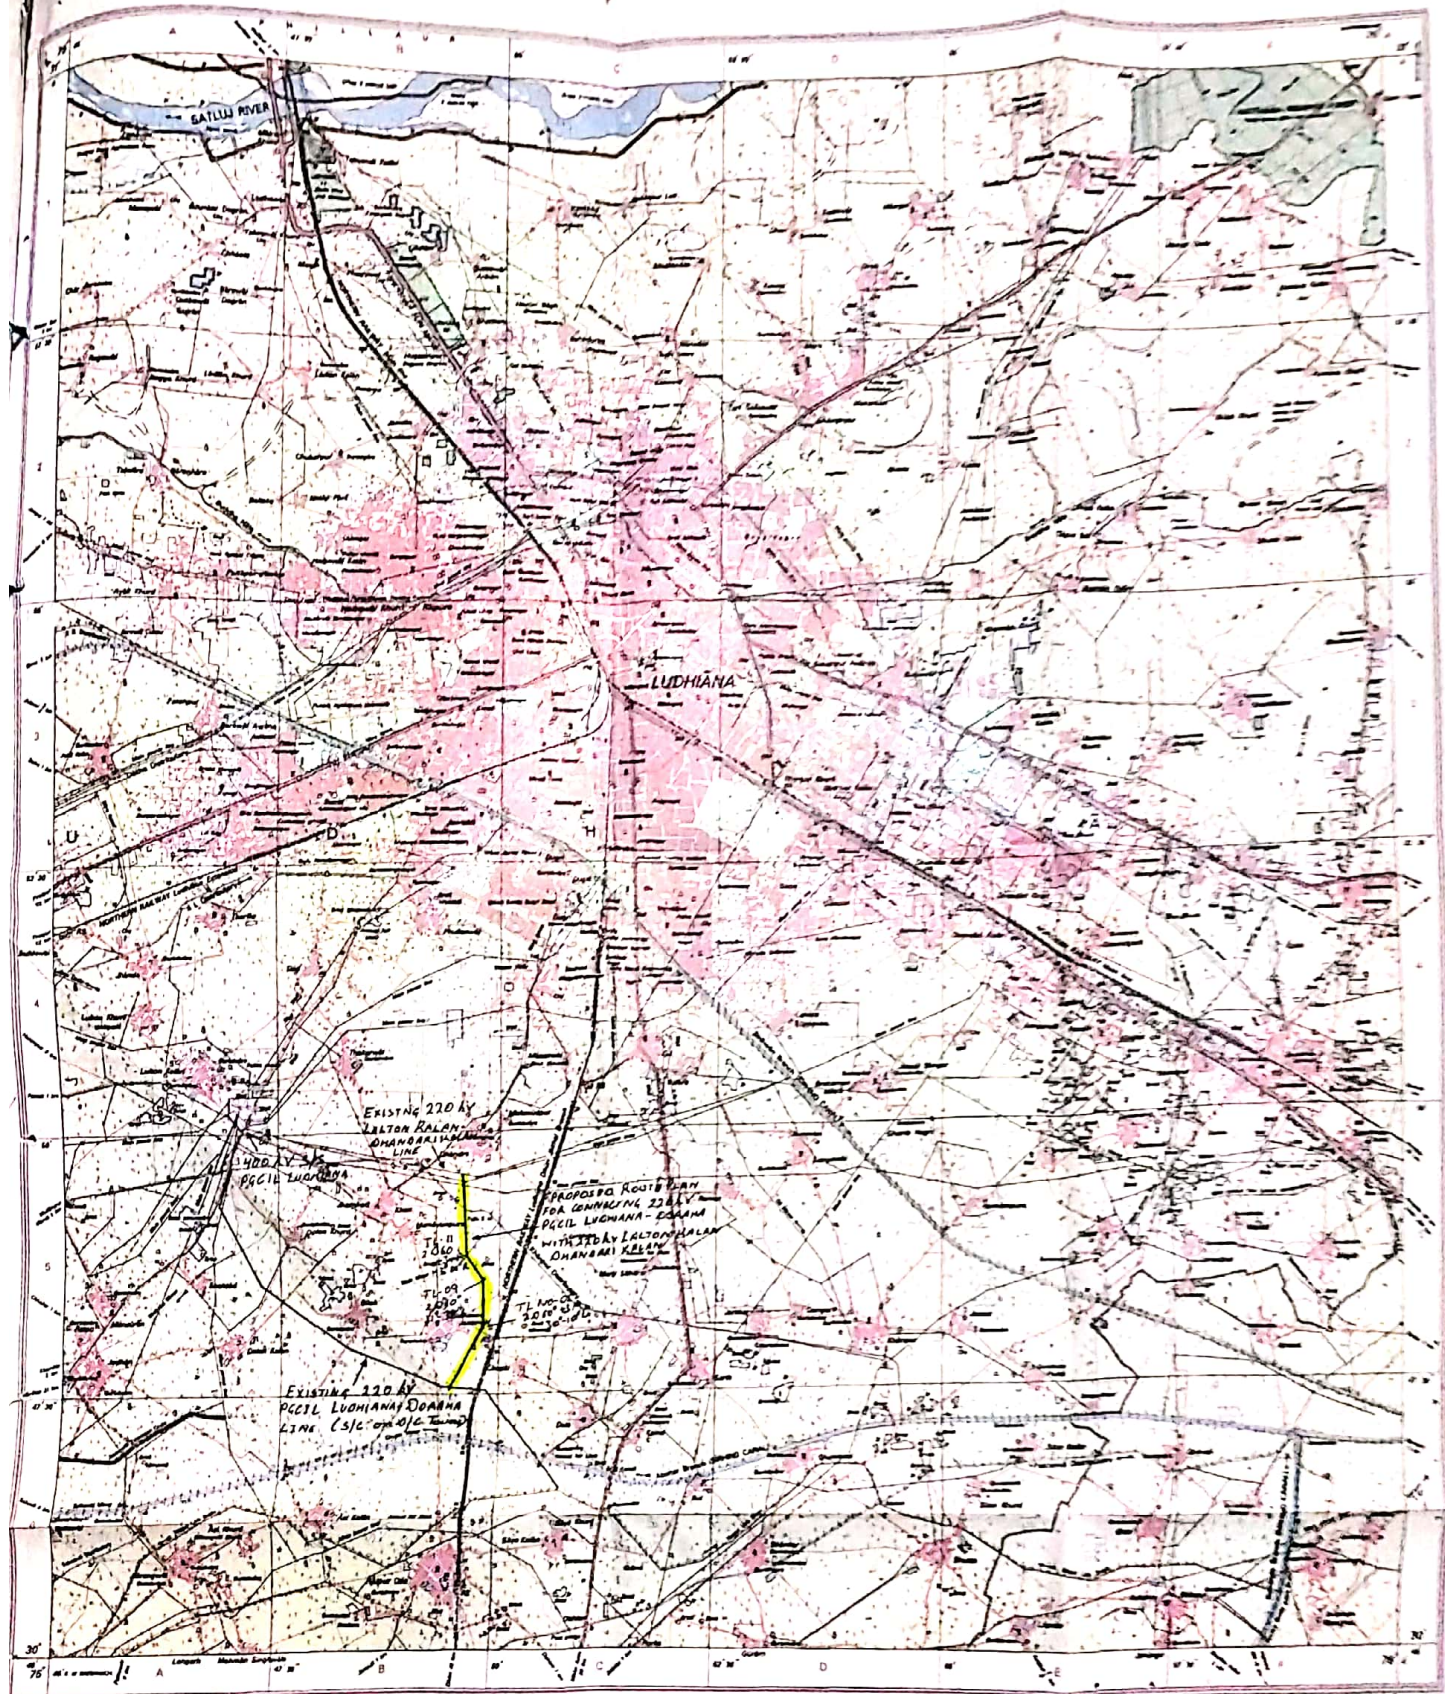

1. LENGTH OF LINE = 4.05 km
2. SIZE OF COND. = 0.45"
3. SIZE OF E/WIRE = 7/5.15 mm

PUNJAB STATE TRANSMISSION CORP. LTD.

### KEY PLAN

PROPOSED ROUTE PLAN FOR CONNECTING  
220 KV PCCSL LUDHIANA - DORRHO S/C ON  
O/C LINE WITH 220 KV LATHIAN KALAN  
- DHANSMI KALAN LINE.

|                |                 |                 |                              |                             |                            |                        |                        |                        |                        |
|----------------|-----------------|-----------------|------------------------------|-----------------------------|----------------------------|------------------------|------------------------|------------------------|------------------------|
| CHD TS PATHALA | ASR. TS PATHALA | ASR. TS PATHALA | CV LF TRAM<br>DESIGN PATHALA | BYCE TSC<br>CIRCUIT PATHALA | CHD TSC<br>CIRCUIT PATHALA | ALL<br>TIES CIV. WORKS | ALL<br>TIES CIV. WORKS | ALL<br>TIES CIV. WORKS | ALL<br>TIES CIV. WORKS |
|----------------|-----------------|-----------------|------------------------------|-----------------------------|----------------------------|------------------------|------------------------|------------------------|------------------------|

DR. S. S. SINGH  
Ludhiana District Engineer  
Ludhiana