DETAIL OF DISPENSER	
Sr.No.	TYPE OF DISPENSER
1	1 MPD MS/HSD
	1 MPD MS/HSD

DETAIL OF TANKS

No	PRODUCT	CAPACITY	DIA Ø	LENGTH	TYPE OF TANKS
1	MS	15KL	2.00Ø	5.00M	M-PIT
2	HSD	20KL	2.00Ø	6.75M	M-PIT

उत्तर देवरिया में निर्माण खण्ड, लोकनिर्माण, देवरिया के अन्तर्गत ग्राम सिरवारिया तहसील देवरिया जिला देवरिया में स्थित गाटा सं0 1034 में स्थित है भारत पेट्रोलियम कारपोरेशन लिमिटेड के नाम से देवरिया कस्बा मार्ग (एस0 एच0-79) के किलोमीटर सं0 16 में बाये

उक्त आउटलेट (पेट्रोल/डीजल) पम्प की स्थापना हेतु अनापत्ति प्रमाण-पत्र निम्नलिखित नियम शर्तों के साथ निर्गत किया जाता है-

शर्तें/नियमें

1- पेट्रोल पम्प का निर्माण प्रमुख सचिव, उत्तर प्रदेश शासन के शासनादेश 1812/23-12-19-1365/17 टी.सी. लोक निर्माण अनुपत्र-12 लखनऊ दिनांक 04.12.2019 द्वारा जारी "The Uttar Pradesh Guidlines for issuing of NOC for Setting up fuel Station along UPPWD Roads 2019" में दिए गए निर्देशों एवं केन्द्रीकृत की शर्तों के अनुसार किया जायेगा।
2- प्रस्तावित स्थल के दोनों ओर 300 मीटर तक कोई रोड क्रासिंग नहीं होनी चाहिये।
3- आई0आर0सी0-12, 2009 के अनुसार मार्ग पर 300 मी0 की दूरी तक कोई अन्य रिटेल आउटलेट स्थापित नहीं होना चाहिए।
4- प्रस्तावित रिटेल आउटलेट का निर्माण मार्ग की स्थायी भूमि के बाहर होगा तथा निर्माण सामग्री इस सीमा में न रखी जाय। प्रस्तावित निर्माण में स्वच्छ विटप मार्ग की चक्र विज्ञा में 15.24 मीटर (50 फीट) छोड़कर होनी चाहिए। लोकनिर्माण की स्थायी भूमि पर कोई भी निर्माण एवं साईन बोर्ड लगाना अनुमन्य नहीं होगा।
5- प्रस्तावित आउटलेट का निर्माण कार्य मार्ग की स्थायी भूमि से बाहर होगा तथा निर्माण सामग्री इस सीमा में न रखी जाय। 0.23 THK. AND 1.20m HIGH BOUNDARY WALL
6- प्रस्तावित रिटेल आउटलेट के प्रवेश एवं निकास पर सड़क पर यातायात की विशिष्टिकरी होनी चाहिये, इसमें कोई अवरोध न हो।
7- यदि निर्माण स्थल की भूमि पर न्यायालय का कोई विवाद विचाराधीन हो तो ऐसी दशा में अनापत्ति प्रमाण पत्र स्वतः निरस्त समझा जायेगा।
8- भूमि के स्वामित्व का सम्पूर्ण उत्तरदायित्व से करा लिया जाय। इस सम्बन्ध में लोक निर्माण विभाग का कोई उत्तरदायित्व नहीं होगा।
9- प्रस्तावित रिटेल आउटलेट के पूर्वि मार्ग की प्रस्तावित रिटेल आउटलेट की ओर न्यूनतम 2 प्रतिशत होगा तथा पुस्तिका आई0आर0सी0 एस0सी0-12, 1983 के अनुसार निर्मित की जायेगी।
10- पेट्रोल उत्तर के आपत्तिजनक जलसाधित होने के कारण पर्यावरण/प्रदूषण विभाग के अधिनियमों एवं अर्थदण्डों की कार्यवाही का दायित्व स्वयं पम्प-मालिक की व्यक्तिगत सुरक्षा के मद्देनजर कड़ाई से अनुपालन सुनिश्चित किया जाए। इसका उत्तरदायित्व पम्प मालिक का होगा।

सहायक अभियन्ता
निर्माण खण्ड, लो0नि0वि0
देवरिया

अधिशासी अभियन्ता
निर्माण खण्ड, लो0नि0वि0
देवरिया

प्रभारी अधिकारी (भण्डार)
देवरिया

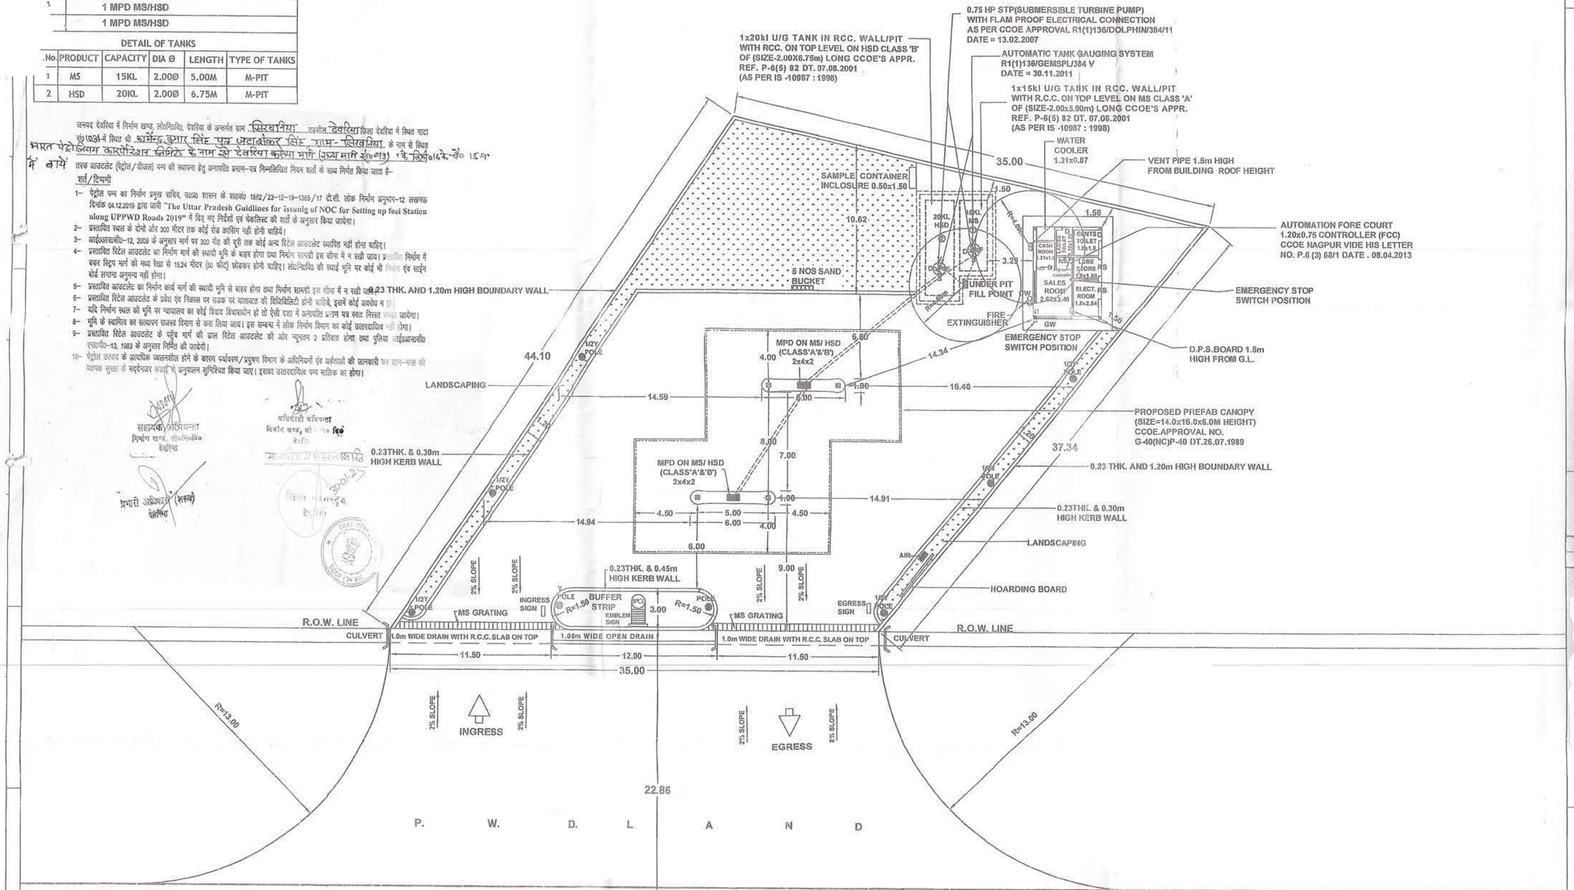

LAYOUT PLAN
Scale= 1:200
Dimension in Mts

LOCATION - VILLAGE - SIRWARIA
DISTT. - DEORIA (U.P.)

M/s

LICENCE NO.

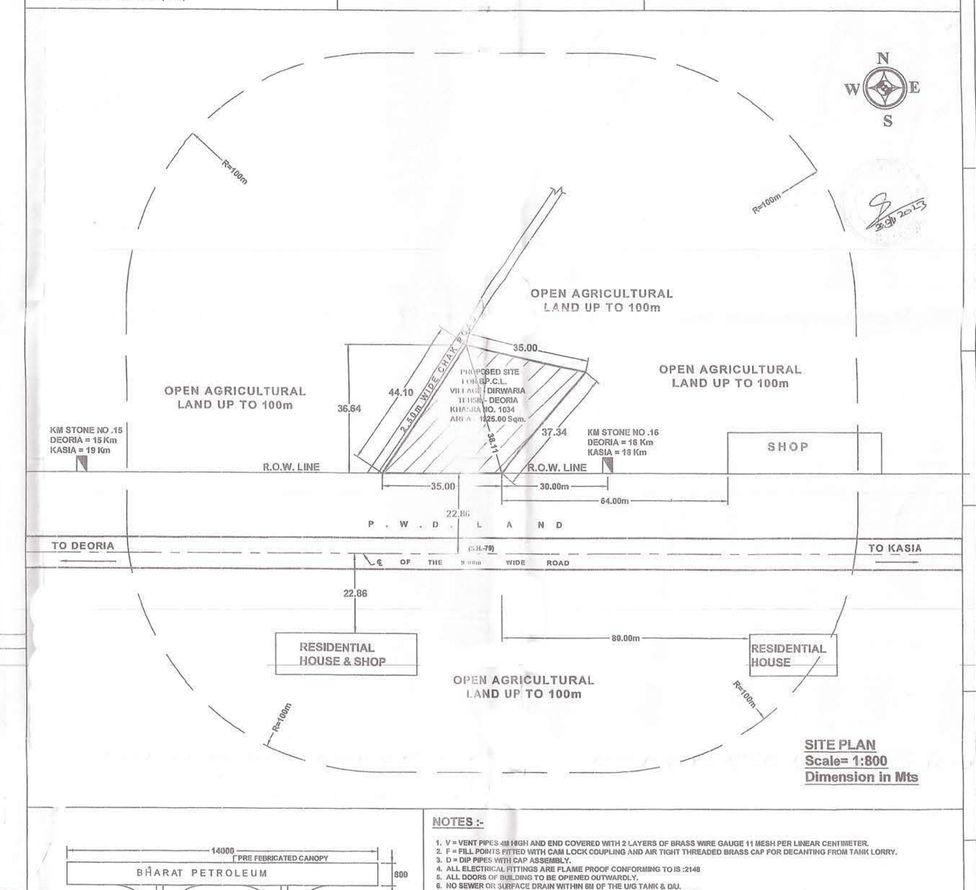

SITE PLAN
Scale= 1:800
Dimension in Mts

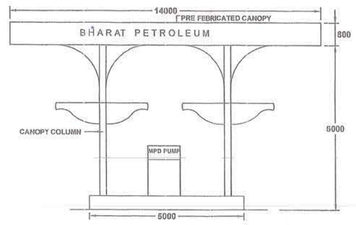

CANOPY SECTION
CCOE.APPROVAL NO.
G-40(NC)P-40 DT.26.07.1989

NOTES :-

1. V = VENT PIPES 4m HIGH AND END COVERED WITH 2 LAYERS OF BRASS WIRE GAUGE 11 MESH PER LINEAR CENTIMETER.
2. F = FILL POINTS FITTED WITH CAM LOCK COUPLING AND AIR TIGHT THREADED BRASS CAP FOR DECANTING FROM TANK LORRY.
3. D = DIP PIPES WITH CAP ASSEMBLY.
4. ALL ELECTRICAL FITTINGS ARE FLAME PROOF CONFORMING TO IS :2148
5. ALL DOORS OF BUILDING TO BE OPENED OUTWARDLY.
6. NO SEWER OR SURFACE DRAIN WITHIN 9M OF THE UIG TANK & D/U.
7. PREMISES TO BE USED FOR ONLY STORAGE OF PETROLEUM PRODUCTS.
8. TANKS ARE PAINTED WITH TWO LAYERS OF HOT BITUMEN OVER TWO COATS OF RED LEAD PRIMER TO PROTECT AGAINST CORROSION.
9. FABRICATION DESIGN OF UNDER GROUND STORAGE TANK ARE CONFORMING TO I.S.: 10987 : 1998 AS PER C.C.O.E. NAGPUR ORDER NO. G-40 (SC) P(WBC 94 DATED-24.02.99.
10. ALL DIMENSIONS ARE IN MTR. UNLESS OTHERWISE NOTED.
11. S.B. SAND BUCKET 10 NO'S OR AS PER EXPLOSIVE RULES.
12. F.E. FIRE EXTINGUISHER. 10 NO'S OR AS PER EXPLOSIVE RULES.
13. TANK SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING AS APPLIED. THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.35KG/SQ.CM. FOR 2 HOURS.
14. DIP ROD SUPPLIED WITH THE TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3280 LONG INSTEAD OF STANDARD 2350MM.
15. FEBRICATION THICKNESS OF SHELL PLATES AND END PLATE OF TANKS:
    20KL-SHELL-6MM
    END - 6MM
16. TANKS CONFORMS TO 124.125 & 131 OF THE PETROLEUM RULE-2002
17. ALL LIGHT POLES ARE FITTED AS PER APPROVAL OF CCE NAGPUR VIDE LETTER NO. PL-III(MBI) DATED:26.11.1953.
18. NATURAL DOWNSLOPE FROM THE EDGE OF MEDALLED ROAD TO CULVERT ON APPROACHES WILL BE MAINTAINED FREE FLOW OF WATER TOWARDS DRAIN.
19. SITE MEETS APPLICABLE IRC.1983 NORMS WITH LATEST AMENDMENTS.
20. EV - EXTENDED VENT POINT
    E = EXTENDED FILL POINTS.
21. THE PROPOSED SITE IS FREE FROM ANY TYPE OF LITIGATION AND NO CASE IS PENDING IN ANY COURT OF LAW.
22. NO ELECTRICAL LINE PASSES OVER THE RO PREMISES .
23. PROPOSED AND EXISTING WORK SHOWN IN SPECIFIC COLOUR

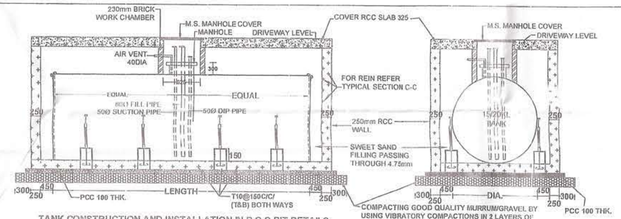

TANK CONSTRUCTION AND INSTALLATION IN R.C.C PIT DETAILS
ALL DIMENSIONS IN MM



FRONT ELEVATION
SCALE - NTS



SECTION FOR R.C.C. CULVERT
Scale - NTS, Dimension are in mm

SITE INFORMATION	
PLOT AREA	1225.00 Sqmt.
KHASRA NO.	1034
LOCATION	SIRWARIA
PARGANA	SHAHJHAPUR
TEHSIL	DEORIA
POST OFFICE	KANCANPUR
POLICE STATION	TARIKULWA
RAILWAY STATION	DEORIA
DISTRICT	DEORIA
STATE	UTTAR PRADESH
PIN CODE	274 404
NEAR KM STONE NO.	16
ROAD NO.	S.H.-79

REVISION DRG. NO.	DATE	ZONE OR PART	BRIEF RECORD	INITIALS
REVISIONS				

भारत पेट्रोलियम कॉर्पोरेशन लिमिटेड
BHARAT PETROLEUM CORPORATION LTD.
(MARKETING - DIVISION)

Subject-: Layout Plan of a Retail Outlet

On Deoria - Kasia Road ,At -Village - Sirwaria,
Tehsil - Deoria ,District - Deoria (U.P.)Near Km Stone No. 16 (S.H. - 79)

Distt.- Deoria (U.P.) | At.- Village - Sirwaria

DATE– 23.05.2022 | ENGINEER IN CHARGE | TERRITORY MANAGER
SCALE 1 : 200
DRAWN Arvind Kumar | TRACED | CHECKED

23.05.22 | BPCL/D16/2022
DATE | DRAWING NO.
NUMBERS CROSSED OUT ARE SUPERSEDED DRAWING NO.
BPCL/D16/2022
DRAWING NO.

क्षेत्रीय अधिकारी
देवरिया रेंज

R. Jagdeesh
(जगदीश आर)
प्रभागीय निदेशक
सामाजिक वानिकी प्रभाग
देवरिया

RAJESH
Territory Manager (Retail)
Bharat Petroleum Corporation Ltd
Bahraich, Deoria (U.P.)

R. Jagdeesh
(जगदीश आर)
प्रभागीय निदेशक
सामाजिक वानिकी प्रभाग
देवरिया

75