


SURVEY REPORT OF RESTORED ROAD WAY 76.
 PASSAGE THROUGH PRINCE GEORGE NATIONAL FOREST
 HILLS OF TILES ROAD, NEW ABERNETHY

POINTS	HIGH TILES	DEGREE
FROM TO	16 HES	100.000 - 110.000
UTP 01-1P (Symptom)	21 HES	100.000 - 110.000
UTP Station 30m from A1-1	23 HES	70.000 - 100.000
A1-1	34 HES	100.000 - 110.000
A1-2	6 HES	100.000 - 110.000
A1-4	15 HES	70.000 - 100.000
A1-13	8 HES	100.000 - 110.000
A1-14	2, 2 HES	100.000 - 110.000
A1-12	4 HES	100.000 - 110.000
A1-10	15 HES	100.000 - 110.000
A1-11	1 HES	100.000 - 110.000
A1-1	1 HES	100.000 - 110.000
UTP STATION	1 HES	100.000 - 110.000

For Details See...
 Local Engineer's Office
 Major Development Authority
 14/10/76

UTP Station 30m from A1-1

Local Engineer's Office
 Major Development Authority
 14/10/76

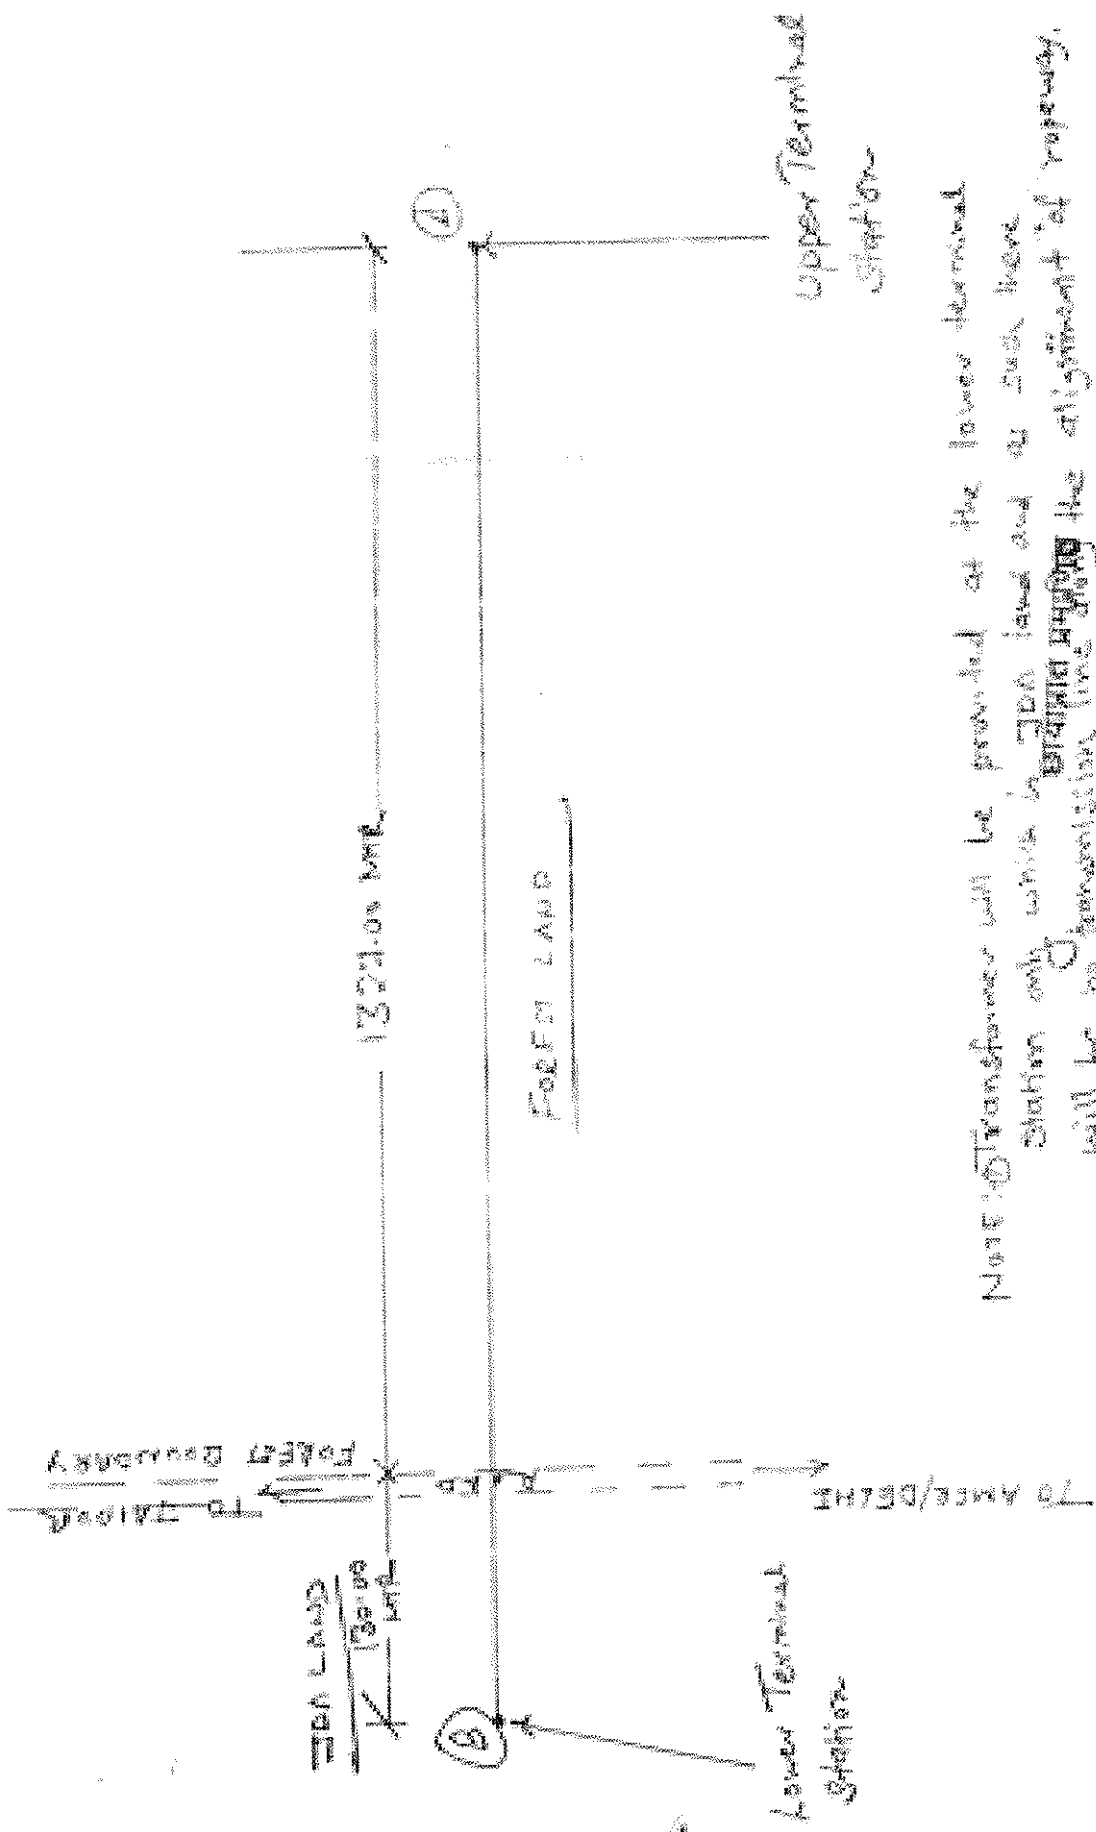

Note: Transformer will be provided at the lower terminal station only which will be 700 feet and is such there will be no transmission line along the alignment of roadway.

② At upper terminal station, for general lighting purpose, illumination will be taken from SWNL from the existing 1.7. line.

Approved: [Signature]
 Engineer (P) [Signature]
 Approved: [Signature]
 Engineer (P) [Signature]