
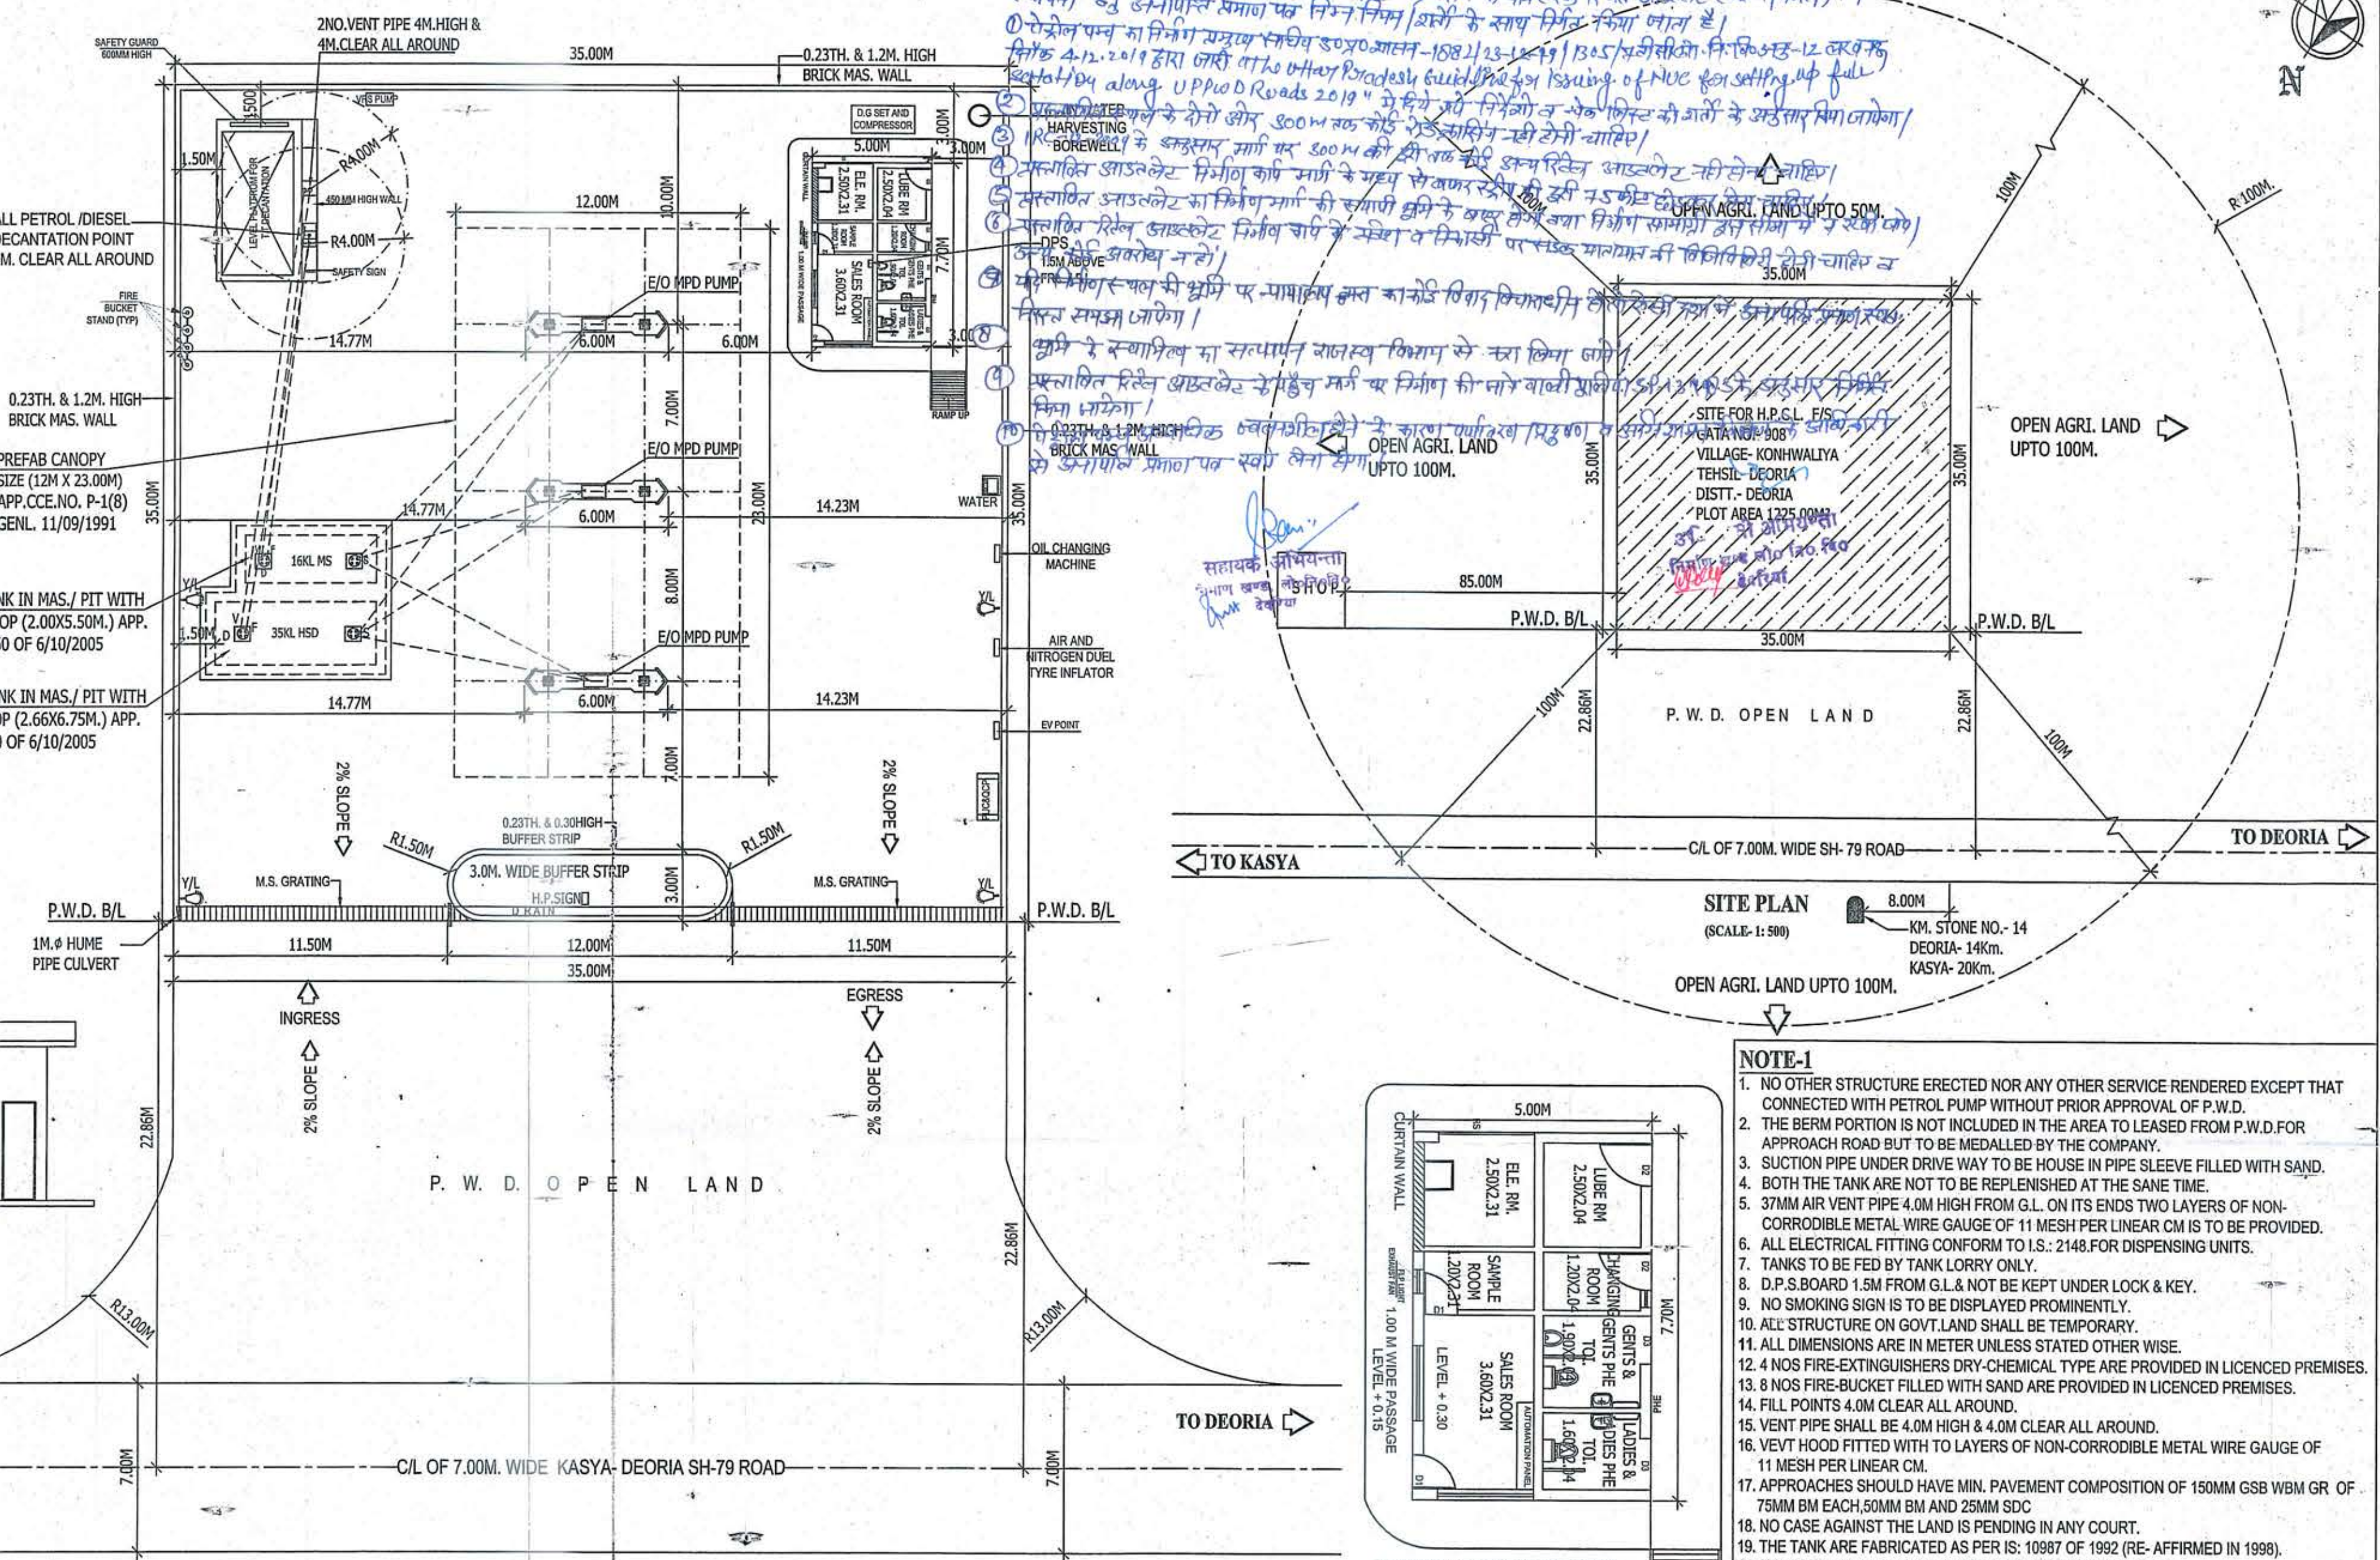
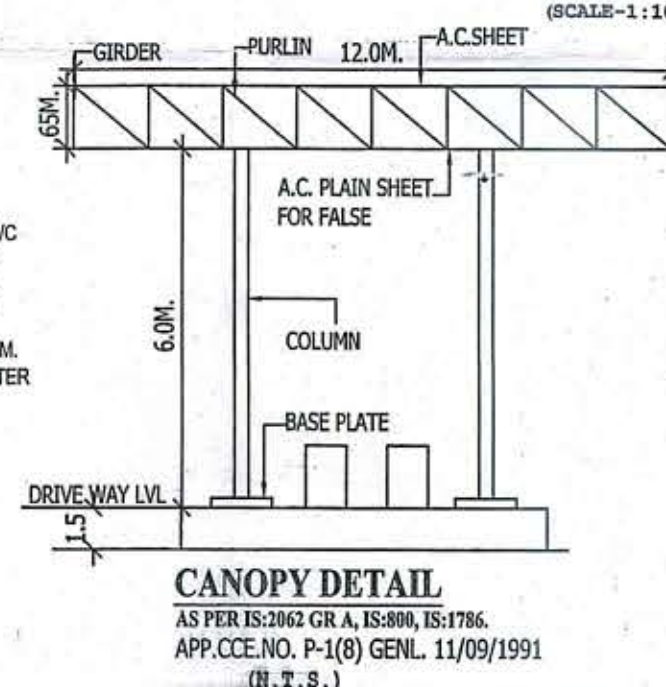
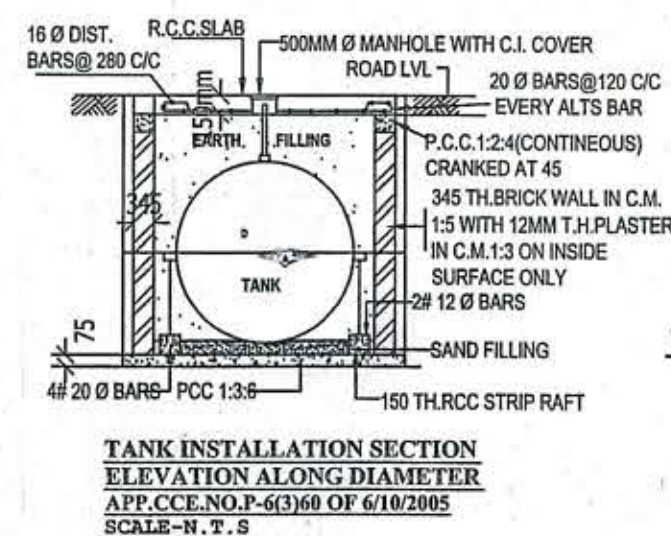
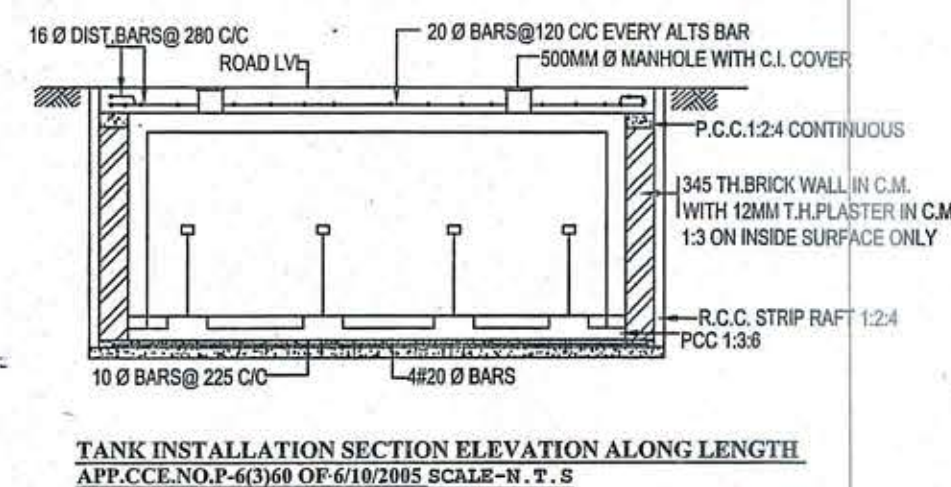


GROUND FLOOR (5.00X 7.77M)	
TYPE	SIZE IN mm
DEALER ROOM	3600X2310
SAMPLE ROOM	1200X2310
ELEC.ROOM	2500X2310
LUBE ROOM	2500X2040
CHANGING ROOM	1200X2040
LADIES AND LADIES PHE TOILET	1600X2040
GENTS AND GENTS PHE TOILET	1900X2040

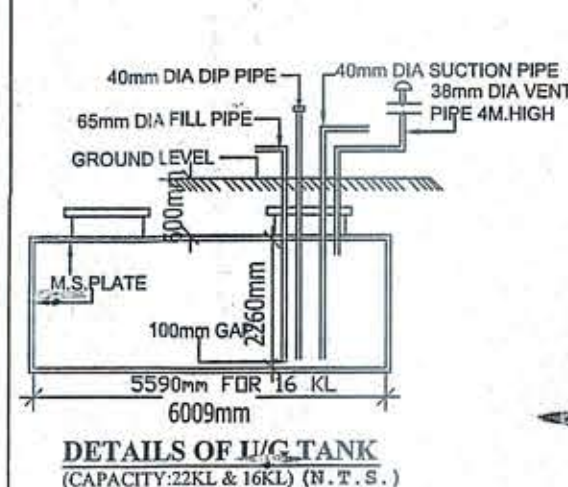

- ### NOTE-1
1. NO OTHER STRUCTURE ERECTED NOR ANY OTHER SERVICE RENDERED EXCEPT THAT CONNECTED WITH PETROL PUMP WITHOUT PRIOR APPROVAL OF P.W.D.
 2. THE BERM PORTION IS NOT INCLUDED IN THE AREA TO LEASED FROM P.W.D FOR APPROACH ROAD BUT TO BE MEDALLED BY THE COMPANY.
 3. SUCTION PIPE UNDER DRIVE WAY TO BE HOUSE IN PIPE SLEEVE FILLED WITH SAND.
 4. BOTH THE TANK ARE NOT TO BE REPLENISHED AT THE SAME TIME.
 5. 37MM AIR VENT PIPE 4.0M HIGH FROM G.L. ON ITS ENDS TWO LAYERS OF NON-CORRODIBLE METAL WIRE GAUGE OF 11 MESH PER LINEAR CM IS TO BE PROVIDED.
 6. ALL ELECTRICAL FITTING CONFORM TO I.S.: 2148.FOR DISPENSING UNITS.
 7. TANKS TO BE FED BY TANK LORRY ONLY.
 8. D.P.S.BOARD 1.5M FROM G.L.& NOT BE KEPT UNDER LOCK & KEY.
 9. NO SMOKING SIGN IS TO BE DISPLAYED PROMINENTLY.
 10. ALL STRUCTURE ON GOVT.LAND SHALL BE TEMPORARY.
 11. ALL DIMENSIONS ARE IN METER UNLESS STATED OTHER WISE.
 12. 4 NOS FIRE-EXTINGUISHERS DRY-CHEMICAL TYPE ARE PROVIDED IN LICENCED PREMISES.
 13. 8 NOS FIRE-BUCKET FILLED WITH SAND ARE PROVIDED IN LICENCED PREMISES.
 14. FILL POINTS 4.0M CLEAR ALL AROUND.
 15. VENT PIPE SHALL BE 4.0M HIGH & 4.0M CLEAR ALL AROUND.
 16. VEVV HOOD FITTED WITH TO LAYERS OF NON-CORRODIBLE METAL WIRE GAUGE OF 11 MESH PER LINEAR CM.
 17. APPROACHES SHOULD HAVE MIN. PAVEMENT COMPOSITION OF 150MM GSB WBM GR OF 75MM BM EACH,50MM BM AND 25MM SDC
 18. NO CASE AGAINST THE LAND IS PENDING IN ANY COURT.
 19. THE TANK ARE FABRICATED AS PER IS: 10987 OF 1992 (RE- AFFIRMED IN 1998).
 20. NO HIGH TENSION LINE IS PASSING THROUGH THE PREMISES.
 21. TANKS KERB WALL 0.25M.THICK & 0.30M. HIGH FROM FLOOR LEVEL PROVIDED TO THE EARTH BURIED.
 22. FLAMMABLE FLEX BOARD HOARDING SHOULD NOT BE USED.

	HINDUSTAN PETROLEUM CORPORATION LTD.		
PRASHANT TOWERS (GROUND FLOOR), MAHEWA CHUNGI, TRANSPORT NAGAR, GORAKHPUR- 273016			
PROPOSED LAY-OUT PLAN OF FILLING STATION AT GATA NO.- 908 VILLAGE- KONHWALIYA PARGANA- SHAHJAHANPUR, TEHSIL- DEORIA ON KASYA-DEORIA SH- 79 ROAD DISTT.- DEORIA U.P.			
SCALE: AS SHOWN	CHECKED/ APPROVED BY:-	DRG.NO. HPC/GKP/2019/ 038	L.NO. A/P/CC/UP/14/
DRAWN BY:- Design Consultants INDIRA NAGAR, LUCKNOW	 Ashish Kumar Sharma Duly Constituted Attorney Hindustan Petroleum Corporation Limited	 Sanjay Kumar DGM-P Gorakhpur Retail Region	DATE: 23/08/2019
			SERIAL NO.- 333
			REVISION: