PRODUCED BY AN AUTODESK EDUCATIONAL PRODUCT

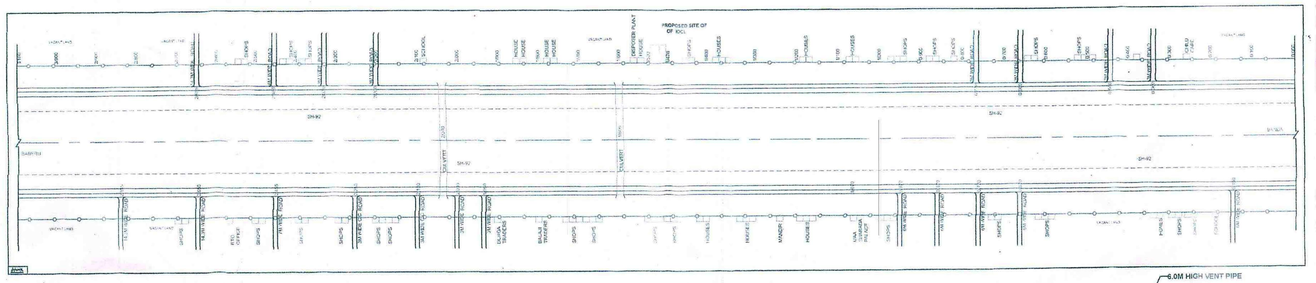

प्रस्तावित रिटेल आउटलेट का निर्माण-पूर्व सीमा रेख मार्ग सैक्शन स्टेशन स्तर के अन्तर्गत बांदा-भवेल-कमासिन-रायपुर मार्ग (राज्य राजमार्ग) के कि.मी. 2 सेक्शन 1.470 के 1.200 के दाएं ओर मार्ग ले0 748 (क्षा0 0.08) सेक्टर कार्ड मीटर 9080 बिना मौसा पट्टी एवम बांदा-महोबा बांदा धनपुर बांदा में प्रस्तावित रिटेल आउटलेट (पेट्रोल एवं डीजल भण्डार) भाग की सड़क रेखा से 23.04 मीटर (75 फीट) की दूरी के बाद स्थापित किये जाने में विभाग को कोई आपत्ति नहीं है।

अधिशासी अभियन्ता
राष्ट्रीय राज्य मार्ग, लो0नि0वि0
बांदा

अधीक्षण अभियन्ता को भारतमाला योजना के अन्तर्गत कनेक्टिविटी प्रोजेक्ट के अधीन राष्ट्रीय राजमार्गों के विकास कार्यों के अधीन भूमि अधिग्रहण का कार्य प्रगति पर है।

विशेष कार्य अधिकारी
(बी0ओ0टी0) लो0नि0वि0
बांदा

प्रमाण-पत्र

प्रमाणित किया जाता है कि खण्ड के अंतर्गत बांदा-भवेल-कमासिन रायपुर मार्ग राज्य मार्ग संख्या-92 श्रेणी के जिलाये पेट्रोल एवं डीजल पम्प रिटेल आउटलेट निर्माण के लिए अनापत्ति प्रदान करने हेतु प्रकरण में संलग्न मानचित्र एवं समस्त संलग्न अभिलेख/Undertaking शासनादेश सं0. सा0-09/2019 /1882/23-12-19-1365/17 टी0सी0वि0 दिनांक 04.12.2019 में उल्लेखित गाइड लाइन के अनुसार लगाये गये हैं तथा उक्त मानचित्र एवं संलग्न अभिलेख/Undertaking उपरोक्त शासनादेश में वर्णित अभियान्त्री/कर्मी की पूर्ति करते हैं।

अधिशासी अभियन्ता
राष्ट्रीय राज्य मार्ग, लो0नि0वि0,
बांदा



PLAN OF SALES BUILDING

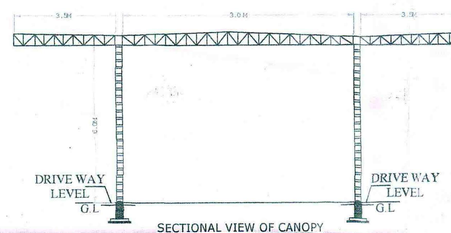

SECTIONAL VIEW OF CANOPY
SCALE :- 1:50

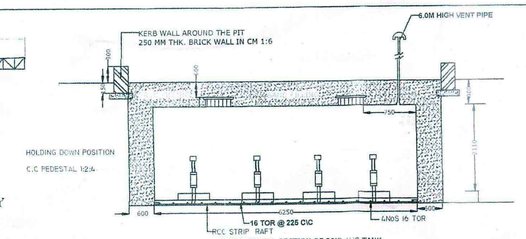

LONGITUDINAL SECTION OF 20KL U/G TANK
IN EARTH PIT (T1/T2)

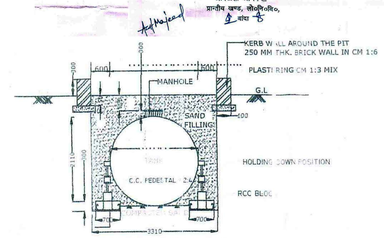

CROSS SECTION OF 20KL U/G TANK
IN EARTH PIT(T1/T2)
SCALE :-1:50



ELEVATION OF SALES BUILDING
SCALE :- 1:50

1.5M HIGH BOUNDARY WALL

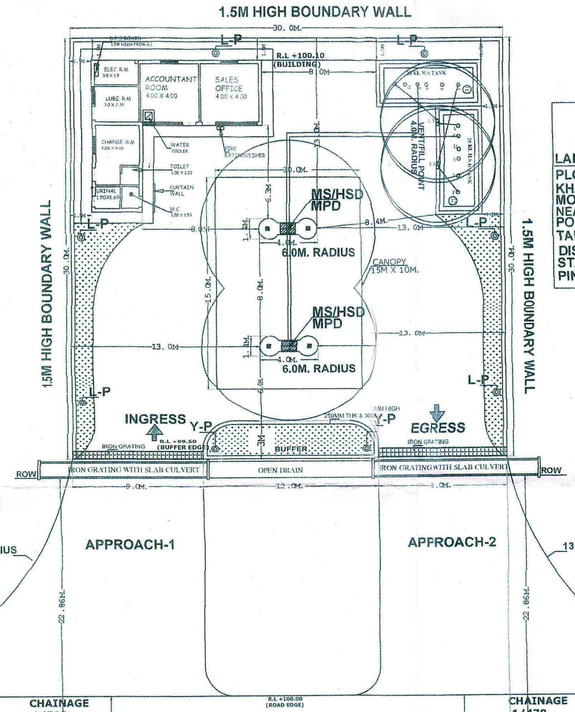

LAYOUT PLAN
SCALE-1:200



MOUZA DETAILS

LANDS DETAIL
PLOT NO-708
KHATA NO-36
MOUZA -PALHARI
NEAREST RLY. STN.-BANDA
POLICE STATION-KOTAWALI
TAHASIL-BANDA
DIST-BANDA
STATE-U.P.
PIN-210001

AREA STATEMENT
1. TOTAL LICENCE AREA =900.00SQ.M.
2. TOTAL PERIMETER = 120.00M.

INDEX - 1		
FOR SALES BLOCK		
Nos	ITEMS	SIZES
1	SALES ROOM	4.00M X 4.00M
2	ACCOUNTANT ROOM	4.00M X 4.00M
3	ELEC. ROOM	3.00M X 1.50M
4	LUBE ROOM	3.00M X 2.39M
5	CHANGE ROOM	3.00M X 4.00M
6	TOILET	1.20M X 1.20M
7	W.C	1.20M X 1.50M
8	URINAL	1.50M X 1.69M

INDEX - 3		
Sl. Nos	NAMES	DESCRIPTION
1	S.B.	SAND BUCKET
2	F.E.	FIRE EXTINGUISHER
3	Y.P.	Y POLE
4	L.P.	L POLE
5	D.P.	D.P. SWITCH

INDEX -2		
FOR TANKS		
Sl. Nos	TANKS	SIZES
1	T1	20KL M.S TANK 2110Ø X 6250 LONG
2	T2	20KL H.S.D TANK 2110Ø X 6250 LONG

NOTES -
ALL THE TANKS ARE LAID IN EARTH PIT WITH HD ARRANGEMENT.

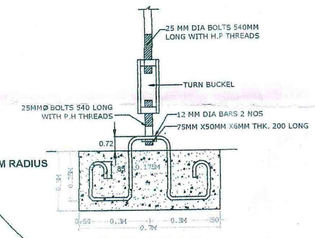

DETAILS OF HOLDING DOWN BOLTS & TURN BUCKEL
SCALE - N.T.S

NOTE :

T1 =1X20KL M.S U.G TANK OF 2.11M Ø X 6.25M LENGTH LAID IN EARTH PIT WITH STRIP RAFT.
T2 =1X20KL H.S.D U.G TANK OF 2.11M Ø X 6.25M LENGTH LAID IN EARTH PIT WITH STRIP RAFT.

SLAB ON TOP.
S = 50 MM Ø SUCTION LINE LAID IN 61CM UNDER GROUND.
D = DIP PIPE WITH CAP ASSEMBLY .
F = FILL PONT FITTED WITH AIR TIGHT THREADED BRASS CAP DESANTING FOR T/L .
V = VENT PIPE 4.0M HIGH OPEN END COVERED WITH TWO LAYERS OF NON - CORRIDIBLE METAL WIRE GAUGE HAVING NOT LESS THAN 60MESH IN MESH PER LINEAR CM.

1. ALL DIMENSIONS ARE IN M. OTHER THAN SPECIFIED.
2. ALL ELECTRICAL FITTINGS ARE FLAME PROOF CONFORMING TO IS: 2148 .
3. THERE IS NO BUILDING. DRAIN OR SEWER WITHIN 4.0M OF THE UNDER GROUND TANKS.
4. ALL ENTRANCE DOORS ARE OPENING OUT SIDES .
5. SALES ROOM USED ONLY FOR PETROLEUM PRODUCT.
6. 1X1.0M DIA HUME PIPE CULVERT IS SUFFICIENT TO DISCHARGE THE RAIN WATER.
7. THE TANKS PAINTED WITH 3 COATS OF SHALIMASTIC H.D PAINT OF 250 MICRON PER COAT.
8. THE 20KL TANKS FABRICATED WITH 6MM THK. FOR SHELL PLATE & 8MM THK FOR END PLATE AS PER IS 10987 .
9. EXHAUST PIPE WITH SPARK ARRESTER OF APPROVED MAKE WILL BE PROVIDED FOR D.G SET.
10. TANKS ARE IN EARTH PIT WITH HOLDING DOWN BOLT AS PER CODE OF ES APPROVED DRAWING NO-CO 6A VIDE LETTER NO -P6335 DATED 15.02.63 CONFORMING RULE 124 & 125 OF PR 1976 TANKS FABRICATION APPROVED AS PER IS: 1998 -1962 (REAFFRMED 1998)
11. 1.2M HIGH BOUNDARY WALL WILL BE PROVIDED.
12. SUBJECT SITE FULL FILL THE RELEVANT NORMS OF I.R.C GRANT IN 1983 .
13. NO LAND LITIGATION IS PENDING IN ANY COURT OF LAW.
14. 2 NOS OF 10KG DCP FIRE EXSTINGUISHER AND 4 NOS OF FIRE BUCKETS WILL BE PROVIDED.
15. NO SMOKING BOARD IS PROVIDED IN THE PUBLIC INFORMATION IN FRONT OF THE WALL OF THE SALES BUILDING.

DRG. NO - RTS/IOCL/PALHARI	DATE- 14.06.2020	REVISIONS-	INITIAL

INDIAN OIL CORPORATION LTD.
MARKETING DIVISION
ALLHABAD

RETAIL OUT LET
PLOT NO-708,MOUZA-PALHARI,
KHATA NO-36, P.S -KOTAWALI
DIST-BANDA, STATE - U.P.

SCALE -AS SHOWN	NOC APPROVAL DRAWING
	EO./MGR./SR. MGR. (ENGG.)
MGR./SR. MGR. (RETAIL SALES)	CHIEF DIVISIONAL RETAIL SALES MGR.
CONSULTANT: MS REFLECTIVE TECHNO STYLE, 1181 -NEAR SANTOSHI MAA TEMPLE,BOMIKHAL, BHUBANESWAR. Hab No -9937440565,8093540205 Email ID : bibhu_bandemaharm@yahoo.com,reflective_style@yahoo.com.	DRN BY-

एस0एन0 त्रिपाठी / S.N. Tripathi
प्रबन्धक (खुदरा बिक्री)
Manager (Retail Sales)
इण्डियन ऑयल कॉर्पोरेशन लिमिटेड (मा0वि0)
Indian Oil Corporation Limited (M.D)
इलाहाबाद मण्डलीय कार्यालय
Allahabad Divisional Office

27/7/2020

PRODUCED BY AN AUTODESK EDUCATIONAL PRODUCT