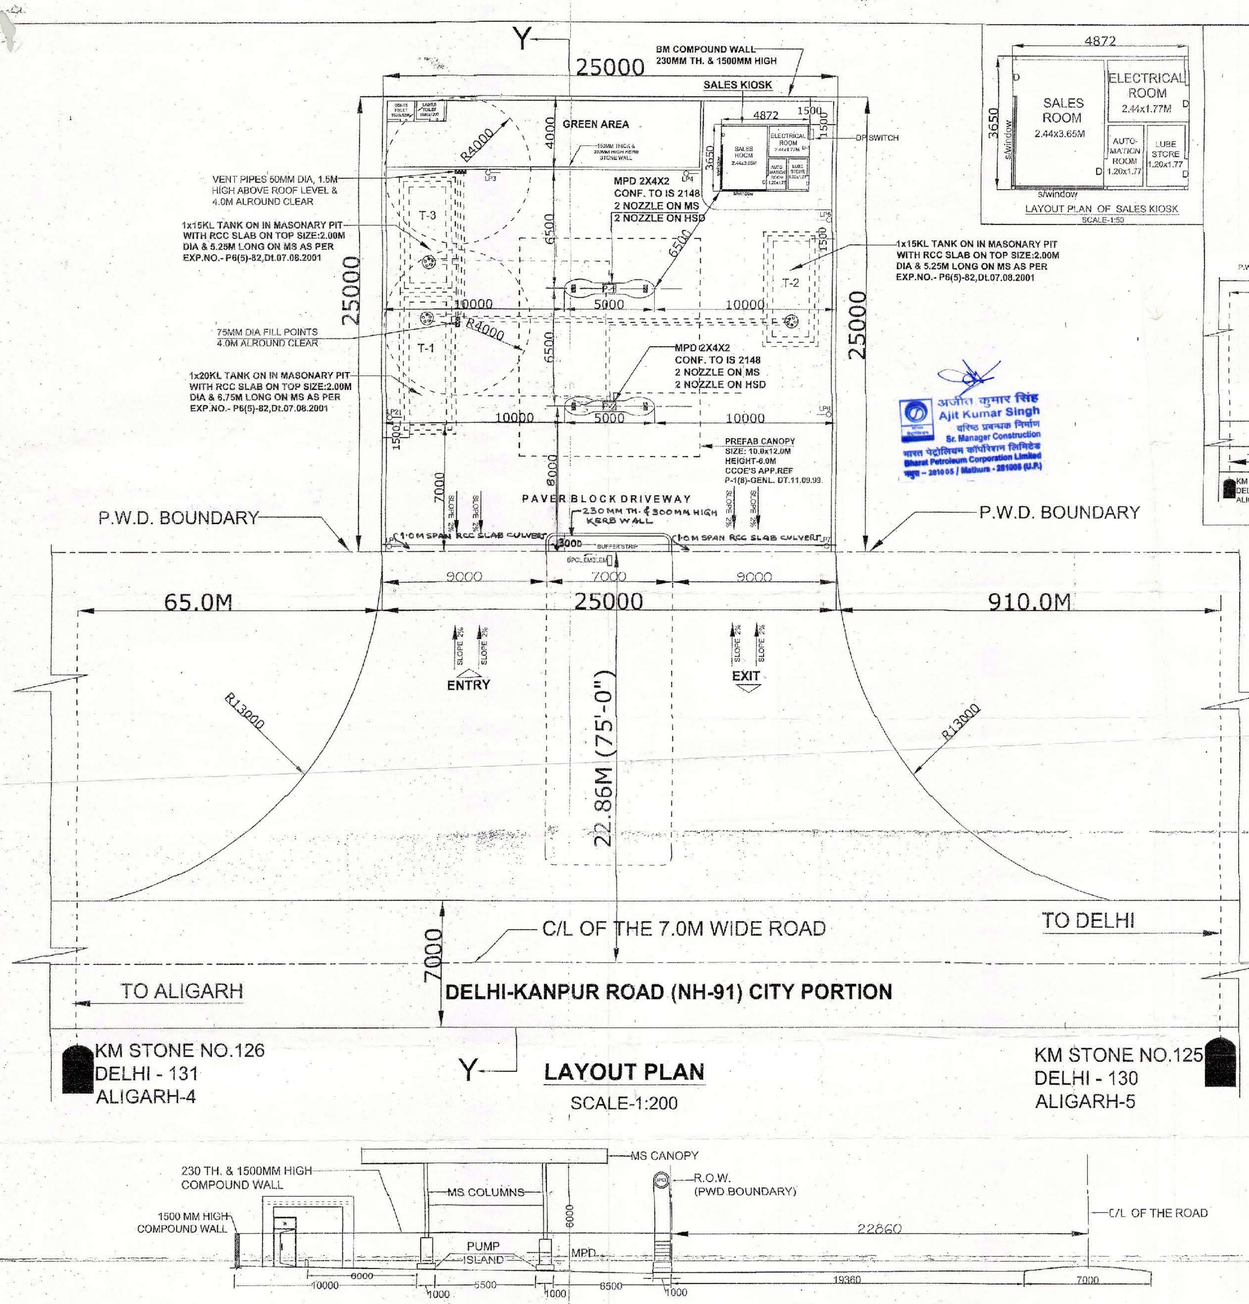

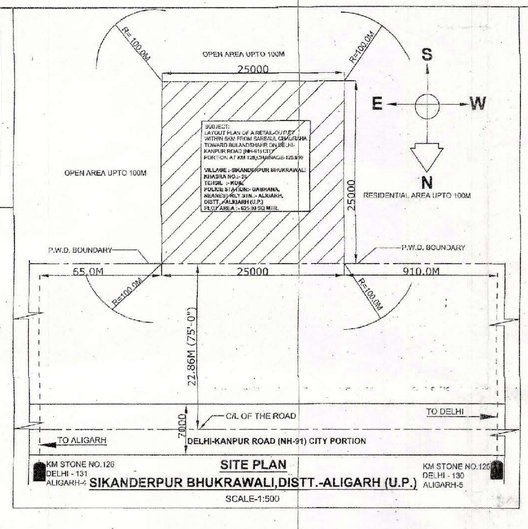

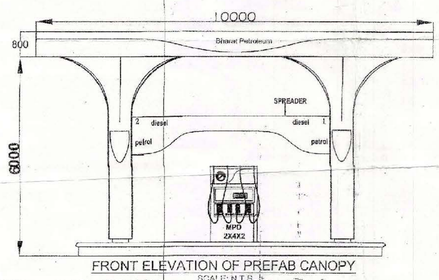

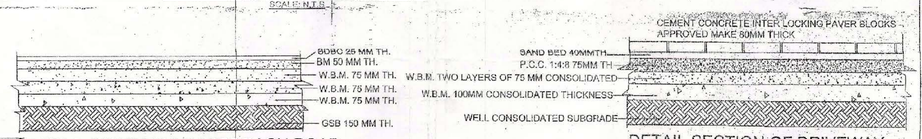

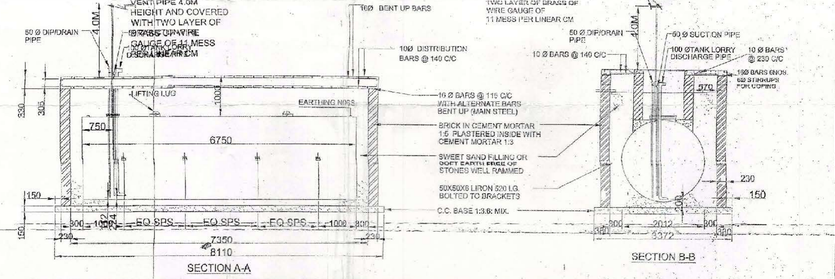

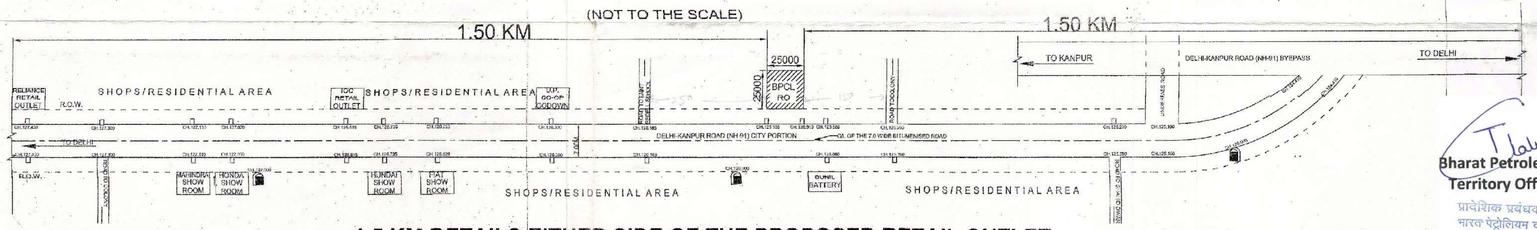

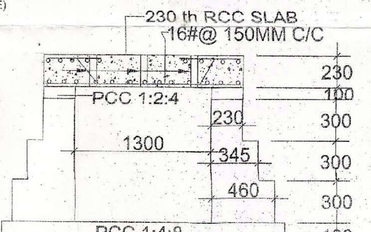

Bharat Petroleum Corporation Limited
Territory Office Mathura
प्रादेशिक प्रबंधक (रिटेल) मथुरा
भारत पेट्रोलियम कॉर्पोरेशन लिमिटेड
प्लॉट डी-1, रोड नं 26, इंडस्ट्रियल एरिया,
साइट-बी, पो. रिफाइनरी, मथुरा-281005

अजीत कुमार सिंह
Ajit Kumar Singh
वरिष्ठ प्रबंधक निर्माण
Sr. Manager Construction
भारत पेट्रोलियम कॉर्पोरेशन लिमिटेड
Bharat Petroleum Corporation Limited
मथुरा – 281005 / Mathura - 281005 (U.P.)

अधिशासी अभियन्ता
निर्माण खण्ड-1 लो0नि0लि0
अलीगढ़ 6/5

सहायक अभियन्ता
निर्माण खण्ड-1 लो0नि0लि0
अलीगढ़

अलीगढ़ से कैरहा कासगंज मार्ग (N.H-91) अछी अवा खेरो के 126/0 के पीलर 125/910 पर ग्राम सिकन्दरपुर भुकरावली पर नवीन रिटेल आउटलेट के स्थापित होने हेतु प्राप्त हुए मांगे गई सिन्दूकार आवश्यक निर्णय निकार है

1- प्रार्थी द्वारा प्रस्तुत मानचित्र रू. पी.ओ.एल.लैण्ड एण्ड के अनुसार है।
2- आवेदक को भूमि का भू-परिवर्तन की अनुमति प्राप्त किये जाना आवश्यक नहीं है।
3- आवेदक के प्रार्थना पत्र पेट्रोलियम एवं ज्वलनशील पदार्थ अधिनियम 1948 के अन्तर्गत अपेक्षित नहीं है।
4- प्रस्तावित स्थल नेशनल हाईवे से 60.00 मीटर की दूरी पर है।
5- प्रस्तावित स्थल सड़क की बायीं ओर है जो कि दोनों दिशाओं के यातायात के सुविधाजनक है।
6- प्रस्तावित स्थल से दोनों ओर दृश्यता (Sight Distance) N.H.91 (दोनों ओर) है।
7- प्रस्तावित स्थल से किसी भी प्रकार का अन्य प्रस्तावित नहीं है।
8- प्रस्तुत मानचित्र के भाग के अनुसार पूर्वी दिशा की दूरी 22.86 मी. प्रस्तावित रिटेल आउटलेट की दूरी 30.86 मी० पश्चिमी रिटेल आउटलेट की दूरी : 87.36 मी० वर्तमान परिस्थिति की दूरी 43.86 मी० पर दोनों तरफ खुला है।

आवेदक को भारतीय के अनुसार प्रस्तावित रिलायन्स पेट्रोलियम आउटलेट (BPCL) के निर्माण हेतु अनापत्ति प्रमाण पत्र निर्गत किये जाने की संस्तुति की जाती है।

(क) आवेदक को प्रस्तावित स्थल के सामने वाली सड़क के निर्माण हेतु मुख्य/पालिका की निर्माण कार्यदायी संस्था के अनुसार इस आशय से अनापत्ति प्रमाण पत्र प्राप्त करना होगा। सम्बन्धित कार्य से पहले विभाग से लिखित में लेख स्वीकृति करना होगा। जिसका प्रस्तावित स्थल पर लागू न करेगा।

(ख) आवेदक को प्रस्तावित स्थल पर लागू न करेगा।

अनापत्ति प्रमाण पत्र निर्गत होने के उपरान्त ही 22.86 मी० की दूरी के भाग को निर्गत कराया जाना है।

अनापत्ति प्रमाण पत्र में जाने की संस्तुति की जाती है।

अधिशासी अभियन्ता
निर्माण खण्ड-1 लो0नि0लि0
अलीगढ़ 6/5

सहायक अभियन्ता
निर्माण खण्ड-1 लो0नि0लि0
अलीगढ़

Bharat Petroleum

NOTES

1. VAVENT PIPE 50MM DIA & 4.0M HIGH,END COVERED WITH TWO LAYERS OF BRASS WIRE GUAGE OF 11 MESH PER LINEAR CENTIMETER.
2. FILL POINT FITTED WITH CAMLOCK COUPLING & AIR TIGHT THREADED BRASS/ ALUMINIUM CAP FOR DECANTING FROM TANK LORRY.
3. DIP PIPE WITH DIP CAP ASSEMBLY MADE OF BRASS/ALUMINIUM.
4. ALL ELECTRICAL FITTINGS ARE FLAME PROOF CONFORMING TO I.S. : 2148.
5. ALL DOORS OF BUILDING TO BE OPENED OUT WARD.
6. NO SEWER OR SURFACE DRAIN WITHIN 6.0M OF THE DISPENSING UNIT.
7. PREMISES TO BE USED ONLY FOR STORAGE OF PETROLEUM PRODUCTS.
8. TANKS ARE PAINTED WITH TWO LAYERS OF HOT BITUMEN OVER TWO COATS OF RED OXIDE PRIMER TO PROTECT AGAINST CORROSION.
9. FABRICATION DESIGN OF U/G STORAGE TANK ARE CONFORMING TO I.S.-1987/1992 AND AS PER C.C.O.E. NAGPUR APP.REF NO.C-90(CC)PRIM/SO/84 DT. 24.02.99
10. ALL DIMENSIONS ARE IN MM UNLESS OTHER WISE NOTED.
11. S.B.H.AND GASKET IS MOS. AS PER EXPLOSIVE RULES.
12. F.E.=FIRE EXTINGUISHERS 4 NOS. AS PER EXPLOSIVE RULES.
13. TANK SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED.THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.35 KG/SQ.CM. AND MAINTAINED FOR 02 HOURS.
14. DIP RODS SUPPLIED WITH THE TANK FOR THE TYPE OF INSTALLATION SHOULD BE 3350MM LONG INSTEAD OF 3150MM.
15. FABRICATION THICKNESS OF SHELL PLATE-4MM & END PLATE-6MM OF 20KL TANK.
16. THE CONSTRUCTION OF TANKS,PROTECTION,SPECIFICATION CONFIRMS TO PARA 124,125 & 131 OF THE PETROLEUM RULES-2002.
17. ALL LIGHT POLES ARE FITTED AS PER APPROVAL OF C.C.O.E. NAGPUR VIDE LETTER NO.PL-111(MBI) DT.26.11.1903.
18. NATURAL DOWN SLOPE FROM EDGE OF THE METALLED ROAD TO CULVERT ON APPROACHES WILL BE MAINTAINED SUCH THAT THE WATER FLOW TOWARDS DRAIN.
19. THE SITE IS FREE FROM ANY TYPE OF LITIGATION AND THERE IS NO CASE IS PENDING IN ANY COURT OF LAW.
20. THERE IS NO OVERHEAD H.T. LINE PASSES THROUGH THE PREMISES.
21. CANOPY SHALL BE INSTALLED AS PER APPROVAL NO. C-90 (NC) 7490 DT. 28-7-94.
22. SITE MEETS ALL APPLICABLE LATEST IOC NORMS.

PUMP DETAIL

SYM.	PRODUCT	CLASS
MPD-1 (2X4X2)	HSD/MS	B/A
MPD-2 (2X4X2)	HSD/ MS	B/A

TANK TABLE

S.NO.	PRODUCT	CAPACITY	LENGTH	DIA	REMARK
T-1	HSD	20KL	6750	2000	IN MASONARY PIT
T-2	MS	16KL	5950	2000	IN MASONARY PIT
T-3	MS	12KL	5250	2000	IN MASONARY PIT

NOTE : ALL DIMENSIONS ARE IN MILIMETERS UNLESS OTHERWISE NOTED.

BHARAT PETROLEUM CORPORATION LIMI

SCALE : AS SHOWN	APPROVED BY:
DRG. NO. : MTR/ALI/06	
DATE : FEB 2017	
EXPL. LIC. NO.:	

अजीत कुमार सिंह
Ajit Kumar Singh
वरिष्ठ प्रबंधक निर्माण
Sr. Manager Construction
भारत पेट्रोलियम कॉर्पोरेशन लिमिटेड
Bharat Petroleum Corporation Limited
मथुरा – 281005 / Mathura - 281005 (U.P.)

SUBJECT:
PROPOSED NEW RETAIL-OUTLET WITHI 5KM FROM SARSAUL CHAURAHA TOWA BULANDSHAHR ON DELHI-KANPUR ROA (NH-91) CITY PORTION AT KM 126, CHAINAGE-125.910

VILLAGE :- SIKANDERPUR BHUKRAW
KHASRA NO.:- 23
TEHSIL :- KOIL,
POLICE STATION:- GABHANA,
NEAREST RLY. STN.:- ALIGARH,
DISTT.:- ALIGARH (U.P.)
PLOT AREA- 625.00 SQ.MTR.