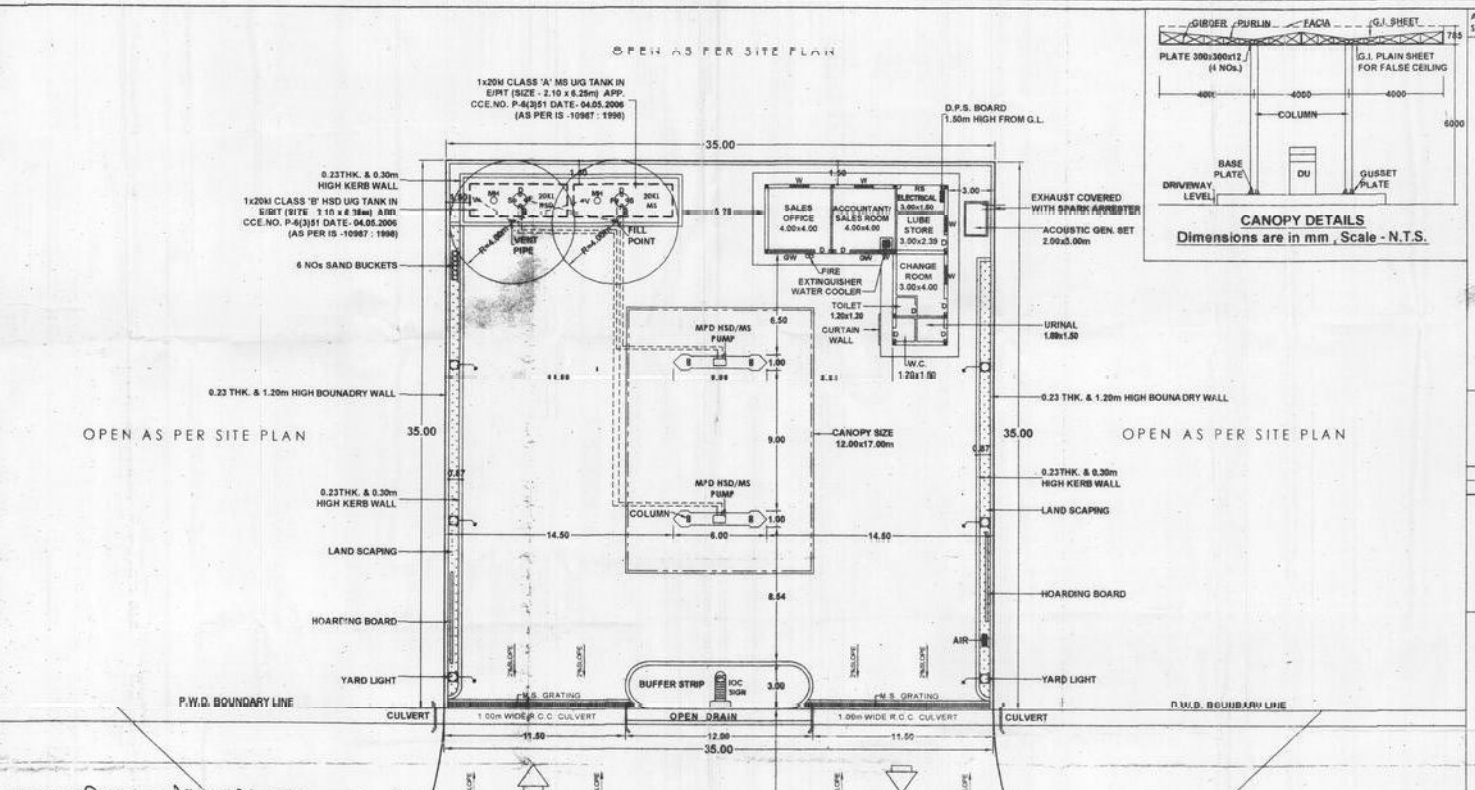

CANOPY DETAILS
Dimensions are in mm , Scale - N.T.S.

ADVT. LOCATION - BHAILOHA (BETWEEN KM STONE NO. -31 TO 34 ON S.H. -76 , ON ITWA - DHEBRUA ROAD), DISTT. - SIDDHARTH NAGAR (U.P.)

LICENCE NO. -

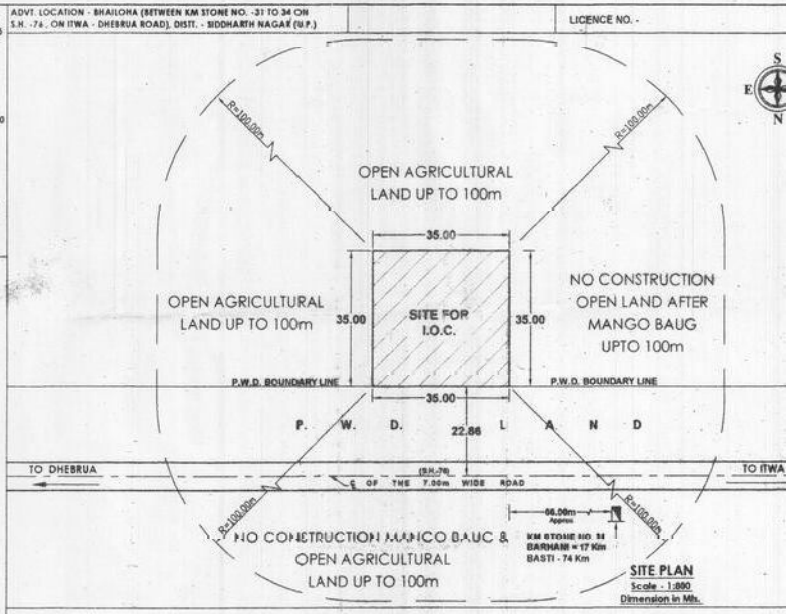

SITE PLAN
Scale - 1:800
Dimension in Mtr.

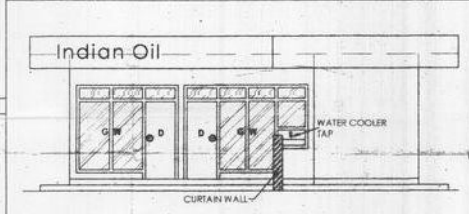

ELEVATION OF SALES BUILDING

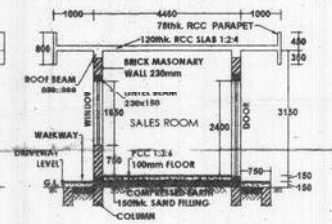

BLDG. SECTIONAL ELEVATION

NOTES :-

1. The vent pipes of the tanks are 4.00mts. above the ground and their ends are covered with 2 layers of brass wire gauge 11 mesh per linear centimeters.
2. Fill points of tanks are provided with camlock couplings and are provided with air tight threaded brass caps.
3. All electrical fittings provided are flameproof confirming to IS:2148.
4. All the doors and windows of the buildings are provided to open outwards
5. Dip pipe of the tanks are provided with cap assembly.
6. No sewer or surface drains are within 6.00mts. of underground tanks and DU's.
7. The premises to be used only for storage of petroleum products.
8. Tanks are painted with 2 coats of bituminous paint over 2 coats of red oxide primer to protect corrosion.
9. Fabrication design of u/g storage tanks are confirming to IS:10987 (1998) as per CCOE, Nagpur approval ref P-6(3)51 Dt. 04.05.2006
10. Sand Buckets and Fire Extinguishers are provided as perpetroleum norms.
11. Tank testing has been done by providing controlled pressure of 8.58 Kg/Sqcm for 2 hours.
12. Dip rods provided are 3280 mm long.
13. Thickness of shell and end plates of the 20kl tanks are - [Shell - 6 mm] [Ends - 8 mm].
14. Tanks conform to clause 124, 125 & 131 of the petroleum rules 2002.
15. All light poles fitted as per approval of CCE Nagpur vide letter no PL-III (MBI) Dt 26/11/2003. Adequate arrangements have been made for proper light at the premises.
16. Natural down slope from edge of the metalled road to culvert on approaches are maintained for free flow of water towards drains.
17. Site meets applicable IRC 1983 norms with latest amendments.
18. The proposed site is free from any type of litigation and no court case is pending in any court of law.
19. No high tension line passes through the premises.
20. Tanks are fed by tank lorry only.
21. All electric fittings of E/O dispensing units confirms to IS:2148.
22. Tank capacity of 20kl = 3.14x((2.1/2)x(2.1/2))x0.25x1000=21636 lts. Less Air Capacity = 1636 lts. Actual Product Storage Capacity = 20000 lts
23. The construction of RO as per IRC approval no 12/83 and IRC recommendation are being followed.

A.E
CD-I, P.W.D
Siddharthnagar

अधिशासी अभियन्ता
निर्माण खण्ड-1, लो०नि०वि०,
सिद्धार्थनगर

(के० एस० तेवतिया)
अधीक्षण अभियन्ता
भवन एवं सं० नि० वि०, बस्ती

LAYOUT PLAN
Scale - 1:200
Dimension in Mtr.

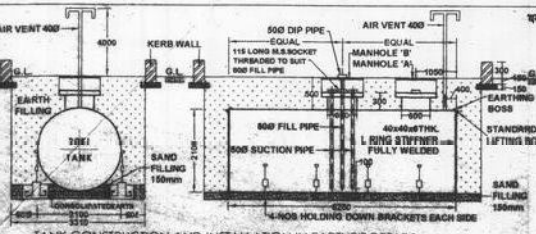

TANK CONSTRUCTION AND INSTALLATION IN EARTHPIT DETAILS
Dimensions are in mm , Scale - NTS.

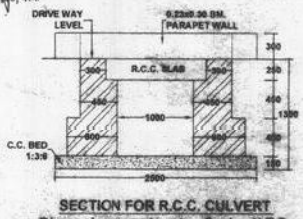

SECTION FOR R.C.C. CULVERT
Dimensions are in mtr. , Scale - N.T.S.

SITE INFORMATION	
PLOT NO / ARAZI NO./ KHASARA NO. /GATA NO.	401/ 402, 12 402
LOCATION -	BHAILOHA
TENSIL -	ITWA
POST OFFICE-	ITWA
POLICE STATION -	ITWA
RAILWAY STATION -	BARHNI
DISTRICT -	SIDDHARTH NAGAR
STATE -	UTTAR PRADESH
PIN CODE -	272 192
KM STONE NO. -	31
ROAD NO -	S.H.-76

AREA CHART

S.NO.	PARTICULARS	AREA (sqm.)
1	SITE AREA	1225.00
2	CANOPY COVERED AREA	204.00
3	SALES BUILDING AREA	72.36

TANKAGE / DU DETAILS

S.NO.	PARTICULARS	NOs.
1.	Tankage MS	1x20KL
2.	Tankage Xtra Premium	
3.	Tankage HSD	1x20KL
4.	Tankage Xtra Mile	
5.	Dispensers MS	1 MPD
6.	Dispensers Xtra Premium	
7.	Dispensers HSD	1 MPD
8.	Dispensers Xtra Mile	

Indian Oil

INDIAN OIL CORPORATION LIMITE
(Marketing Division)
GORAKHPUR DIVISIONAL OFFICE - GORAKHPUR

Name of Drawing: **Layout Plan of Retail Outlet**

Location: On Itwa - Dhebrea Road (At - Vill. - **Bhailoha**) (Tehsil -Itwa (District - **Siddhartha Nagar**) Near Km Stone No. 31 (S.H. - 7

Scale 1:200 | Drawing N IOC/31

Drawn by: Arvind Kumar (Dy.Mgr.Engg.) | Mgr. (R.S.) | (S.D.R.S.M.)