


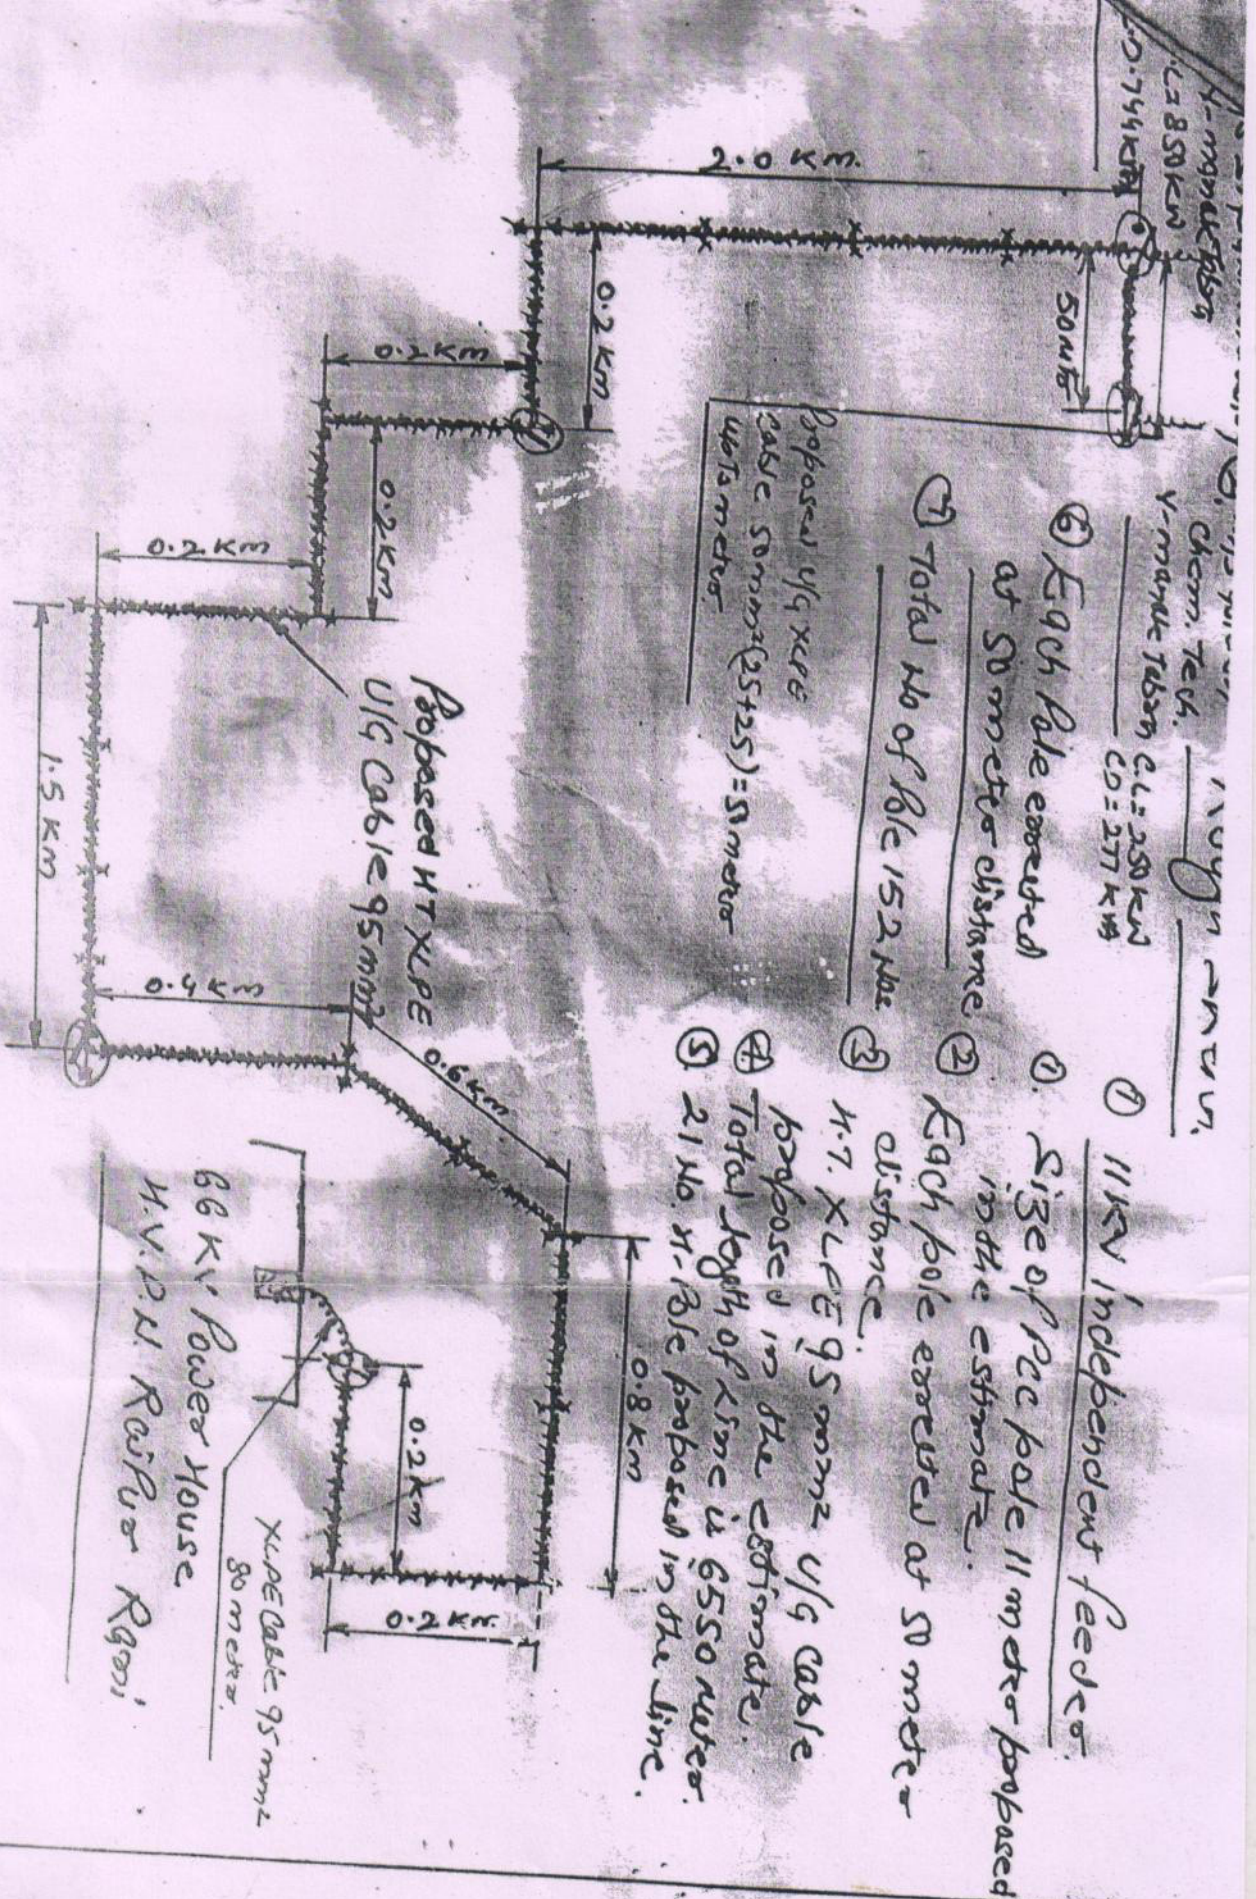

4-mphole PLS
 L=850 km
 20.744 km
 50 mtr
 Chem. Tech.
 V-mphole PLS
 CL=250 km
 CD=277 km

Proposed U/G XLPE
 cable 50mm²(25+25)=50 meters
 46.75 meters

- ① 11KV independent feeder.
- ② Size of PCC pole 11 meters proposed in the estimate.
- ③ Each pole erected at 50 meter distance.
- ④ H.T. XLPE 95mm² U/G cable proposed in the estimate.
- ⑤ Total length of line is 6550 meters.
- ⑥ 21 No. H.Pole proposed in the line.
- ⑦ Total No of Pole 152 No.
- ⑧ Each Pole erected at 50 meter distance.

S.D. Division
 JALPAIGIRI Raipur Hall