


1/3

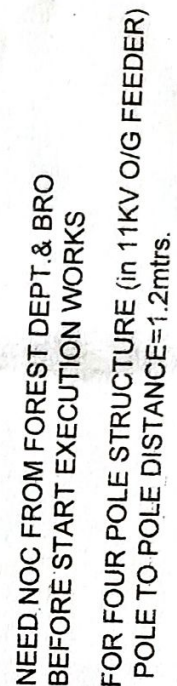

33KV		PARNOTE	TANGER	GANDRI
POLE (11 MTR)	08			
33KV LINE CKTM(NEW)	221			
HT AB CABLE	155	76	79	
11KV LINE CKTM(NEW)	2189	614	413	1162
POLE (9 MTR)	88	25	20	43

[Handwritten signature]
JE Elects/DIV
Ramban


[Handwritten signature]
JE-
[Handwritten signature]

[Handwritten signature]
AEE
Cen

TAPPING POINT
FROM EXISTING
33KV LINE

AEE
AE
AEE
(Electric spin)
ST S Div
M-97000



33/11 KV SUB STATION
KANGA, DIST-RAMBAN(J&K)
PGCIL
33 KV&11KV LINE SURVEY

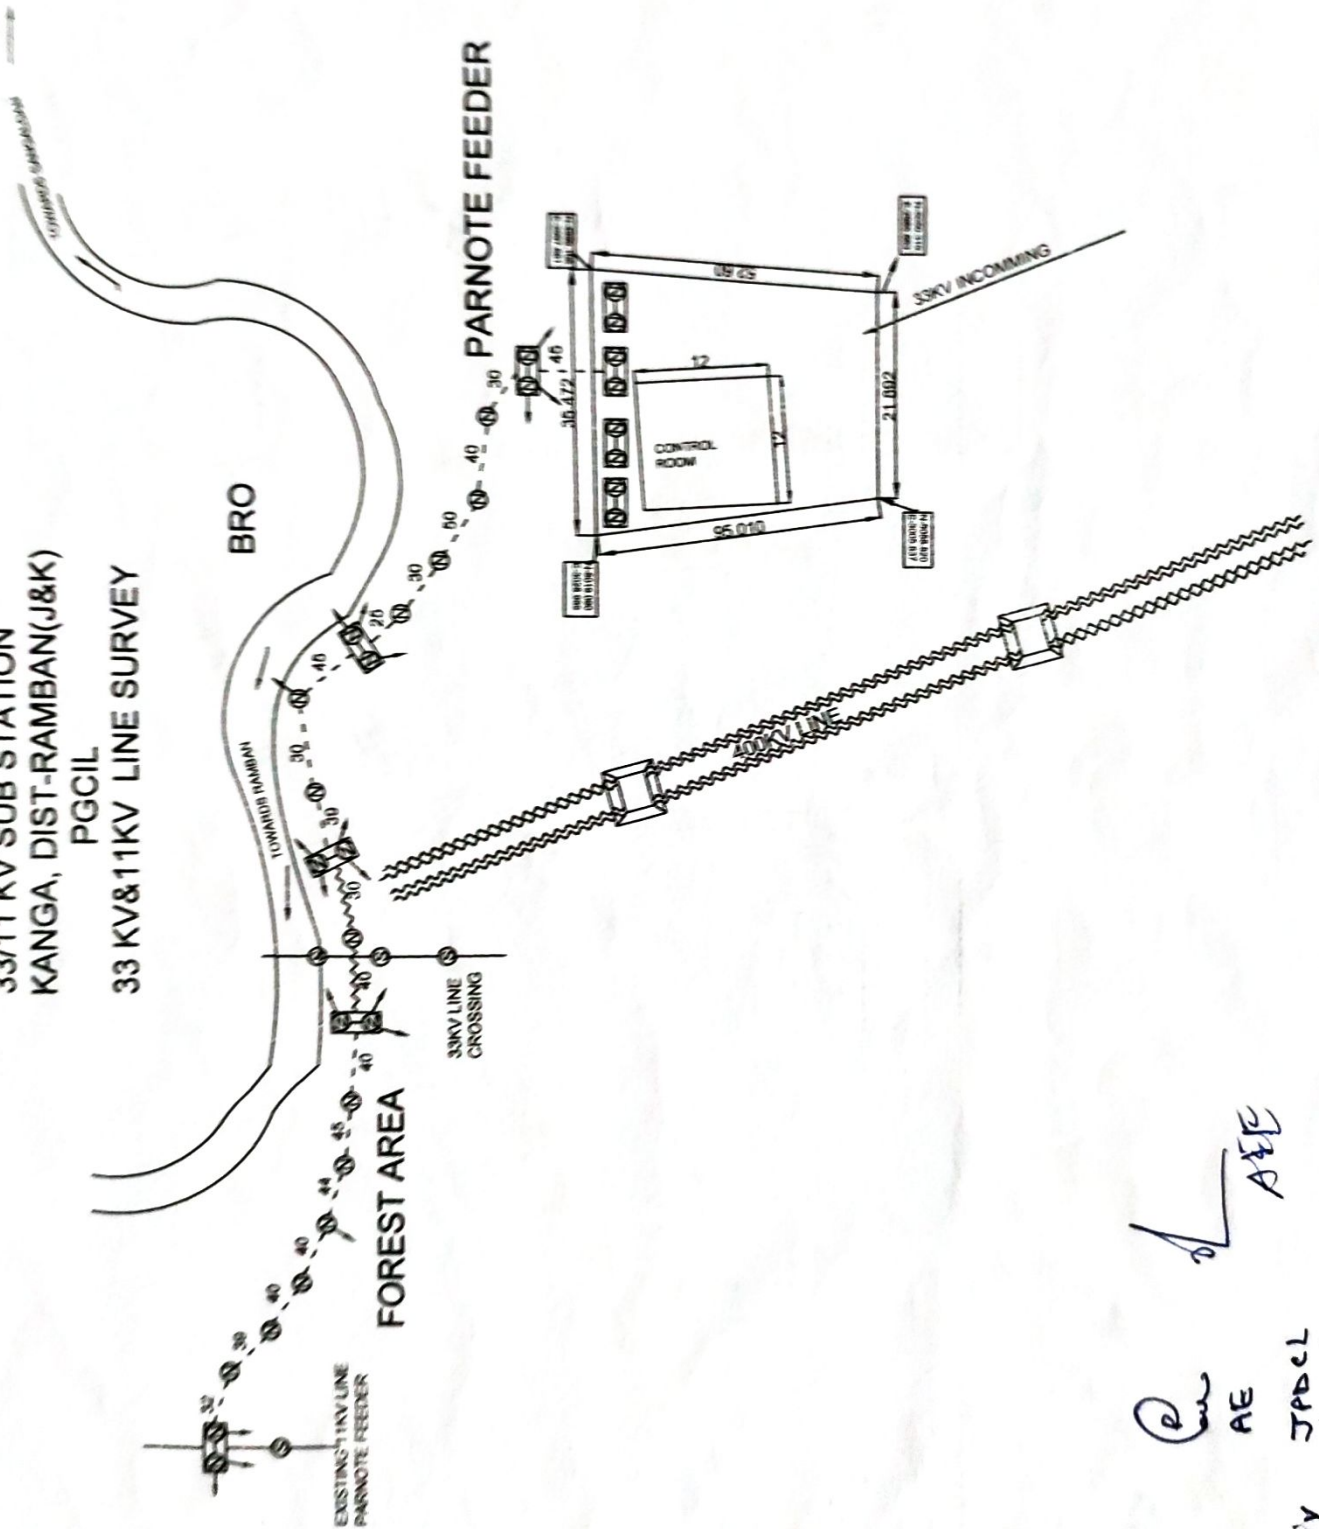

JE
 JPCCL E/S DIV
 Ramban
 AE
 JPCCL
 E/S-DIV
 Ramban
 AEE

33/11 KV SUB STATION
KANGA, DIST-RAMBAN(J&K)
PGCIL
33 KV&11KV LINE SURVEY

2/3

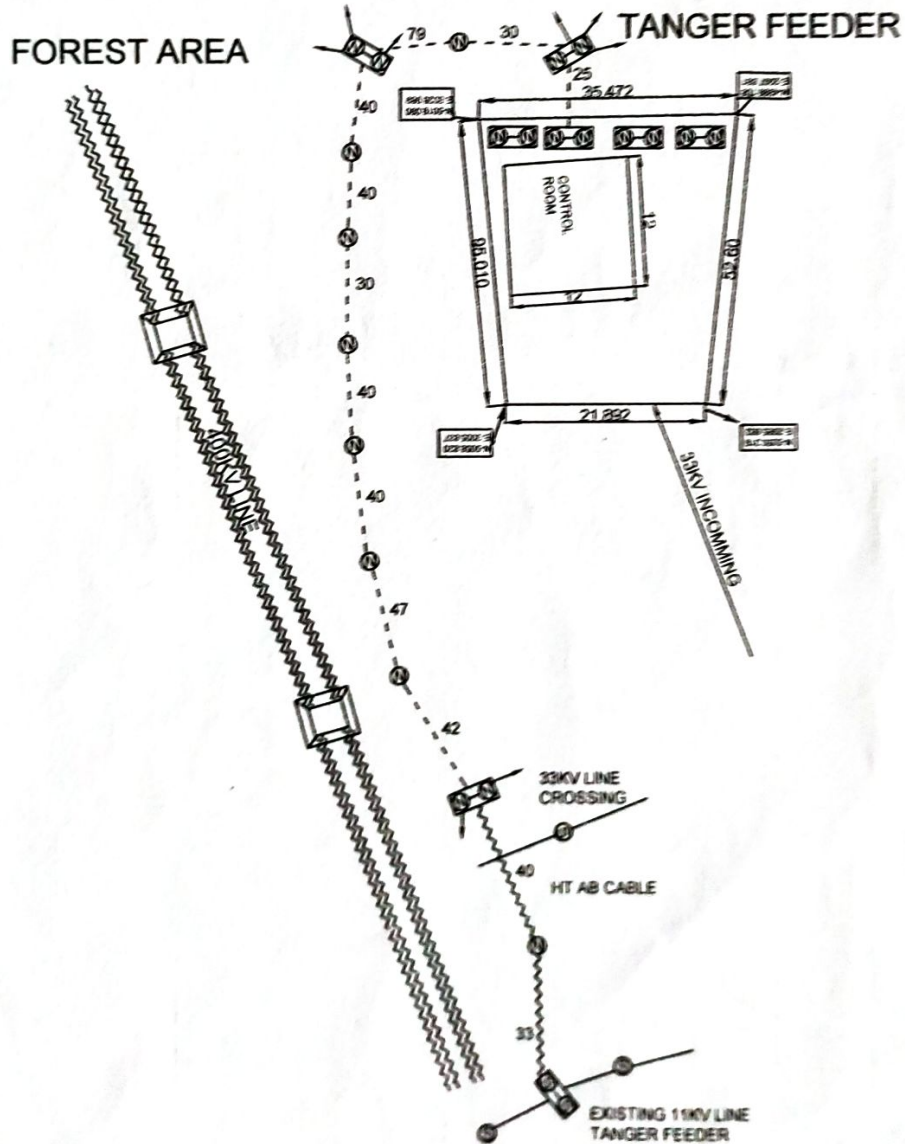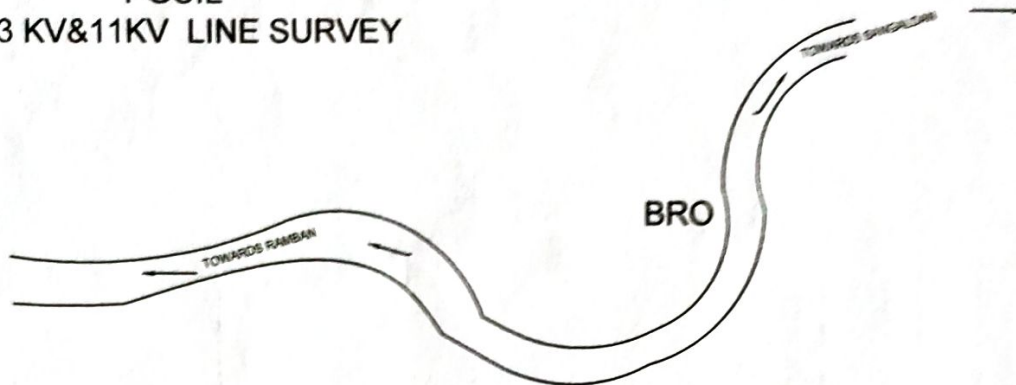

AE
Electricity
JPDCL Ramban

JE
Electric S/DW.
JPDCL Ramban