


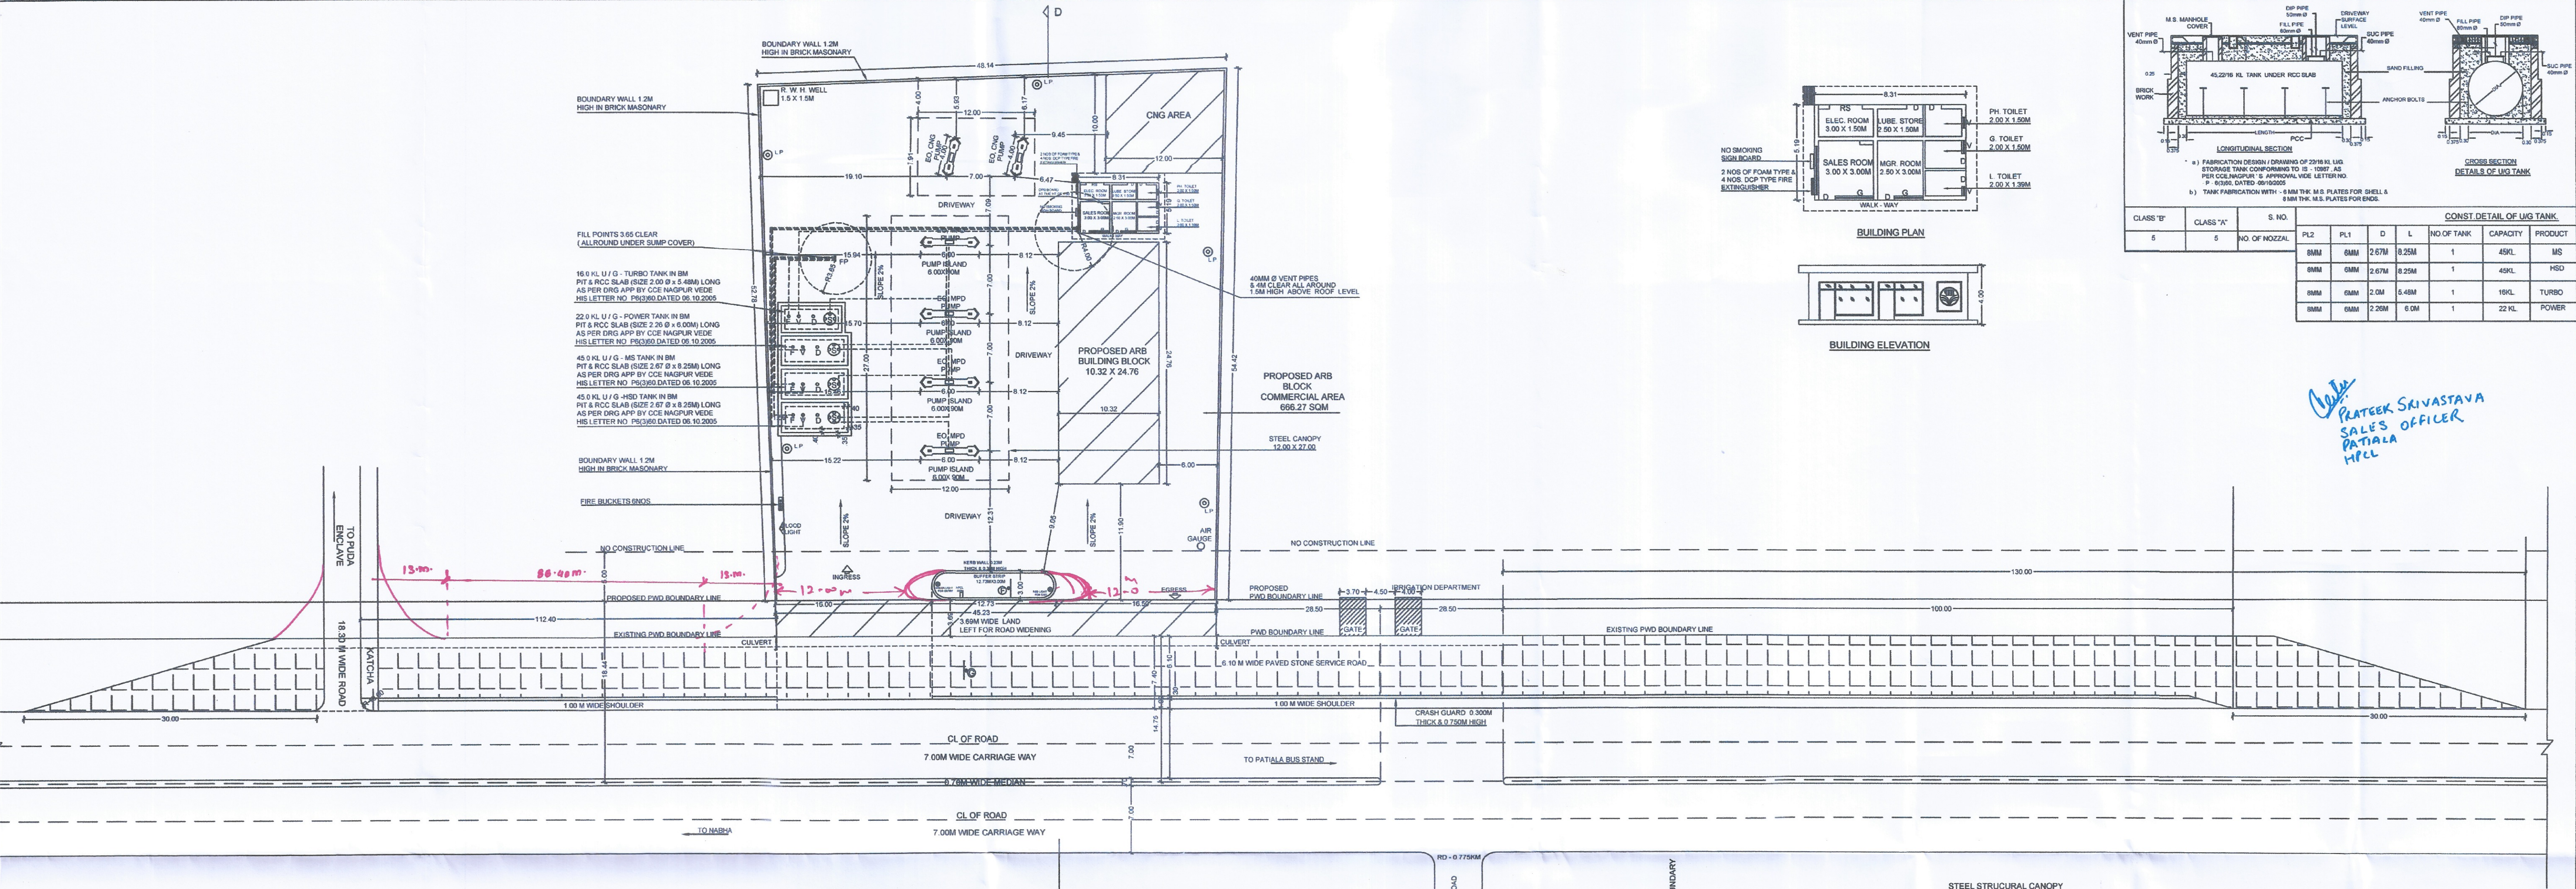


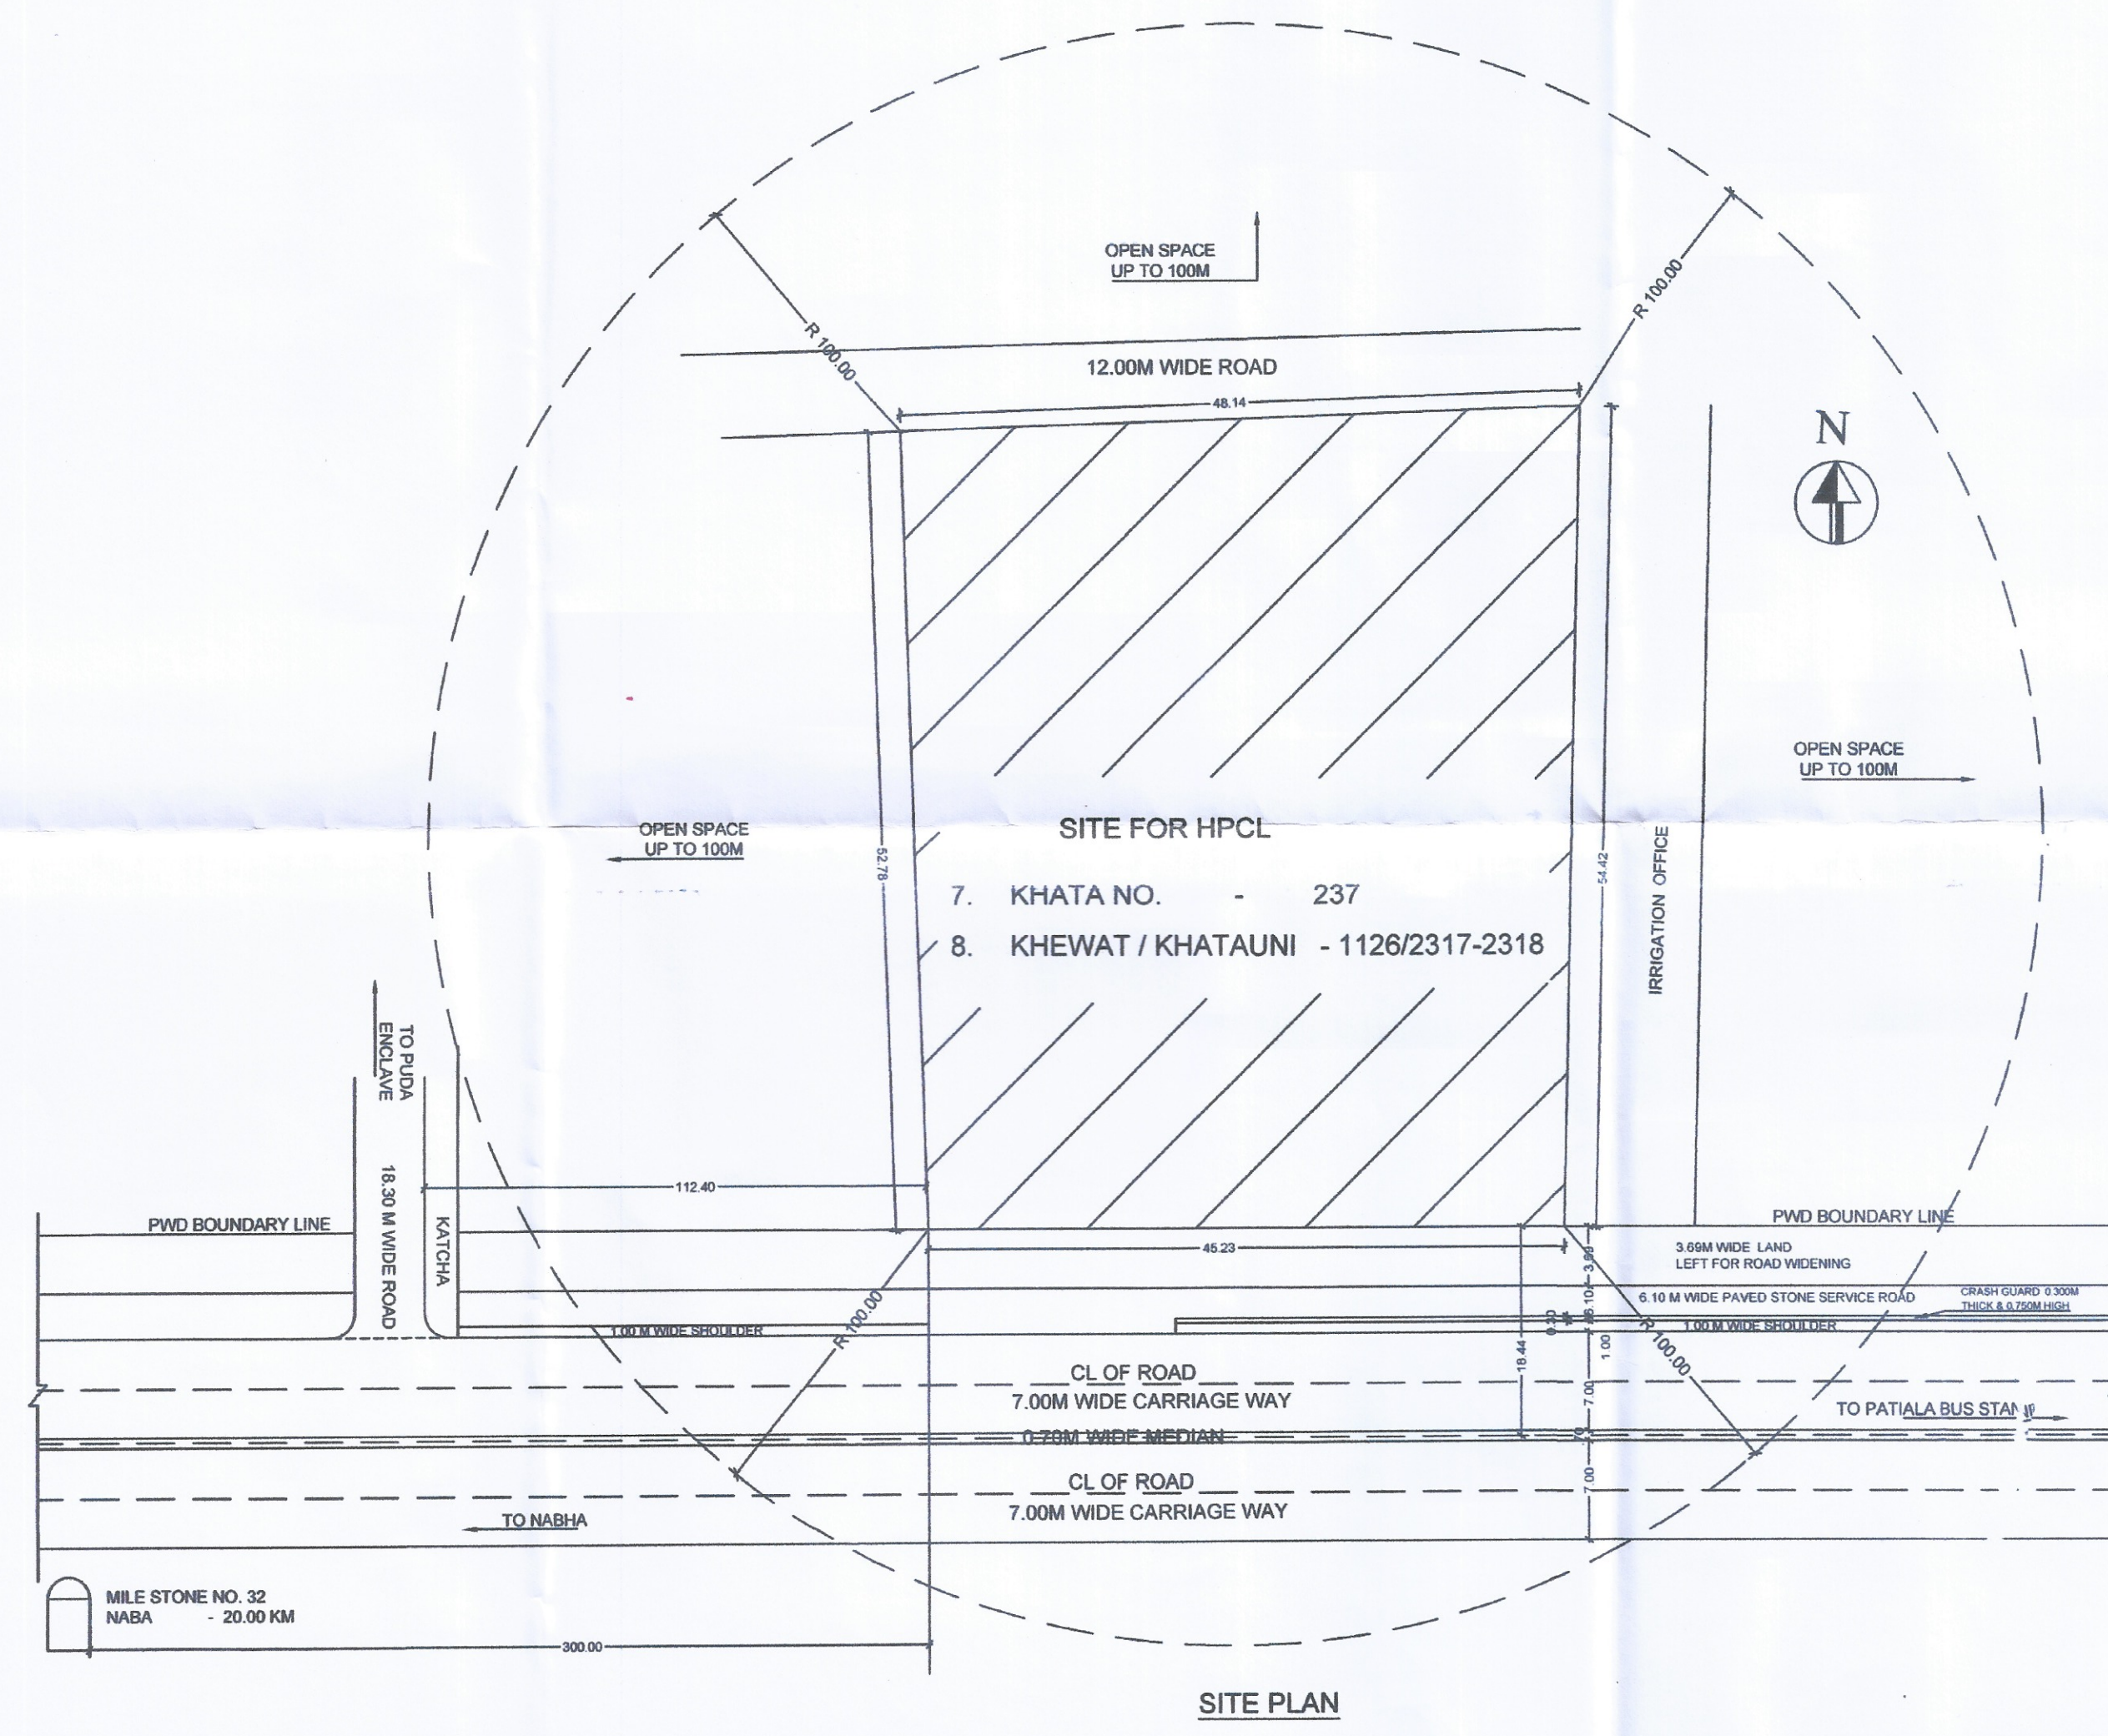


LAYOUT PLAN

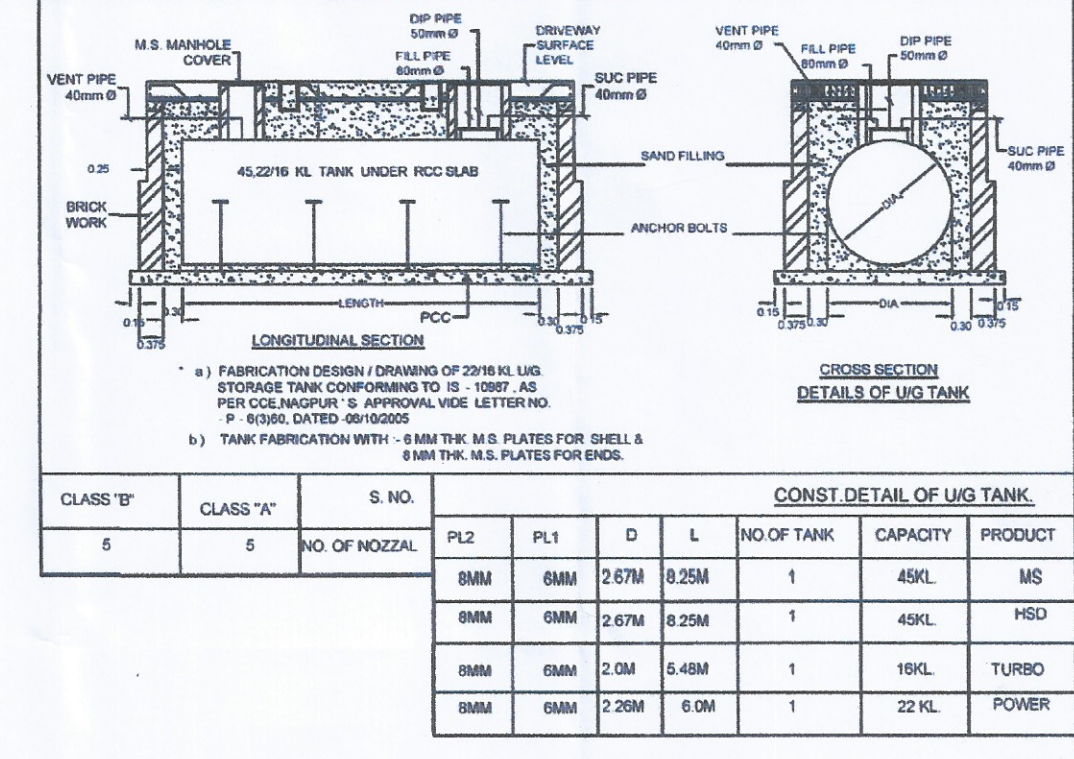






SITE PLAN

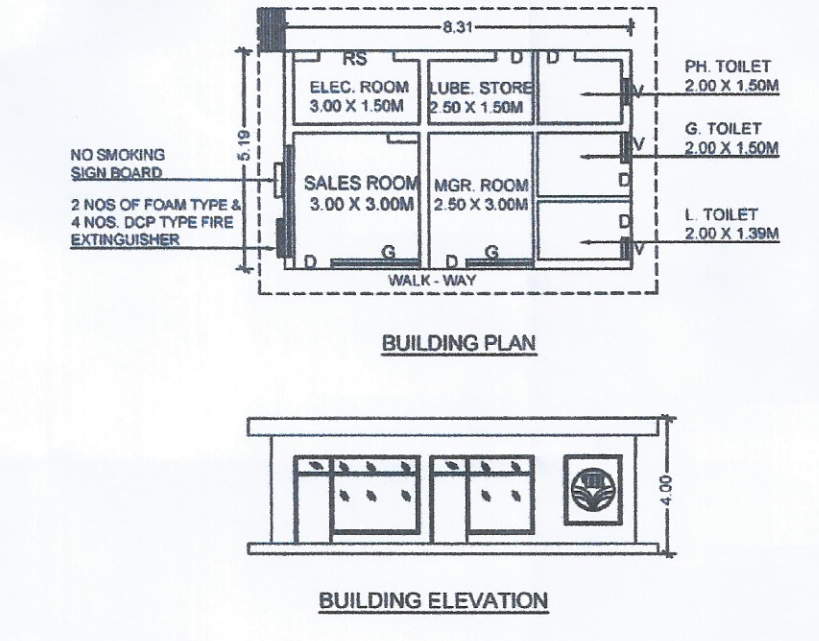

PRATEEK SAIVASTAVA
SALES OFFICER
HPCL

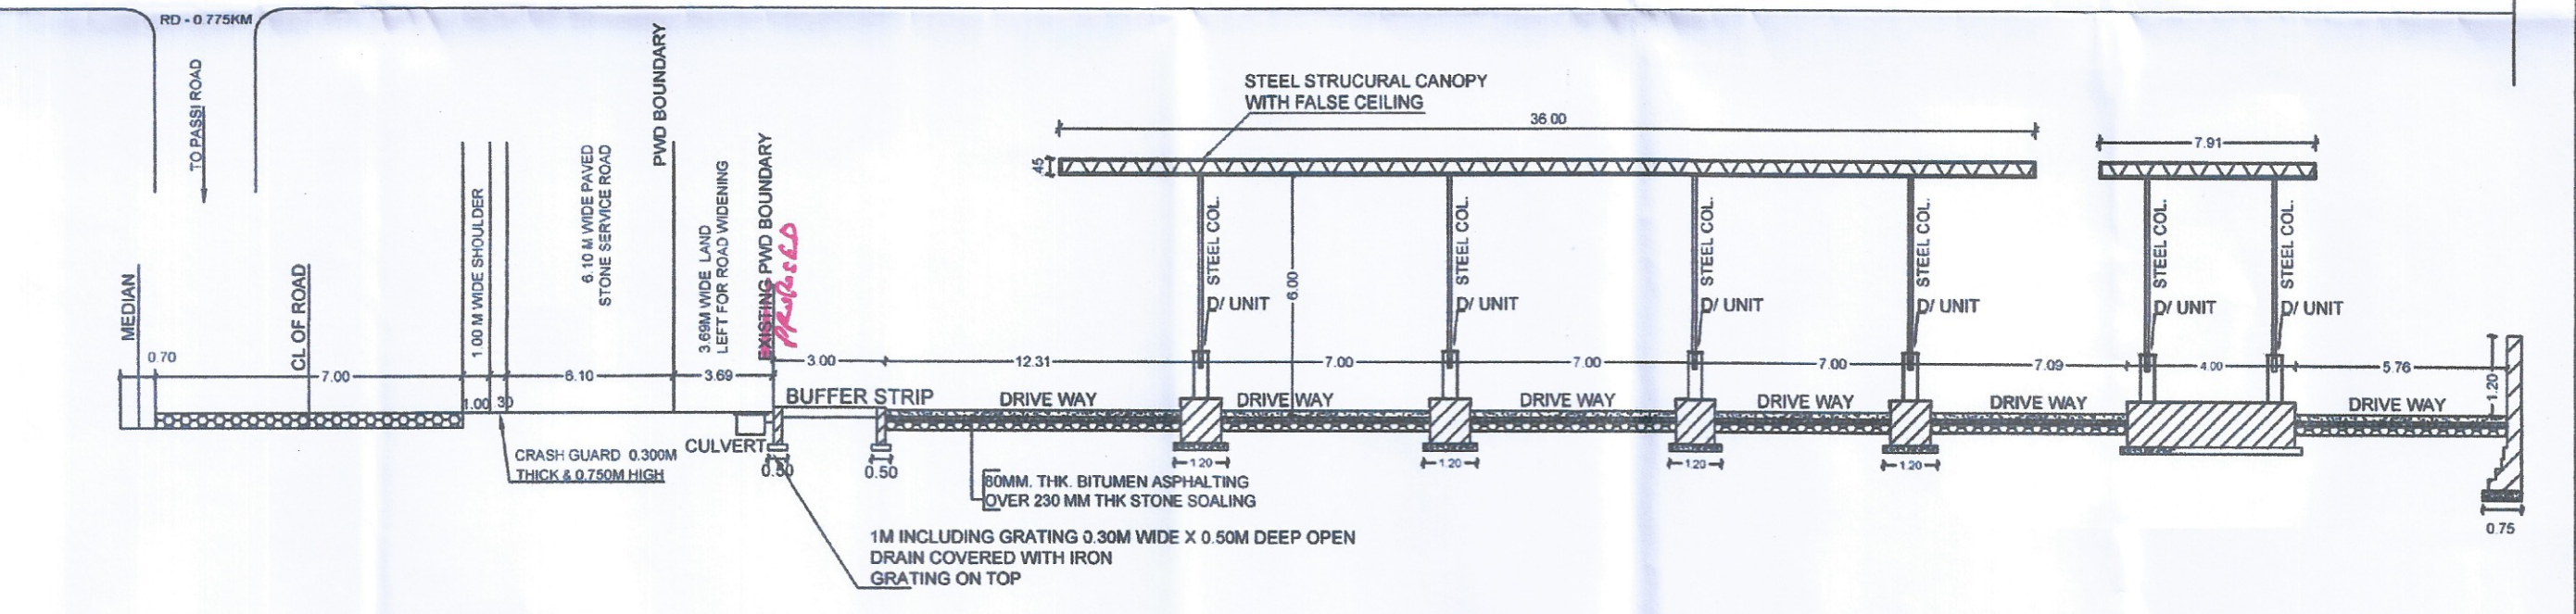

SECTION CD'

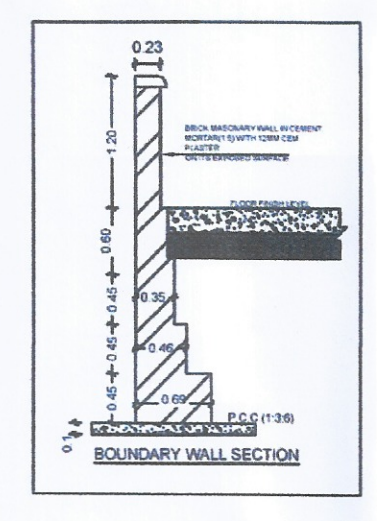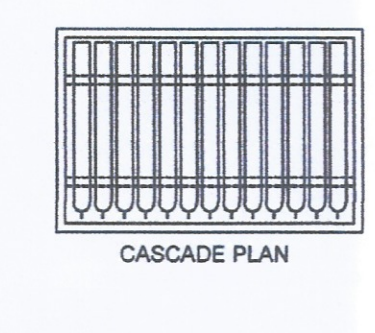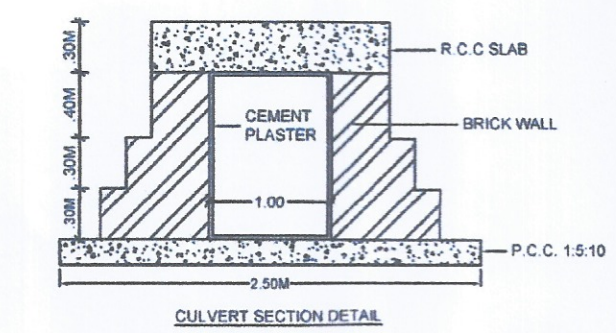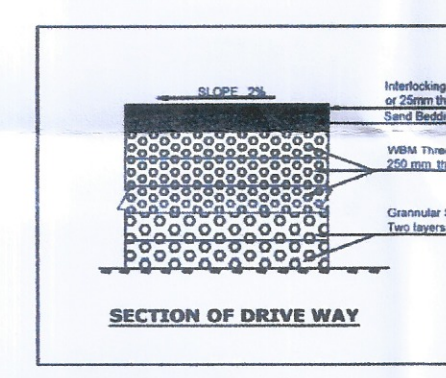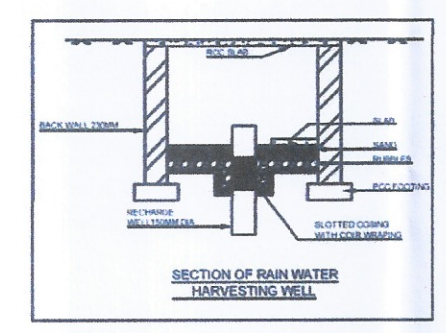

AREA DETAILS :-
PER COV. AREA OF COMMERCIAL
= 25% OF (2466.66 SQM) = 616.66 SQM
PRO COV AREA OF COMMERCIAL = 605.19 SQM

NOTE :-
1. ALL DIMENSION IN METERS.
2. V = VENT PIPE 4M HIGH & END COVERED WITH 2 LAYERS OF BRASS WIRE GAUGE 11 MESH PER LINEAR CENTIMETER.
3. F = FILL POINT FITTED WITH CAMELOCK COUPLING & AIR TIGHT THREADED BRASS CAP FOR DECONTAMINATING FROM TANK LOUVER.
4. D = DIP PIPE WITH CAP ASSEMBLY.
5. ALL ELECTRICAL FITTING AREA FLAME PROOF CONFORMING TO I.S. - 2148.
6. ALL DOORS OF BUILDING TO BE OPENED OUTWARDLY.
7. PERMITS TO BE USED FOR ONLY STORAGE OF PETROLEUM PRODUCTS.
8. TANKS AREA PAINTED WITH TWO LAYERS OF HOT BITUMEN OVER TWO COATS OF RED LEAD PRIMER TO PROTECT AGAINST CORROSION.
9. FABRICATION DESIGN OF UNDER GROUND STORAGE TANK AREA CONFORMING TO I.S. - 15987-1992 AS PER C.C.E. NAGPUR ORDER NO. PCH/60 DATED - 06-10-2005
10. S.B. SAND BUCKET 10 NO. AS PER EXPLOSIVES RULES.
11. F.E. FIRE EXTINGUISHER 10 NO. AS PER EXPLOSIVES RULES.
12. TANK SHOULD BE GREEN HYDROSTATIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED. THE TEST SHOULD BE MENTIONED AT A CONTROLLED PRESSURE OF 0.30KG/CM² FOR 2 HOURS.
13. DIP ROD SUPPLIED WITH THE TANK FOR THE TYPE OF INSTALLATION SHOULD BE 32MM LONG INSTEAD OF STANDARD 250MM.
14. FABRICATION THICKNESS OF SHELL PLATES & END PLATES OF TANKS 22KL - SHELL - 6MM END - 8MM & 101 OF THE PETROLEUM - 3002.
15. ALL LIGHT POLES AREA FITTED AS PER APPROVAL OF C.C.E. NAGPUR VICE LETTER NO. PL/11 (MB) DATED - 26-11-1992.
16. EV = EXTENDED VENT POINT, E.P. = EXTENDED FILL POINT.
17. NATURAL DOWN SLOPE FROM THE EDGE OF METALLED ROAD TO CULVERT ON APPROACHES WALL BE MAINTAINED FREE FLOW OF WATER TOWARDS DRAIN.
18. NO. ELECTRICAL LINE IS PASSING OVER THE RO. FRIMGES.
19. CONSTRUCTION OF APPROACH ROAD SERVICE ROAD & AD LINES AT THEIR OWN COST BY THE FRANCHISE OWNER CO. AND ITS MAINTENANCE IN FUTURE AT THEIR OWN COST.

ADDRESS DETAILS:-

1. VILLAGE	-	LEHAL
2. NEAREST POLICE STATION	-	PATIALA
3. NEAREST RLY. STATION	-	PATIALA
4. TEHSIL	-	PATIALA
5. DISTRICT	-	PATIALA
6. STATE	-	PUNJAB
7. KHATA NO.	-	237
8. KHEWAT / KHATAUNI	-	1126/2317-2318

AREA DETAILS :-

1. TOTAL PLOT AREA :-	=	2466.66 SQM
2. PER COV. BUILDING AREA 10% OF 2466.66	=	246.66 SQM
3. PRO COV BUILDING AREA	=	43.123 SQM
4. PER COV. CANOPY AREA 25 % OF 2466.66	=	616.66 SQM
5. CANOPY AREA	=	12.00 X 27.00
6. 2ND CANOPY AREA	=	94.92 SQM
7. PRO COV. CANOPY AREA	=	418.92 SQM

HINDUSTAN PETROLEUM CORPORATION LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)

LAYOUT PLAN OF FILLING STATION
AT PATIALA - NABHA, AT RD 0.80KM
DISTT. - PATIALA,
STATE - PUNJAB.

CHECKED BY: *[Signature]* APPROVED BY: *[Signature]*

DATE: 25/08/2020 DWG No. P.P.-01

M/S ROCKY & ASSOCIATES
JALANDHAR