



Map showing Diversion of Forest land proposed to construct 220KV DC/MC line from 400KV SS Narsapur to CTT of 220/132 KV SS Bourampet Narsapur Range, Medak Division.

Length of the line: 2275.92m
Area: $2275.92 \times 35 = 7.9657$ ha

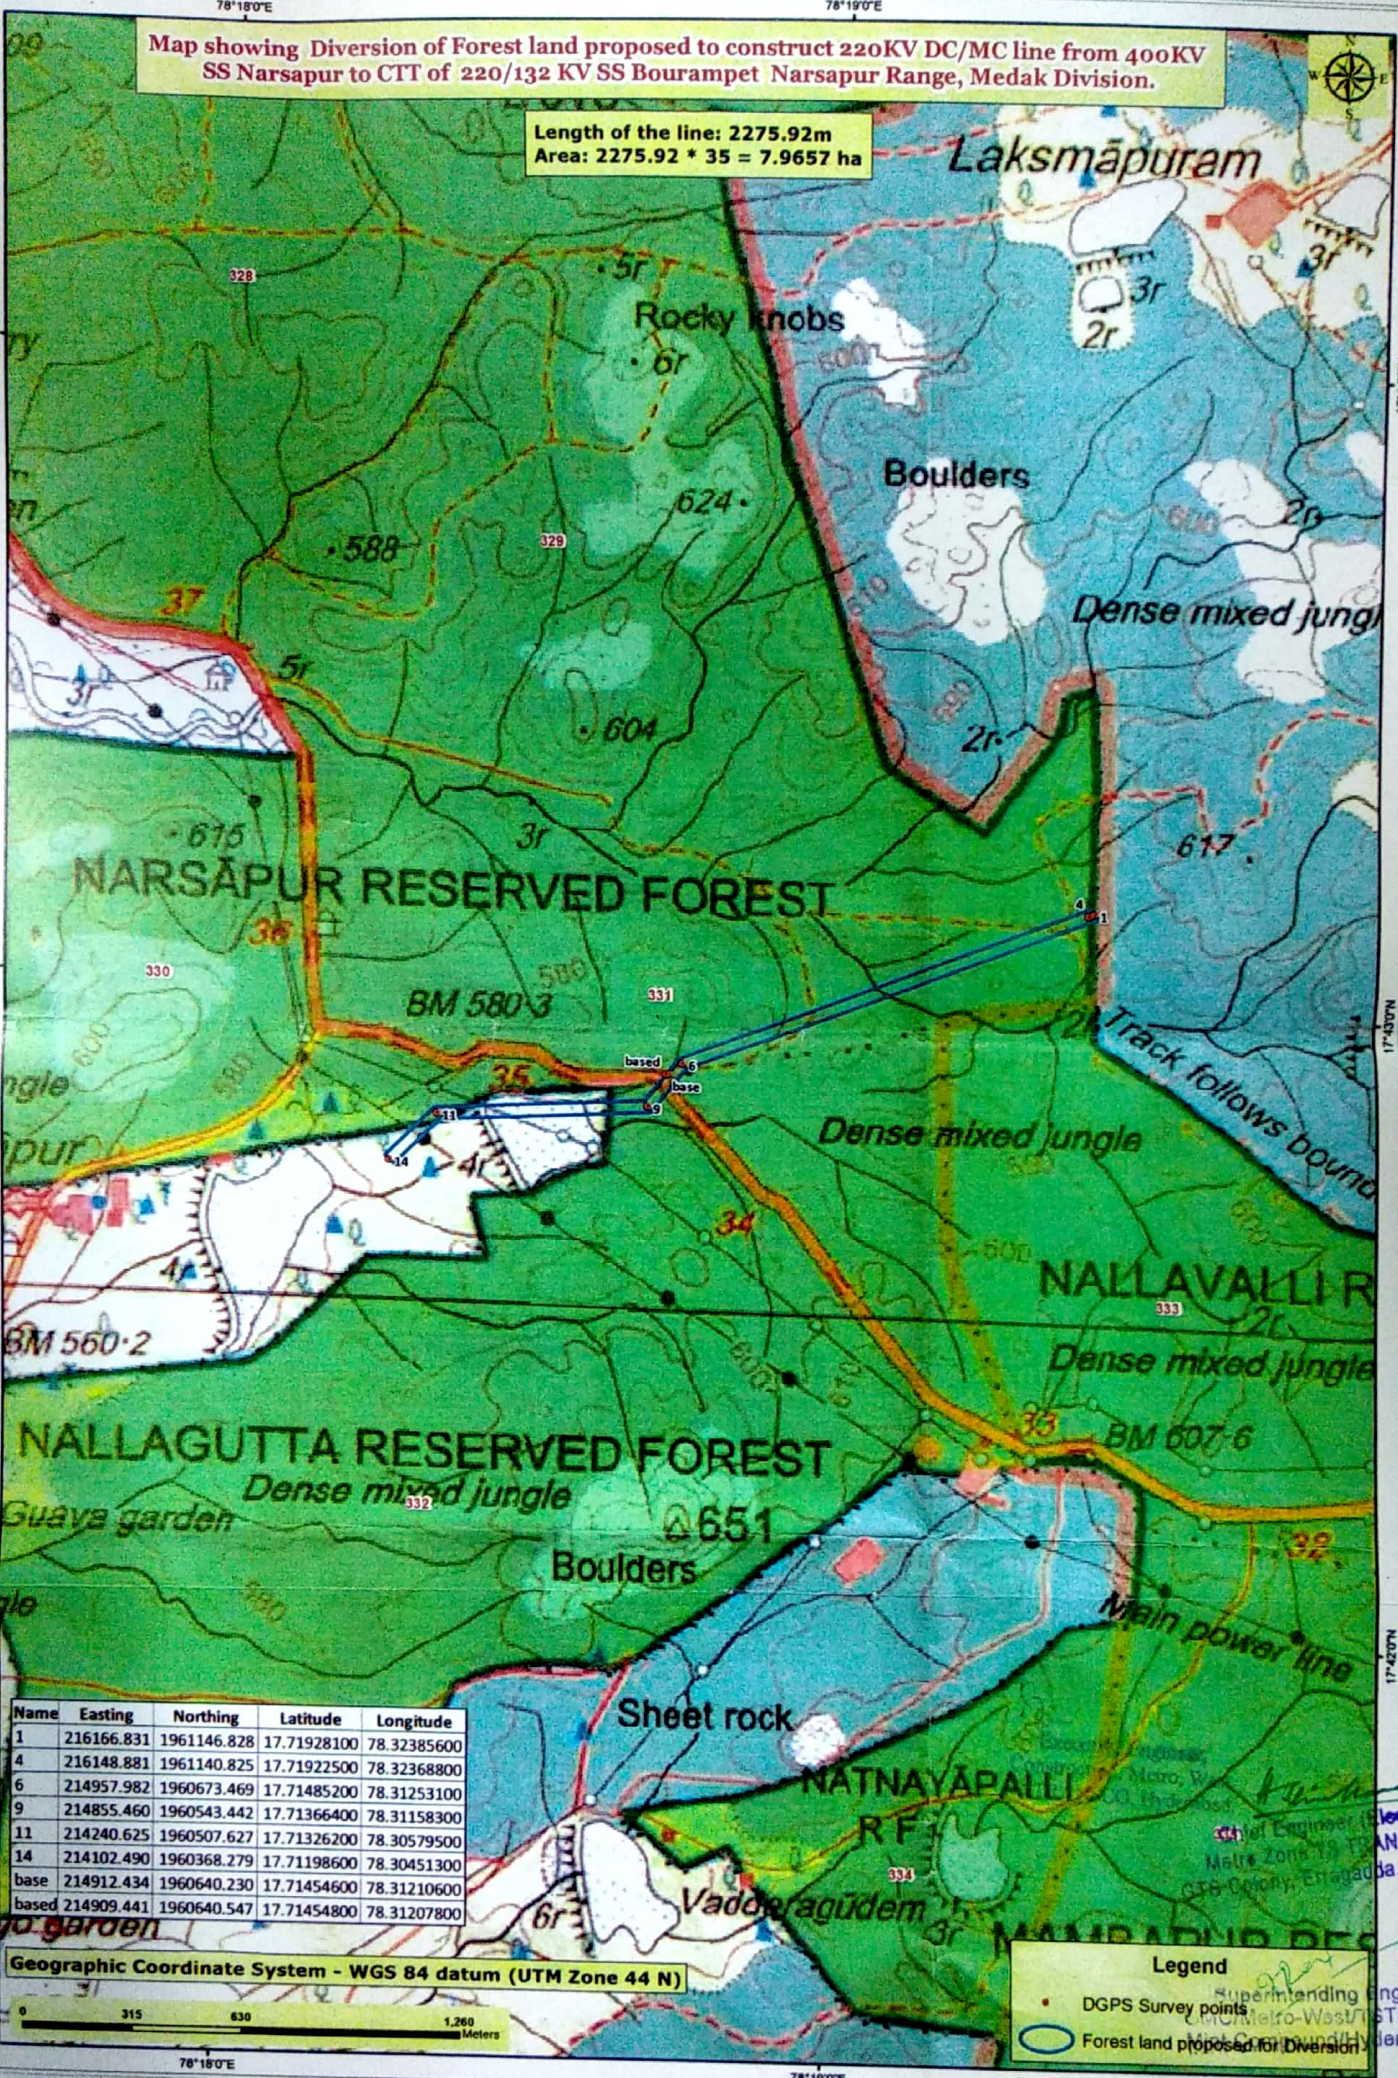

Name	Easting	Northing	Latitude	Longitude
1	216166.831	1961146.828	17.71928100	78.32385600
4	216148.881	1961140.825	17.71922500	78.32368800
6	214957.982	1960673.469	17.71485200	78.31253100
9	214855.460	1960543.442	17.71366400	78.31158300
11	214240.625	1960507.627	17.71326200	78.30579500
14	214102.490	1960368.279	17.71198600	78.30451300
base	214912.434	1960640.230	17.71454600	78.31210600
based	214909.441	1960640.547	17.71454800	78.31207800

Geographic Coordinate System - WGS 84 datum (UTM Zone 44 N)



Legend

- Superintending Engineer, Metro, West
- Chief Engineer (Elec.)
- STRANSCO
- Hyderabad-63
- DGPS Survey points
- Forest land proposed for Diversion