


Compensatory Afforestation Scheme for double Degraded area under FCA proposal for Submission of revised Forest land proposal for diversion of Forest Land of 30.00 hac. for forest clearance for Erection of 66kv D/C tower line for 66kv Subir substation to Proposed 66kv Morzira substation.

District:-Dang
Village:-Don

Taluka:-Ahwa
Survey no. :-204

Division:-North Dang
Compart no. :-137(P.F.)

Range:-Pipalaydevi
F.S.no. :-VIII

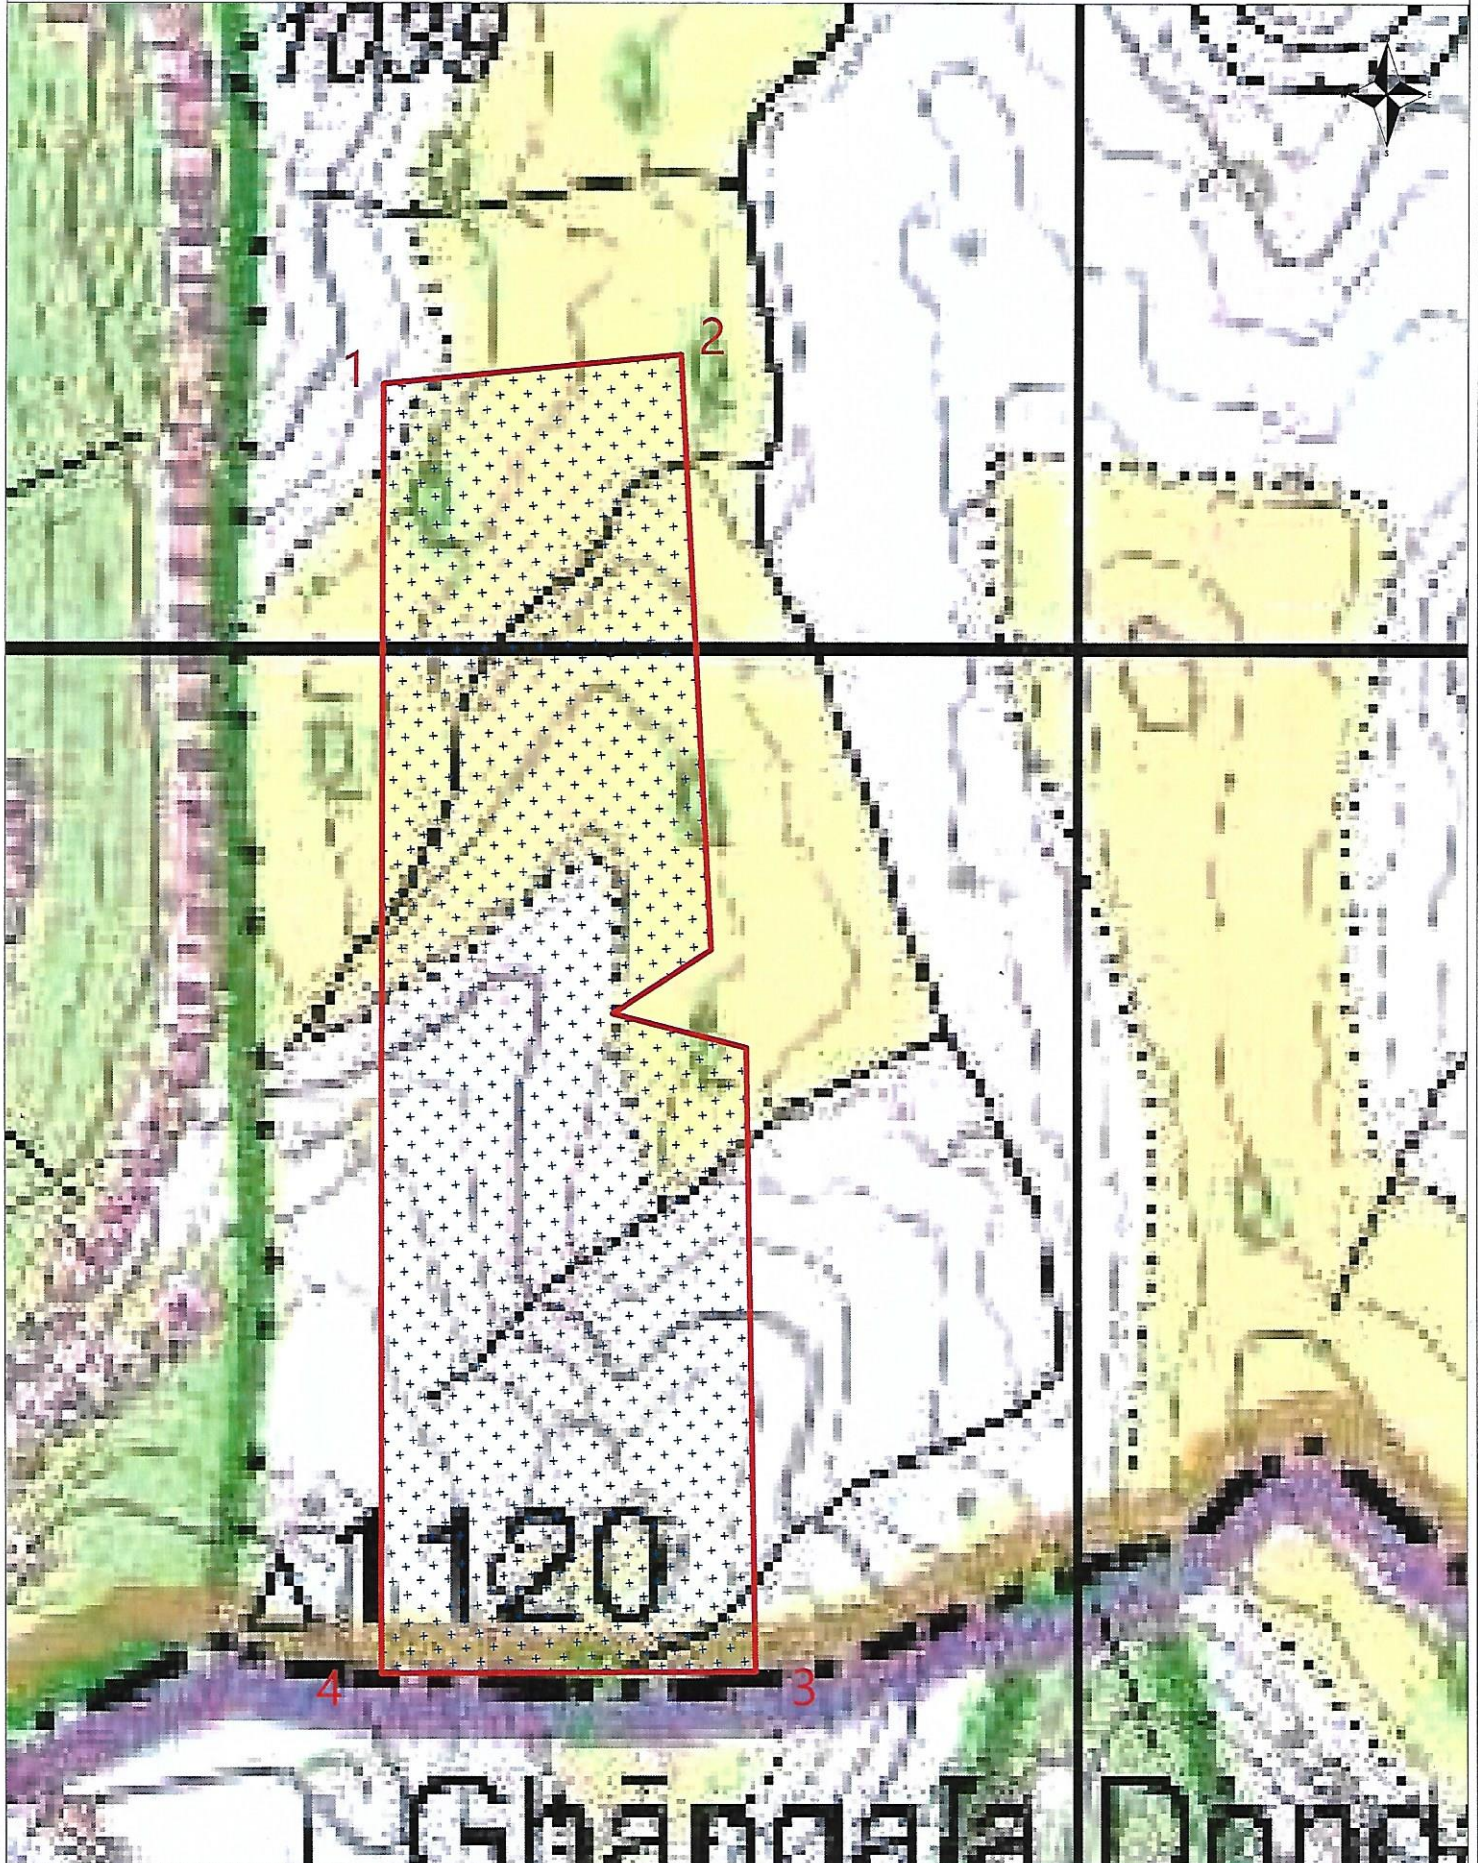

Leagend

 Proposed C.A.Land 30.00 ha.

G.P.S Location

1. 20°42'36.84"N 73°49'36.05"E
2. 20°42'39.02"N 73°49'47.11"E
3. 20°42'0.31"N 73°49'46.42"E
4. 20°42'0.94"N 73°49'34.62"E

(D.N.Rabari, GFS)
Deputy Conservator of Forest
North Dang Division Ahwa