

Compensatory Afforestation Scheme for double Degraded area under FCA proposal for Submission of revised Forest land proposal for diversion of Forest Land of 30.00 hac. for forest clearance for Erection of 66kv D/C tower line for 66kv Subir substation to Proposed 66kv Morzira substation.

District:-Dang

Taluka:-Ahwa

Division:-North Dang


Range:-Pipalaydevi

Village:-Don

Survey no.:-204


Compart no.:-137(P.F)

F.S.no.:-VIII



G.P.S Location

1. 20°42'36.84"N 73°49'36.05"E
2. 20°42'39.02"N 73°49'47.11"E
3. 20°42'0.31"N 73°49'46.42"E
4. 20°42'0.94"N 73°49'34.62"E

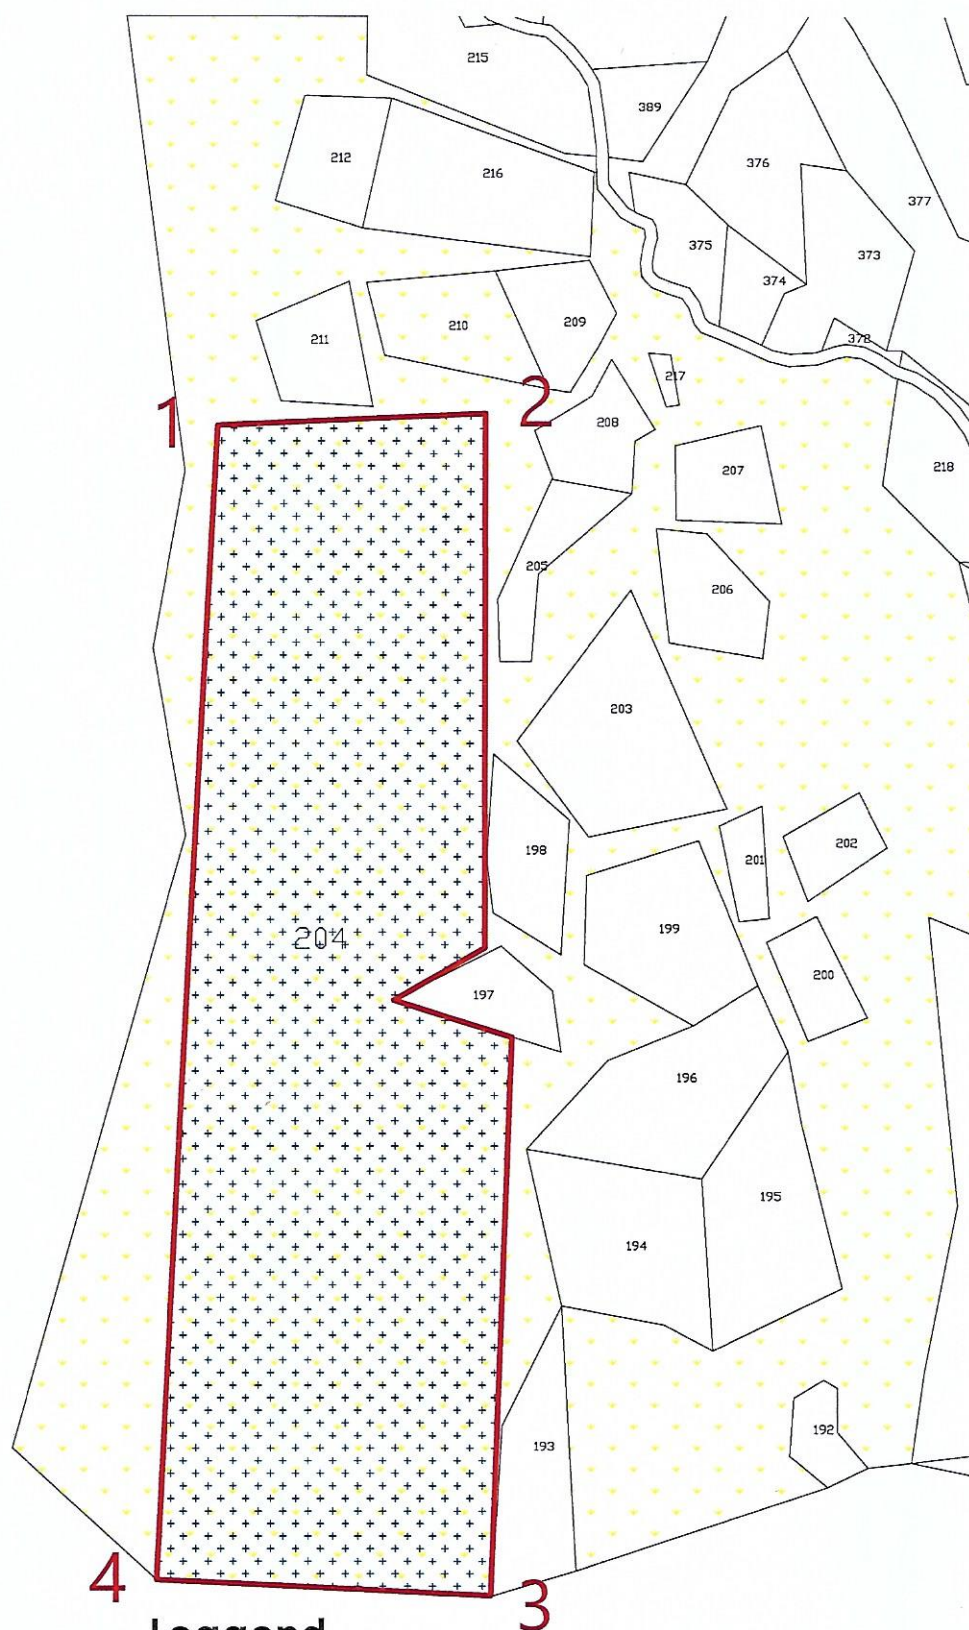

Leagend

-  Protected Forest
-  Proposed C.A.Land 30.00 ha.


(D.N.Rabari, GFS)
Deputy Conservator of Forest
North Dang Division Ahwa