


F 44 R 13

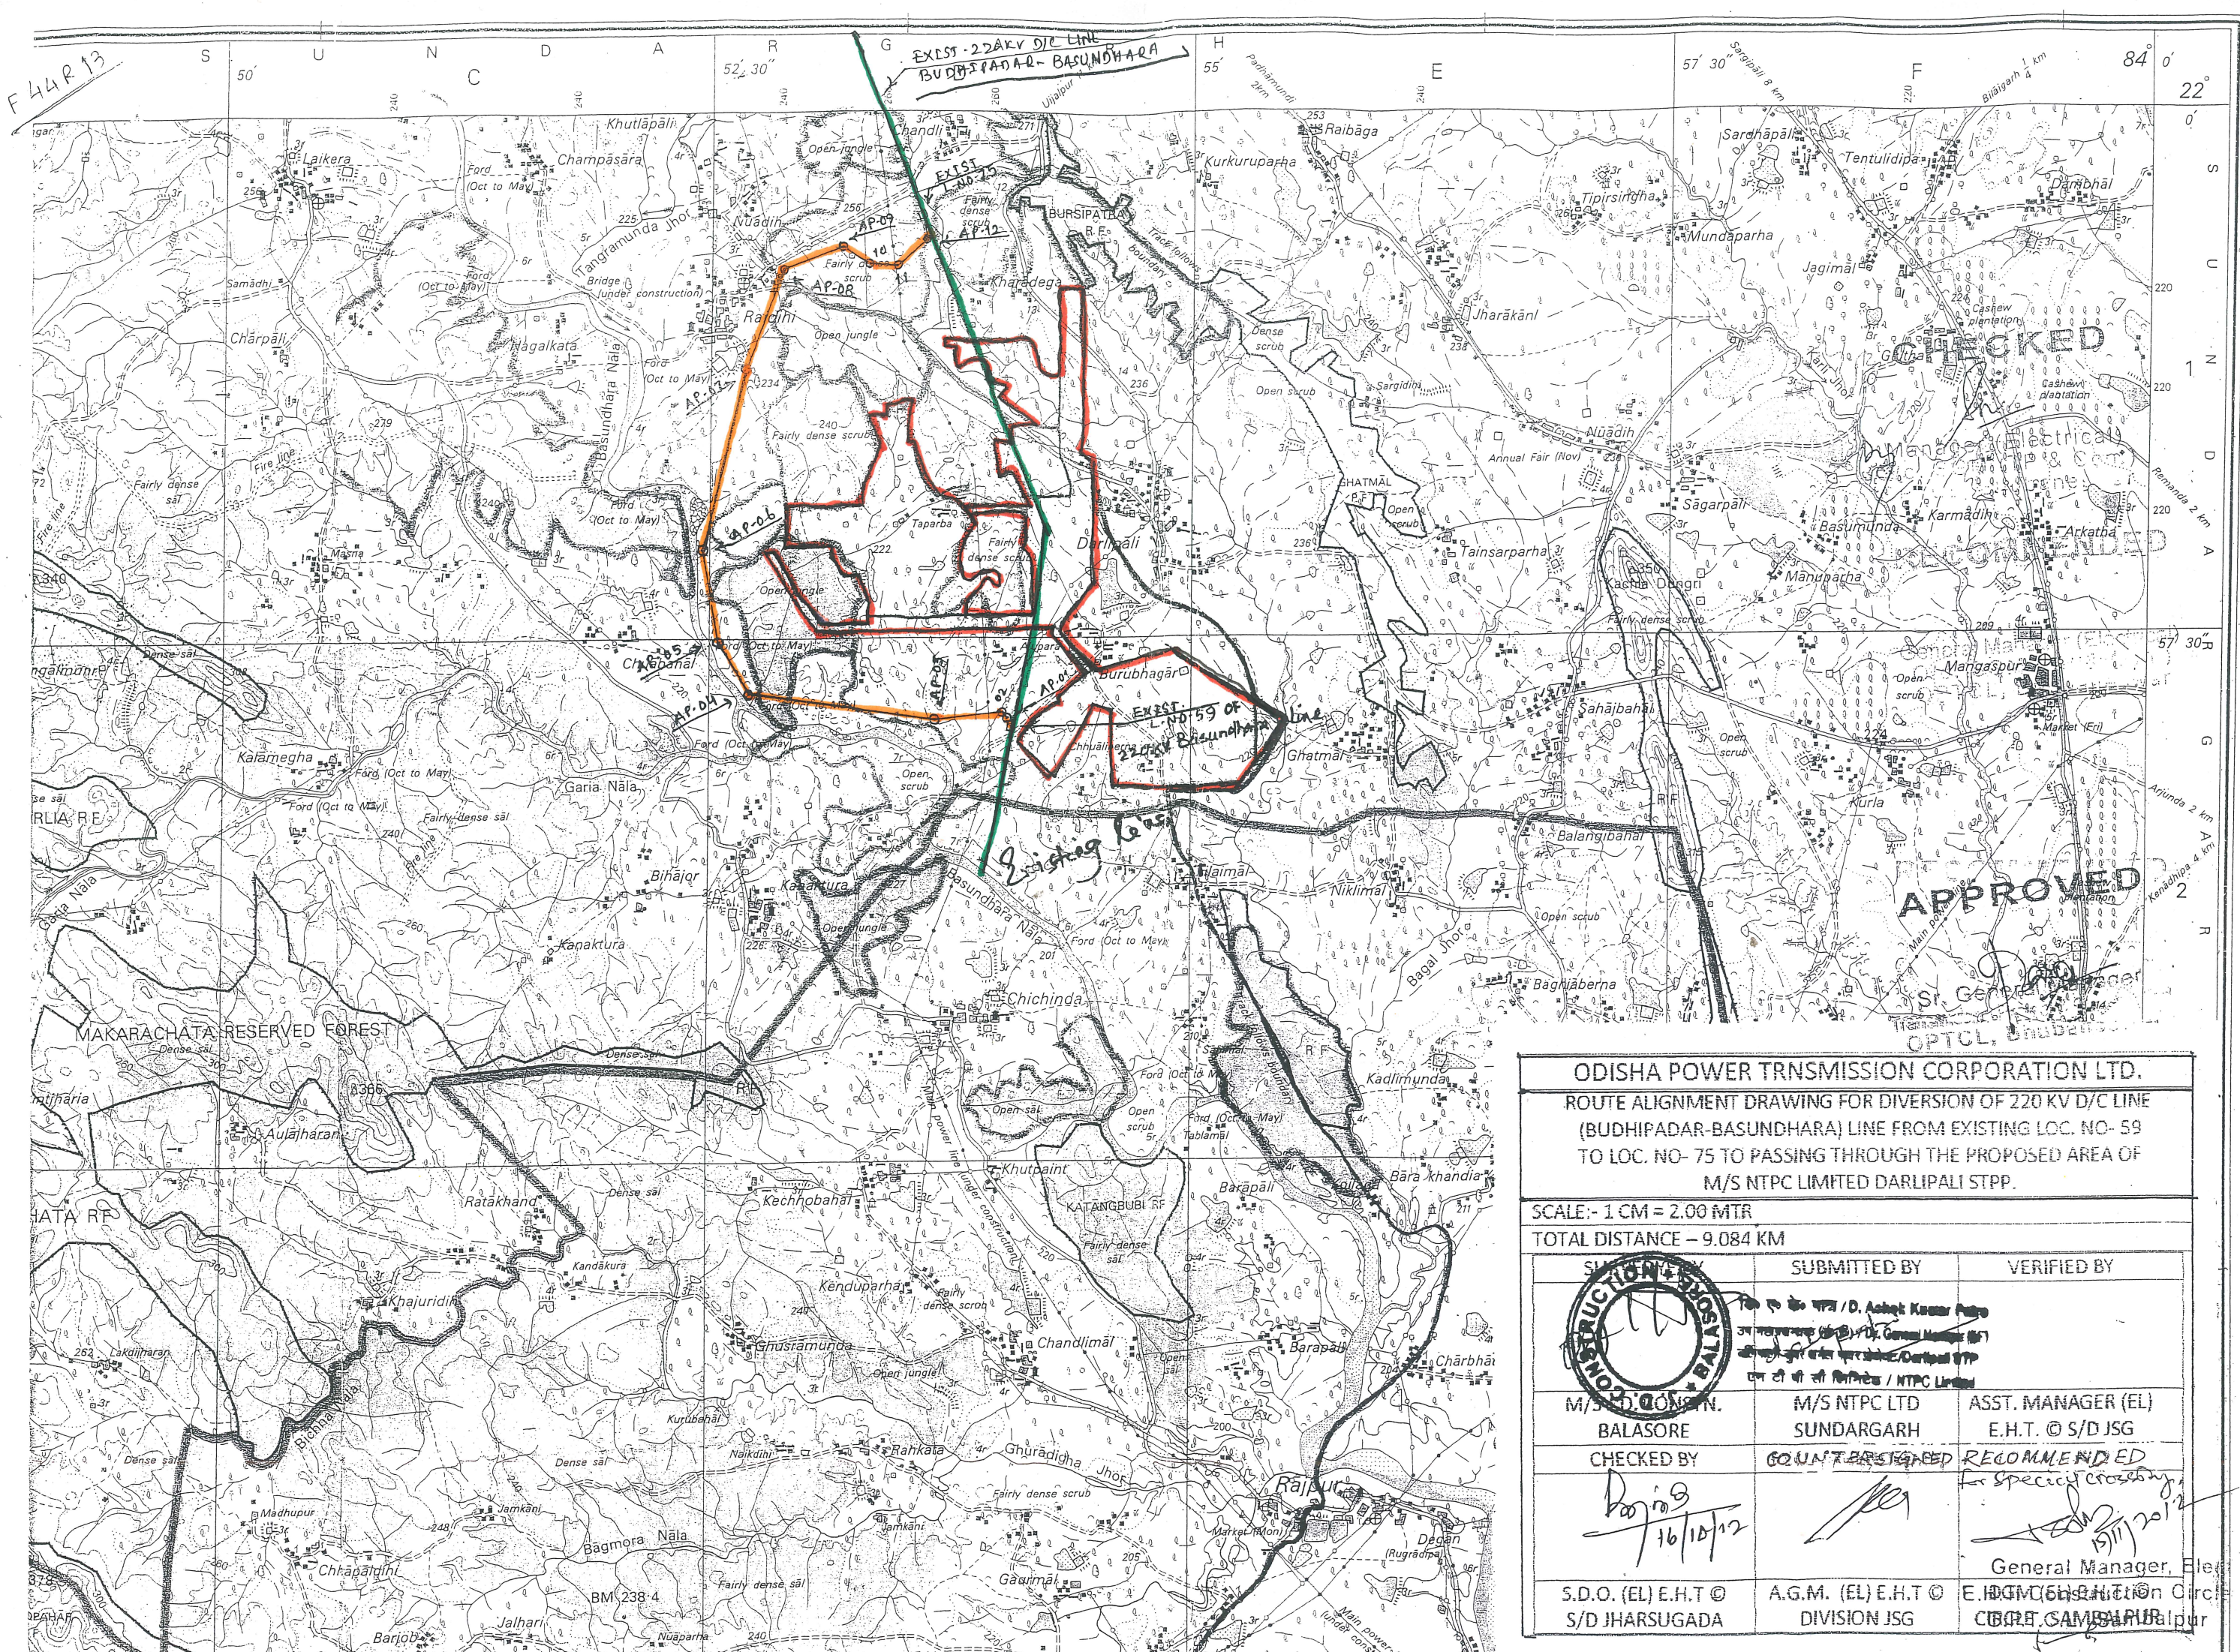

ODISHA POWER TRANSMISSION CORPORATION LTD.		
ROUTE ALIGNMENT DRAWING FOR DIVERSION OF 220 KV D/C LINE (BUDHIPADAR-BASUNDHARA) LINE FROM EXISTING LOC. NO- 59 TO LOC. NO- 75 TO PASSING THROUGH THE PROPOSED AREA OF M/S NTPC LIMITED DARLIPALI STPP.		
SCALE:- 1 CM = 2.00 MTR		
TOTAL DISTANCE - 9.084 KM		
	SUBMITTED BY	VERIFIED BY
	M/S D. G. S. N. BALASORE	M/S NTPC LTD SUNDARGARH
CHECKED BY	COUNTER SIGNED	RECOMMENDED
S.D.O. (EL) E.H.T. © S/D JHARSUGADA	A.G.M. (EL) E.H.T. © DIVISION JSG	E.H.T. © S/D JSG