


73°10'0"E

# PROPOSED ELECTRICAL H.T LINE ALIGNMENT FROM SINDONI MAIN ROAD TO KHEDPA LOHARMAL



0 100 200 400 600  
Meters

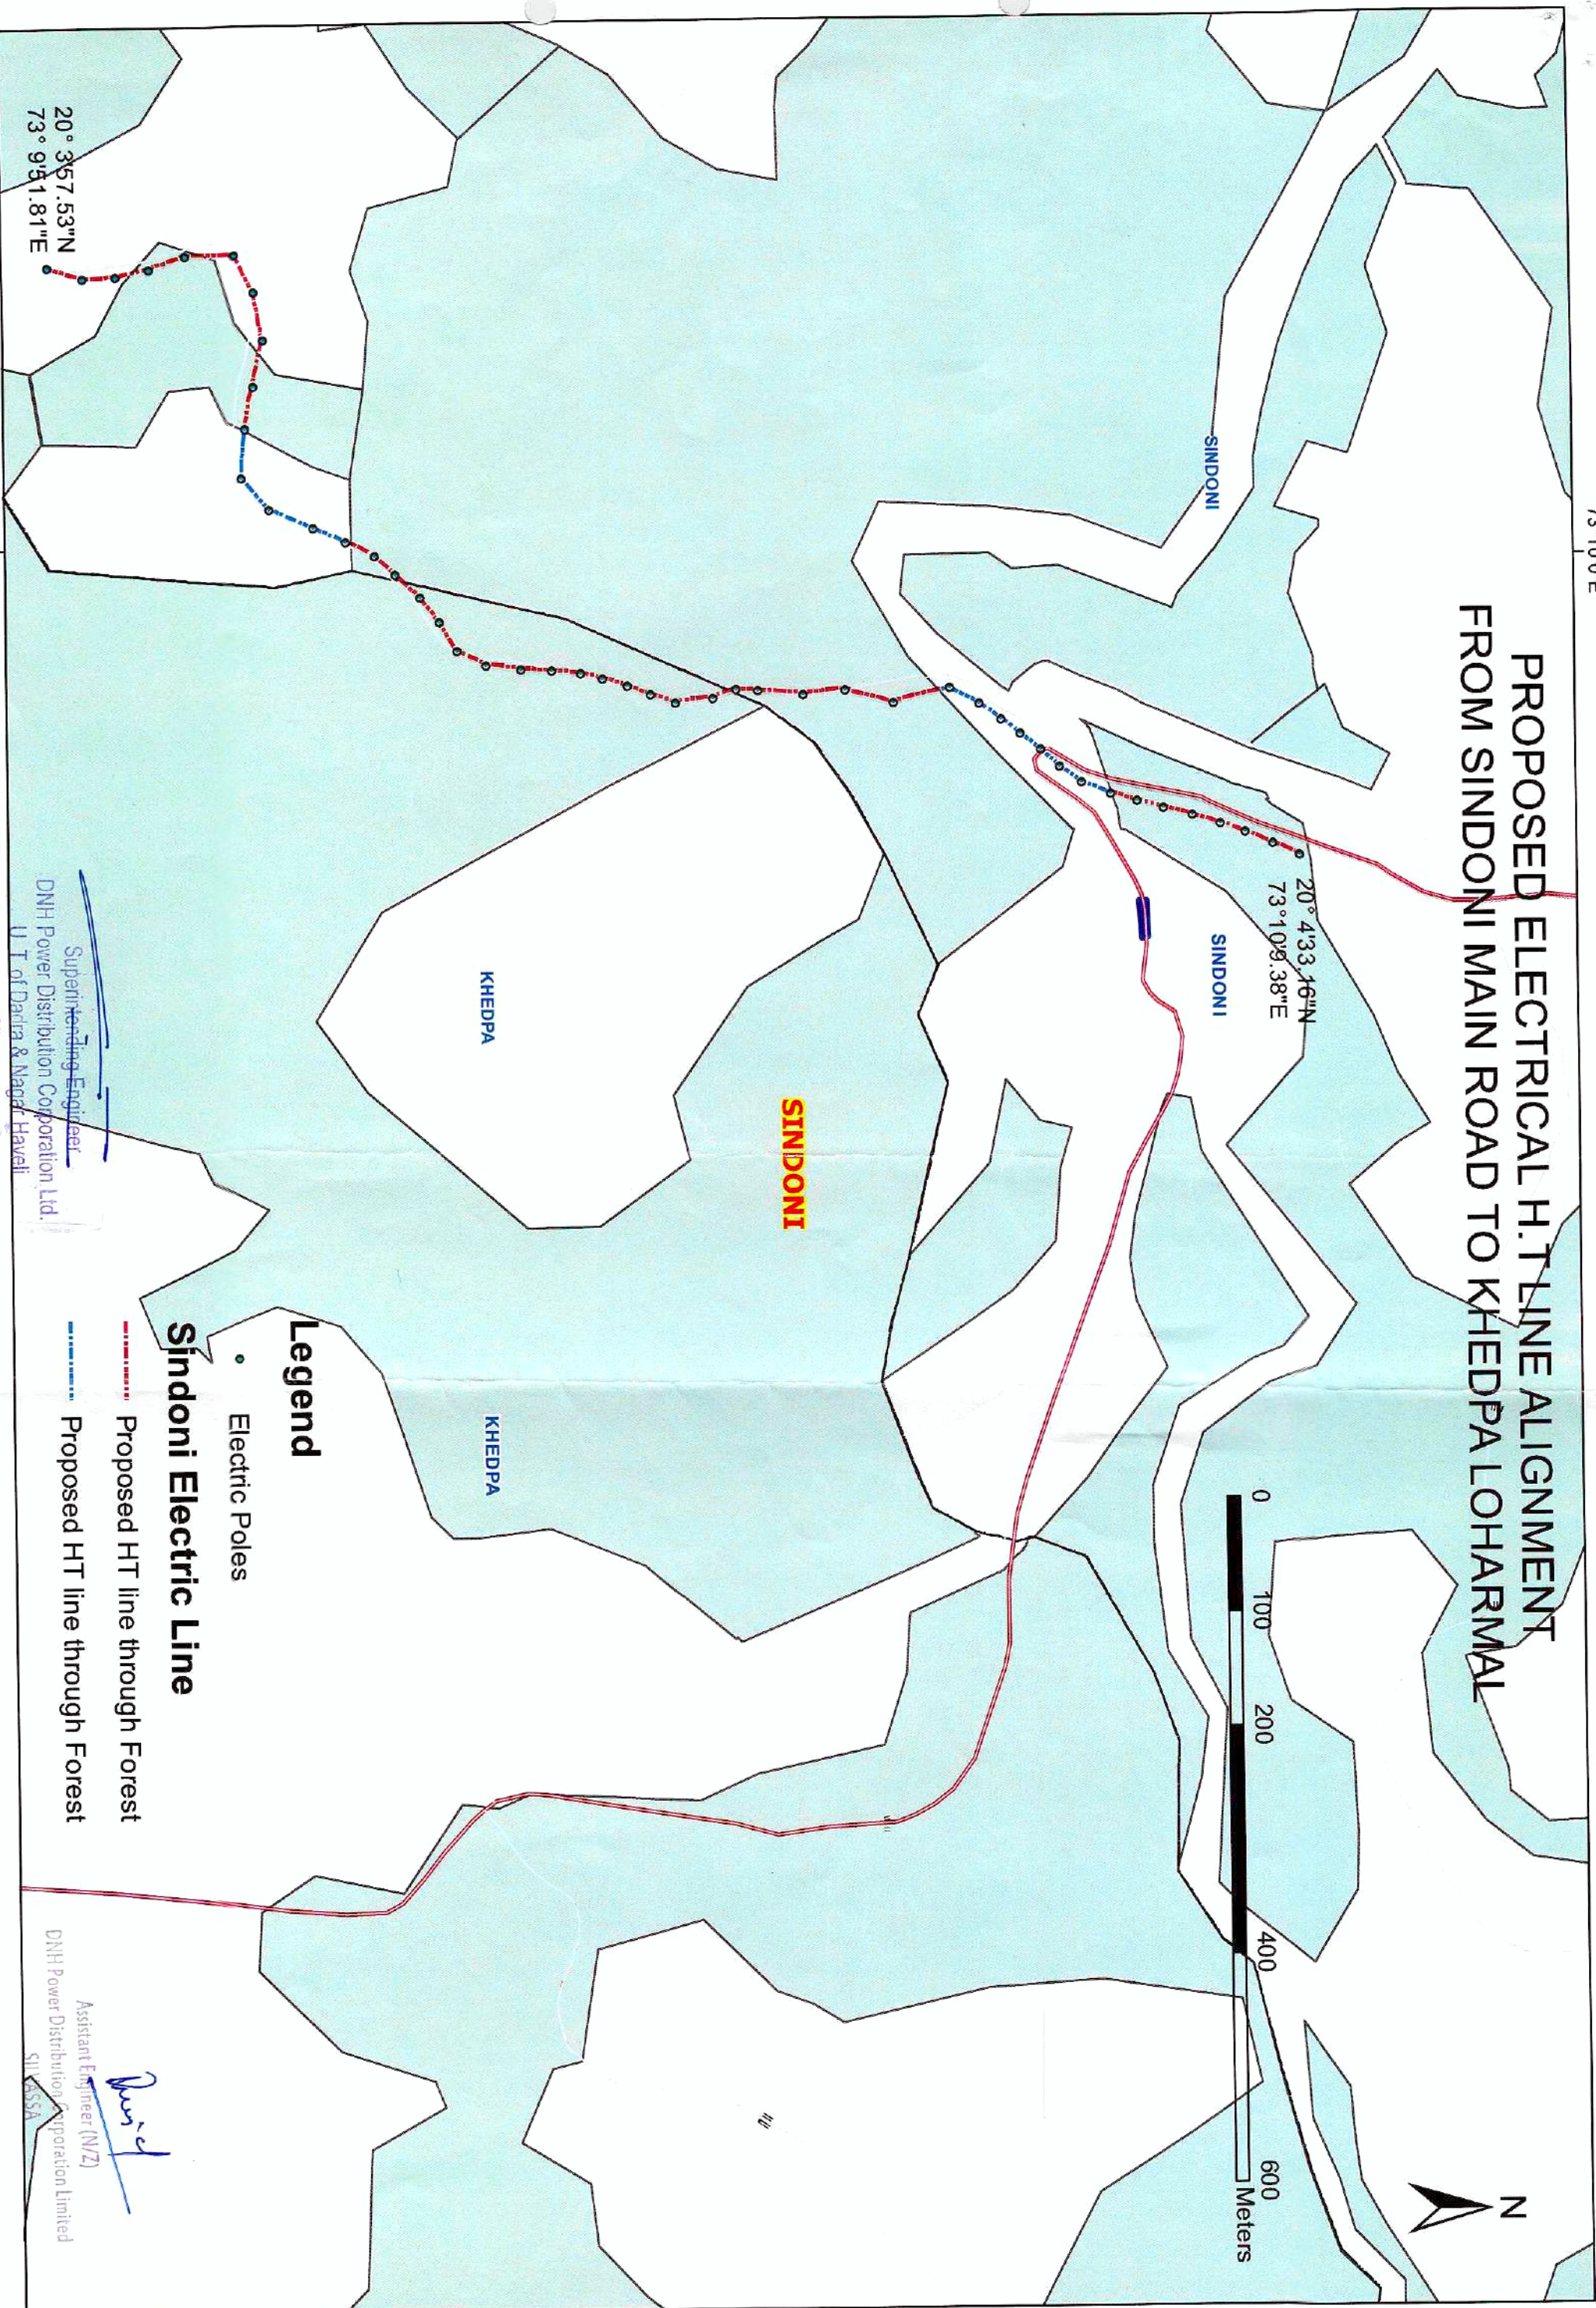

## Legend

- Electric Poles
- Proposed HT line through Forest
- Proposed HT line through Forest

## Sindoni Electric Line

Superintending Engineer  
DNH Power Distribution Corporation Ltd.  
U.T. of Dadra & Nagar Haveli  
Silvassa

Assistant Engineer (N/Z)  
DNH Power Distribution Corporation Limited  
Silvassa