


**RE-ROUTING OF 400 KV S/C DULHASTI KISHANPUR TRANSMISSION LINE FROM
TOWER NO-43 TO 47 AT DRABSHALLA**



1367

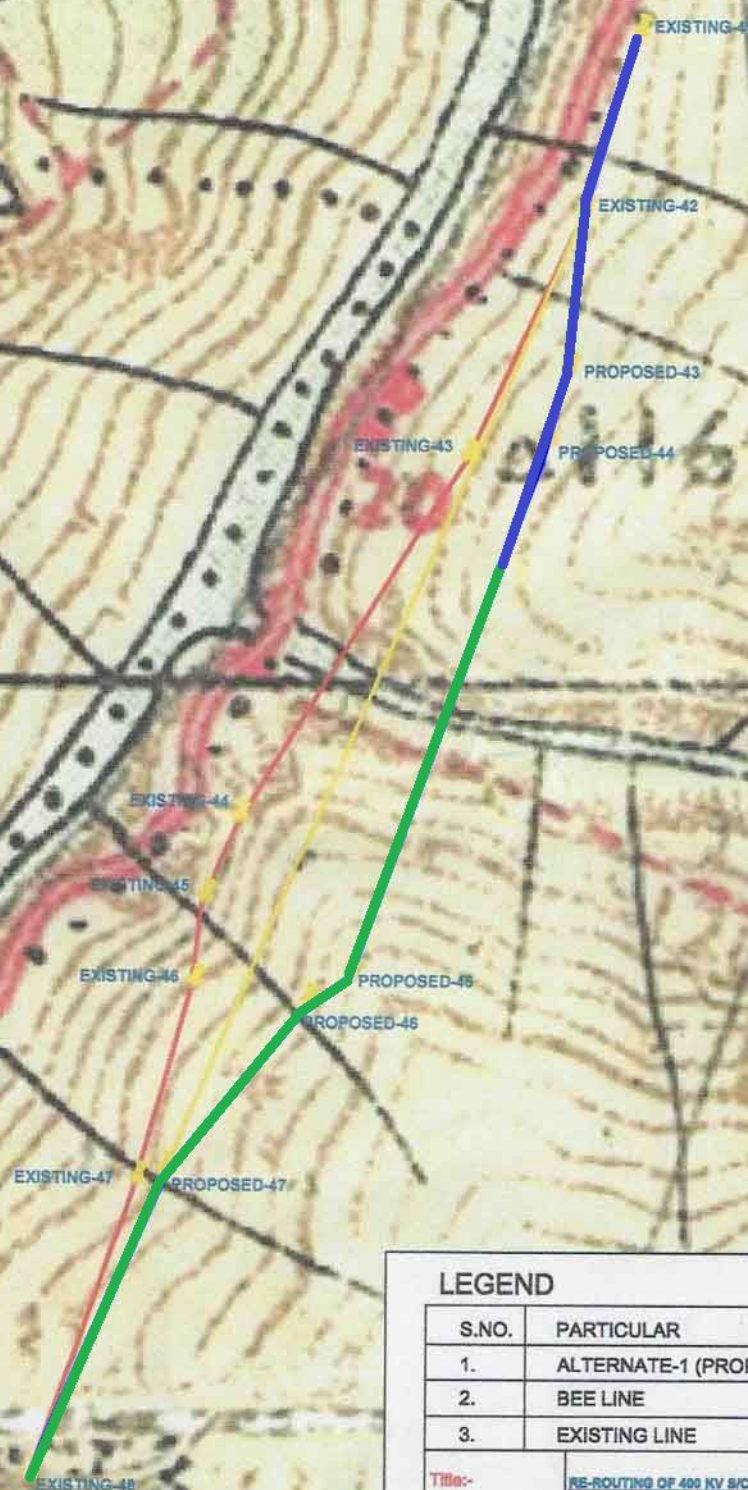

LEGEND

S.NO.	PARTICULAR	SYMBOL
1.	ALTERNATE-1 (PROPOSED)	
2.	BEE LINE	
3.	EXISTING LINE	

Title:- RE-ROUTING OF 400 KV S/C DULHASTI KISHANPUR TRANSMISSION LINE FROM TOWER NO-43 TO 47 AT DRABSHALLA

DRAWING:- Drawing Showing Proposed Line, Existing Line & Bee Route

Client:- M/S POWER GRID CORPORATION OF INDIA Ltd.

CONTRACTOR:- M/S VINAY CONSTRUCTION COMPANY
H.NO. 32/C, SECTOR -7, VAISHNAVI ENCLAVE
CHANNI HIMMAT JAMMU - 180015

Surveyed by.	Submitted by.	Checked by.	Recommended by.	Approved by.
VCC	VCC	PGCIL	PGCIL	PGCIL

[Signature]
Chief Engineer (Elect.)
PGCIL

Behind 151
BATO...

[Signature]
Extension
Channi Himmat
Jammu