


Map showing Diversion of Forest Land proposed to construct 220 KV DC line from 400/220/132 KV Gajwel SS to 220/132 KV Siddipet SS in favor of EE, Construction, TS TRANSCO, Siddipet District.

Length of line = 1280.69 mts
Area in Ha = 1280.69 X 35 = 4.482 Ha

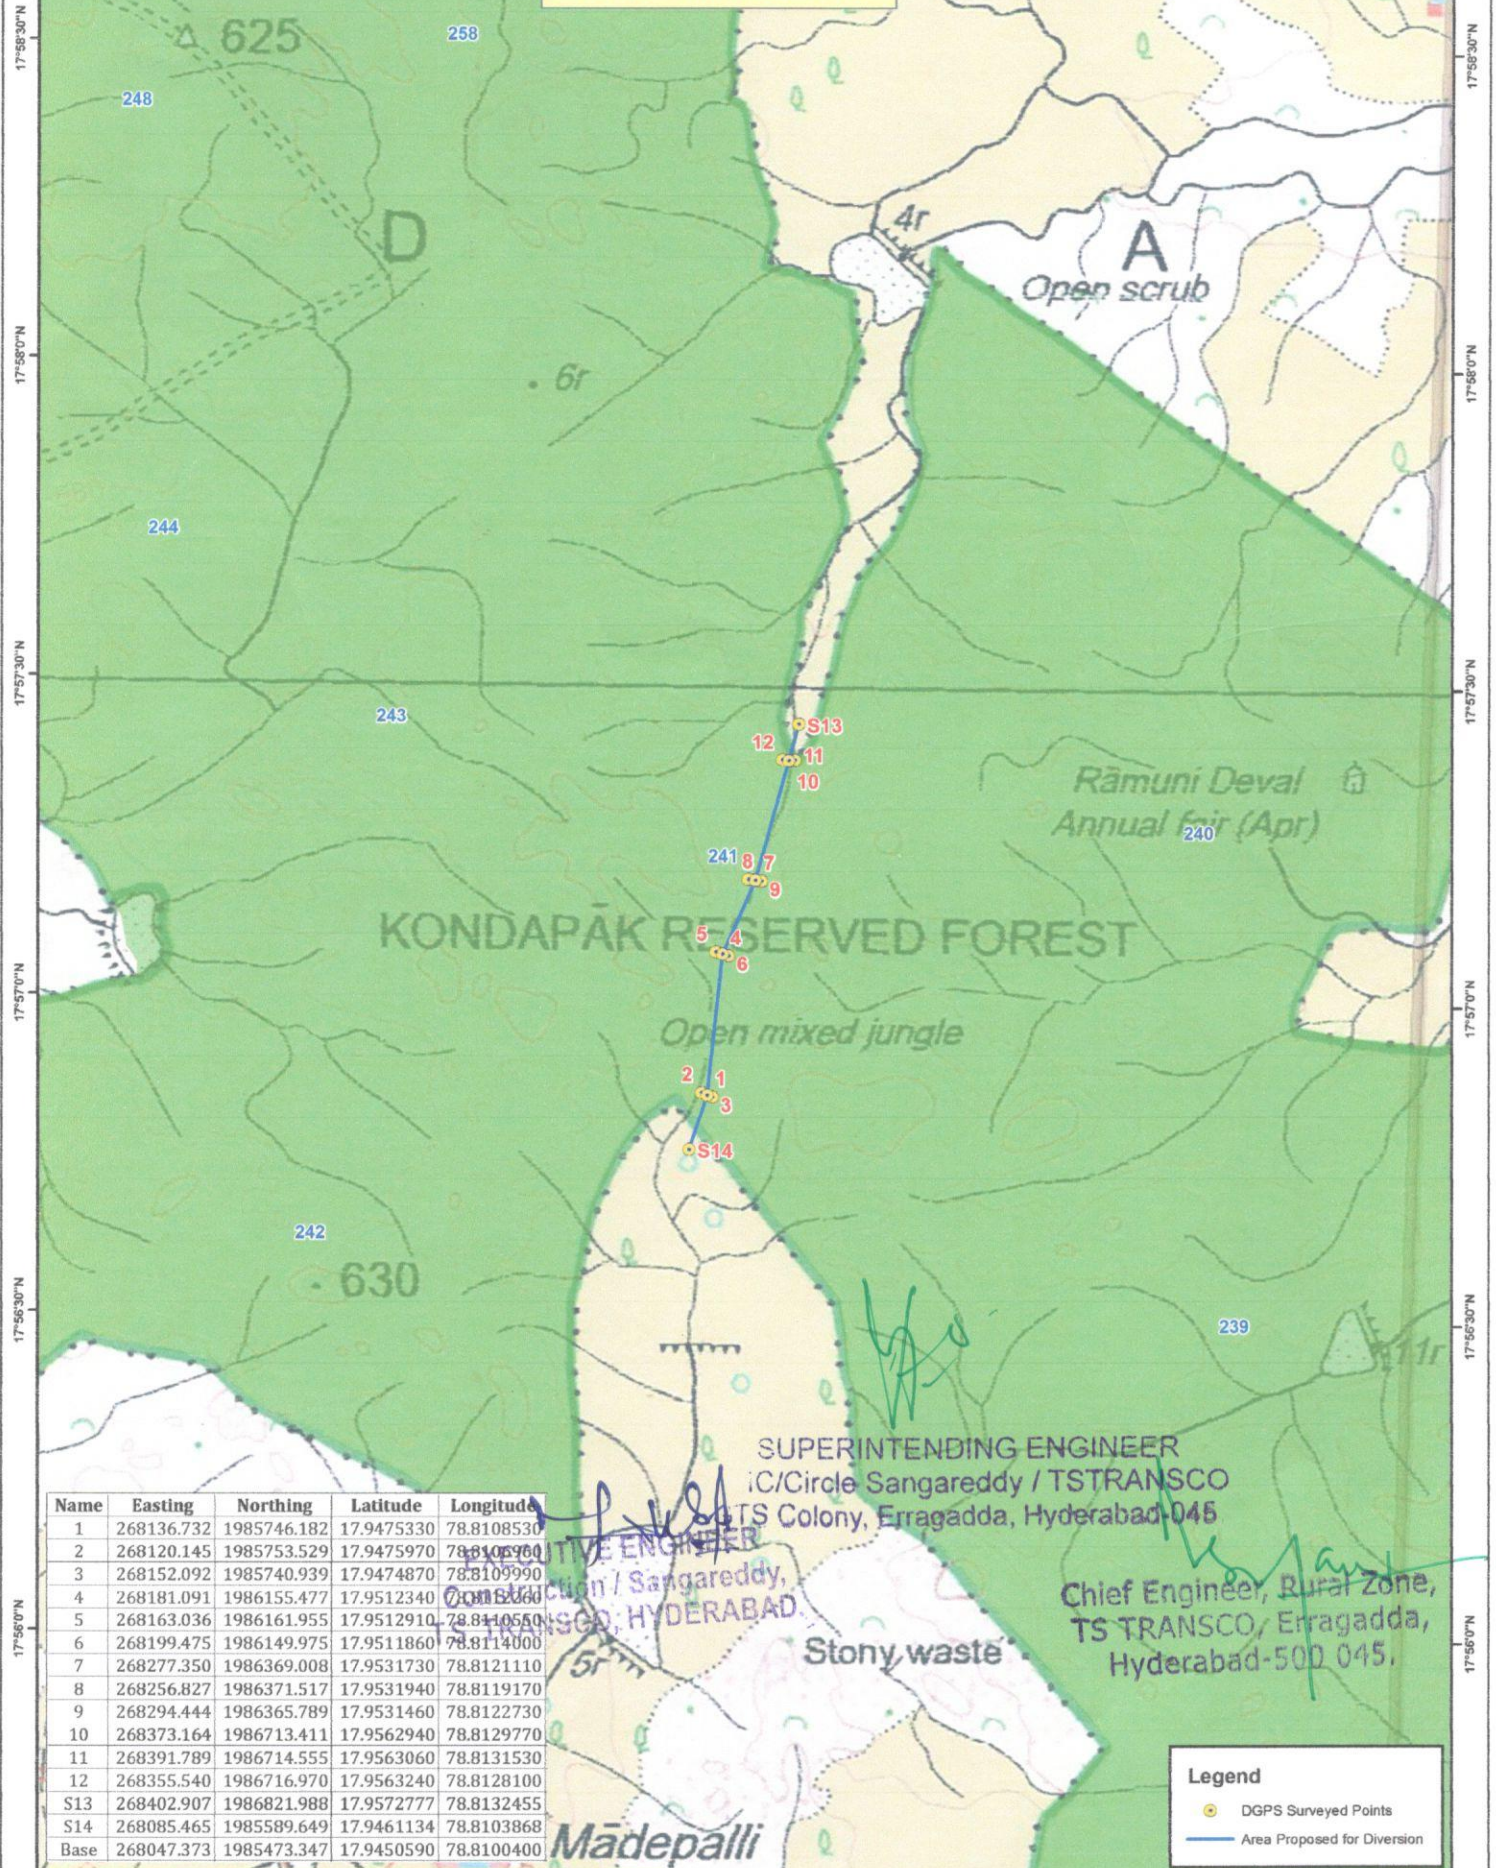

SUPERINTENDING ENGINEER
IC/Circle Sangareddy / TSTRANSCO
TS Colony, Erragadda, Hyderabad-500 045

Chief Engineer, Rural Zone,
TS TRANSCO, Erragadda,
Hyderabad-500 045.

Mādepalli