


RE-ROUTING OF 400 KV S/C DULHASTI KISHANPUR TRANSMISSION LINE FROM TOWER NO-43 TO 47 AT DRABSHALLA



ANNEXURE-08

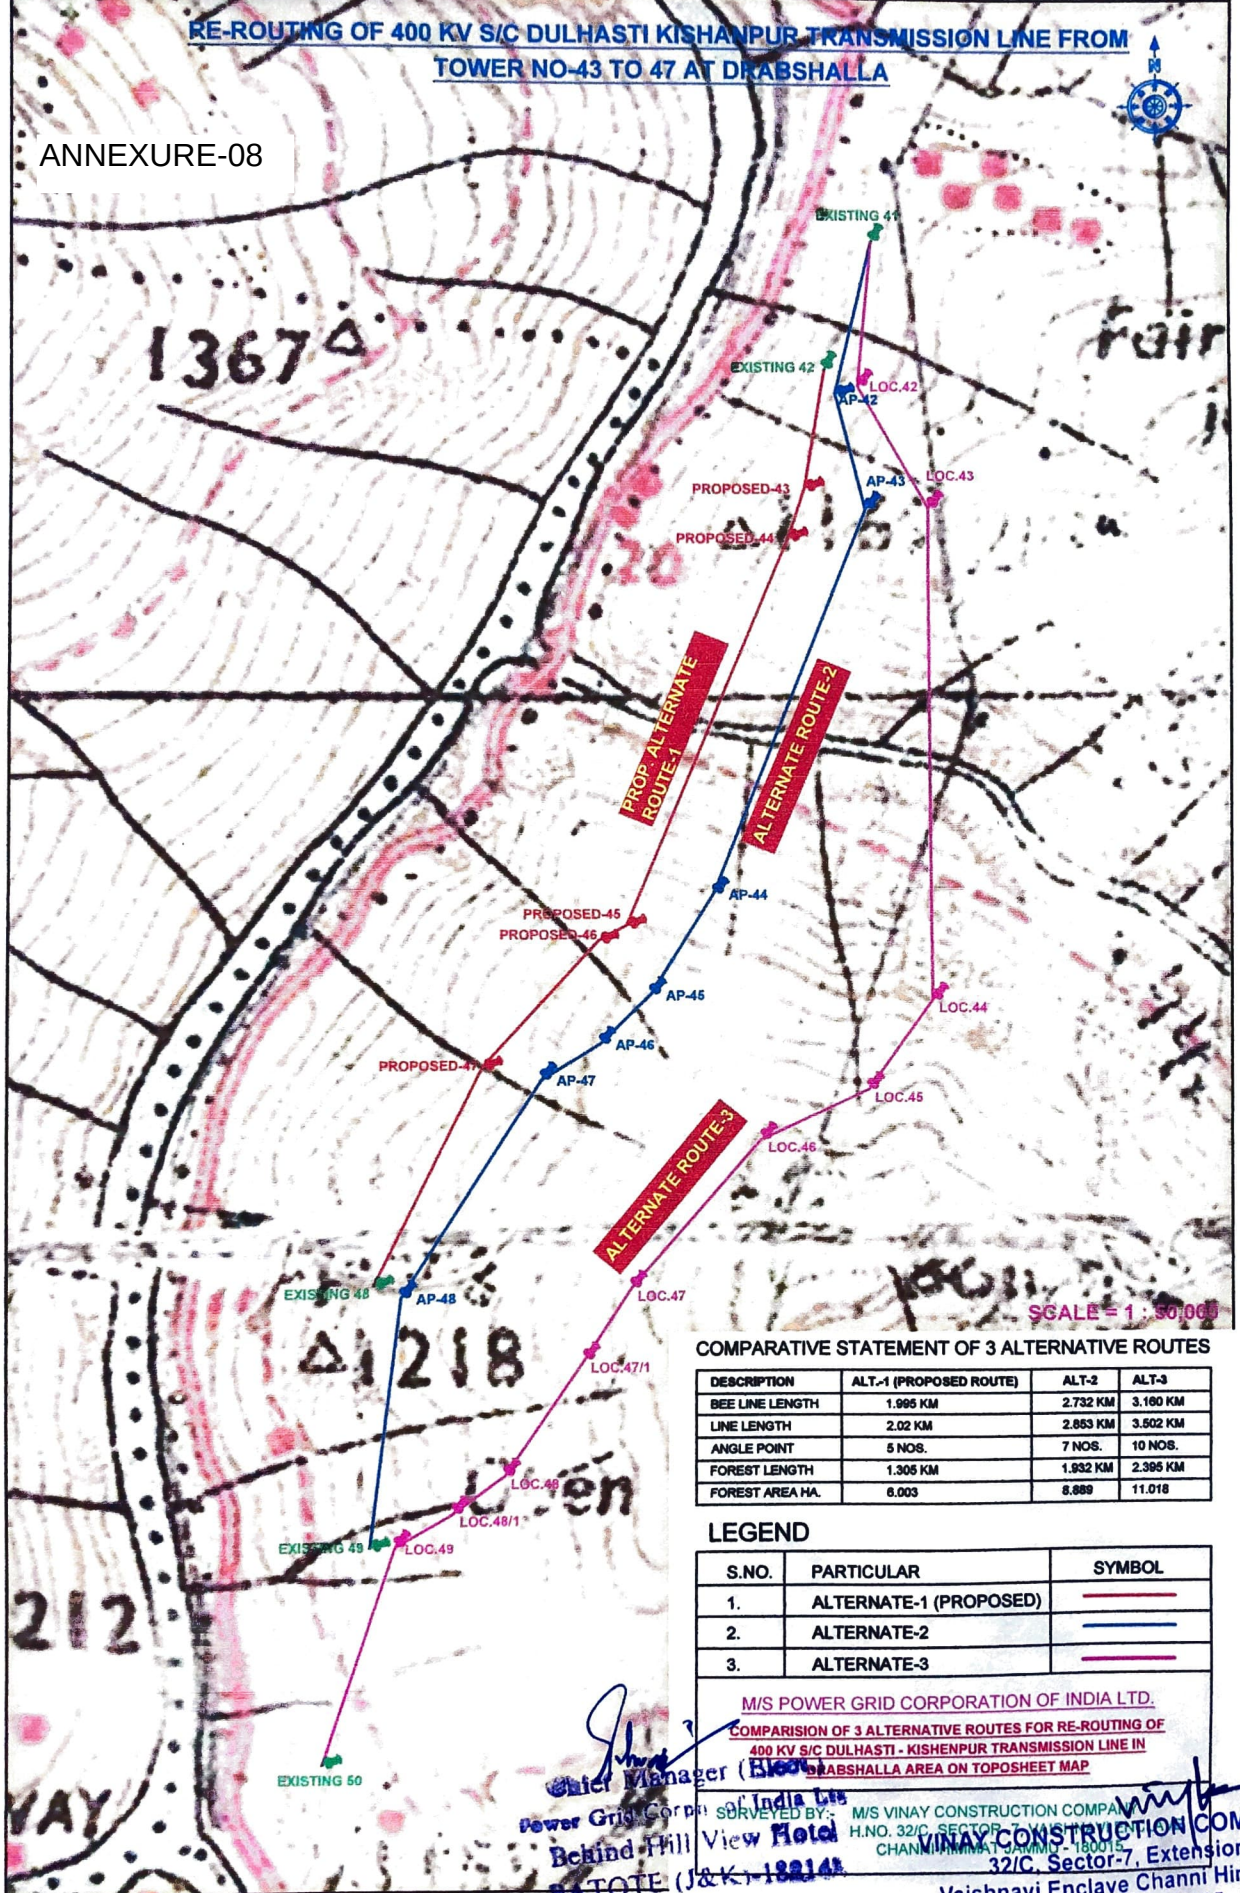

SCALE = 1 : 50,000

COMPARATIVE STATEMENT OF 3 ALTERNATIVE ROUTES

DESCRIPTION	ALT-1 (PROPOSED ROUTE)	ALT-2	ALT-3
BEE LINE LENGTH	1.995 KM	2.732 KM	3.180 KM
LINE LENGTH	2.02 KM	2.853 KM	3.502 KM
ANGLE POINT	5 NOS.	7 NOS.	10 NOS.
FOREST LENGTH	1.305 KM	1.932 KM	2.395 KM
FOREST AREA HA.	6.003	8.889	11.018

LEGEND

S.NO.	PARTICULAR	SYMBOL
1.	ALTERNATE-1 (PROPOSED)	—
2.	ALTERNATE-2	—
3.	ALTERNATE-3	—

M/S POWER GRID CORPORATION OF INDIA LTD.

COMPARISON OF 3 ALTERNATIVE ROUTES FOR RE-ROUTING OF
400 KV S/C DULHASTI - KISHANPUR TRANSMISSION LINE IN
DRABSHALLA AREA ON TOPOSHEET MAP

Chief Manager (Electrical)
Power Grid Corp. of India Ltd.
Behind Hill View Road
Bhatote (J&K) - 182141

M/S VINAY CONSTRUCTION COMPANY
H.NO. 32/C, SECTOR-7, CHANNI HIMMAT - 180015
VINAY CONSTRUCTION COMPANY
32/C, Sector-7, Extension
Vaishnavi Enclave Channi Himmat,
Jammu Pin - 180015