


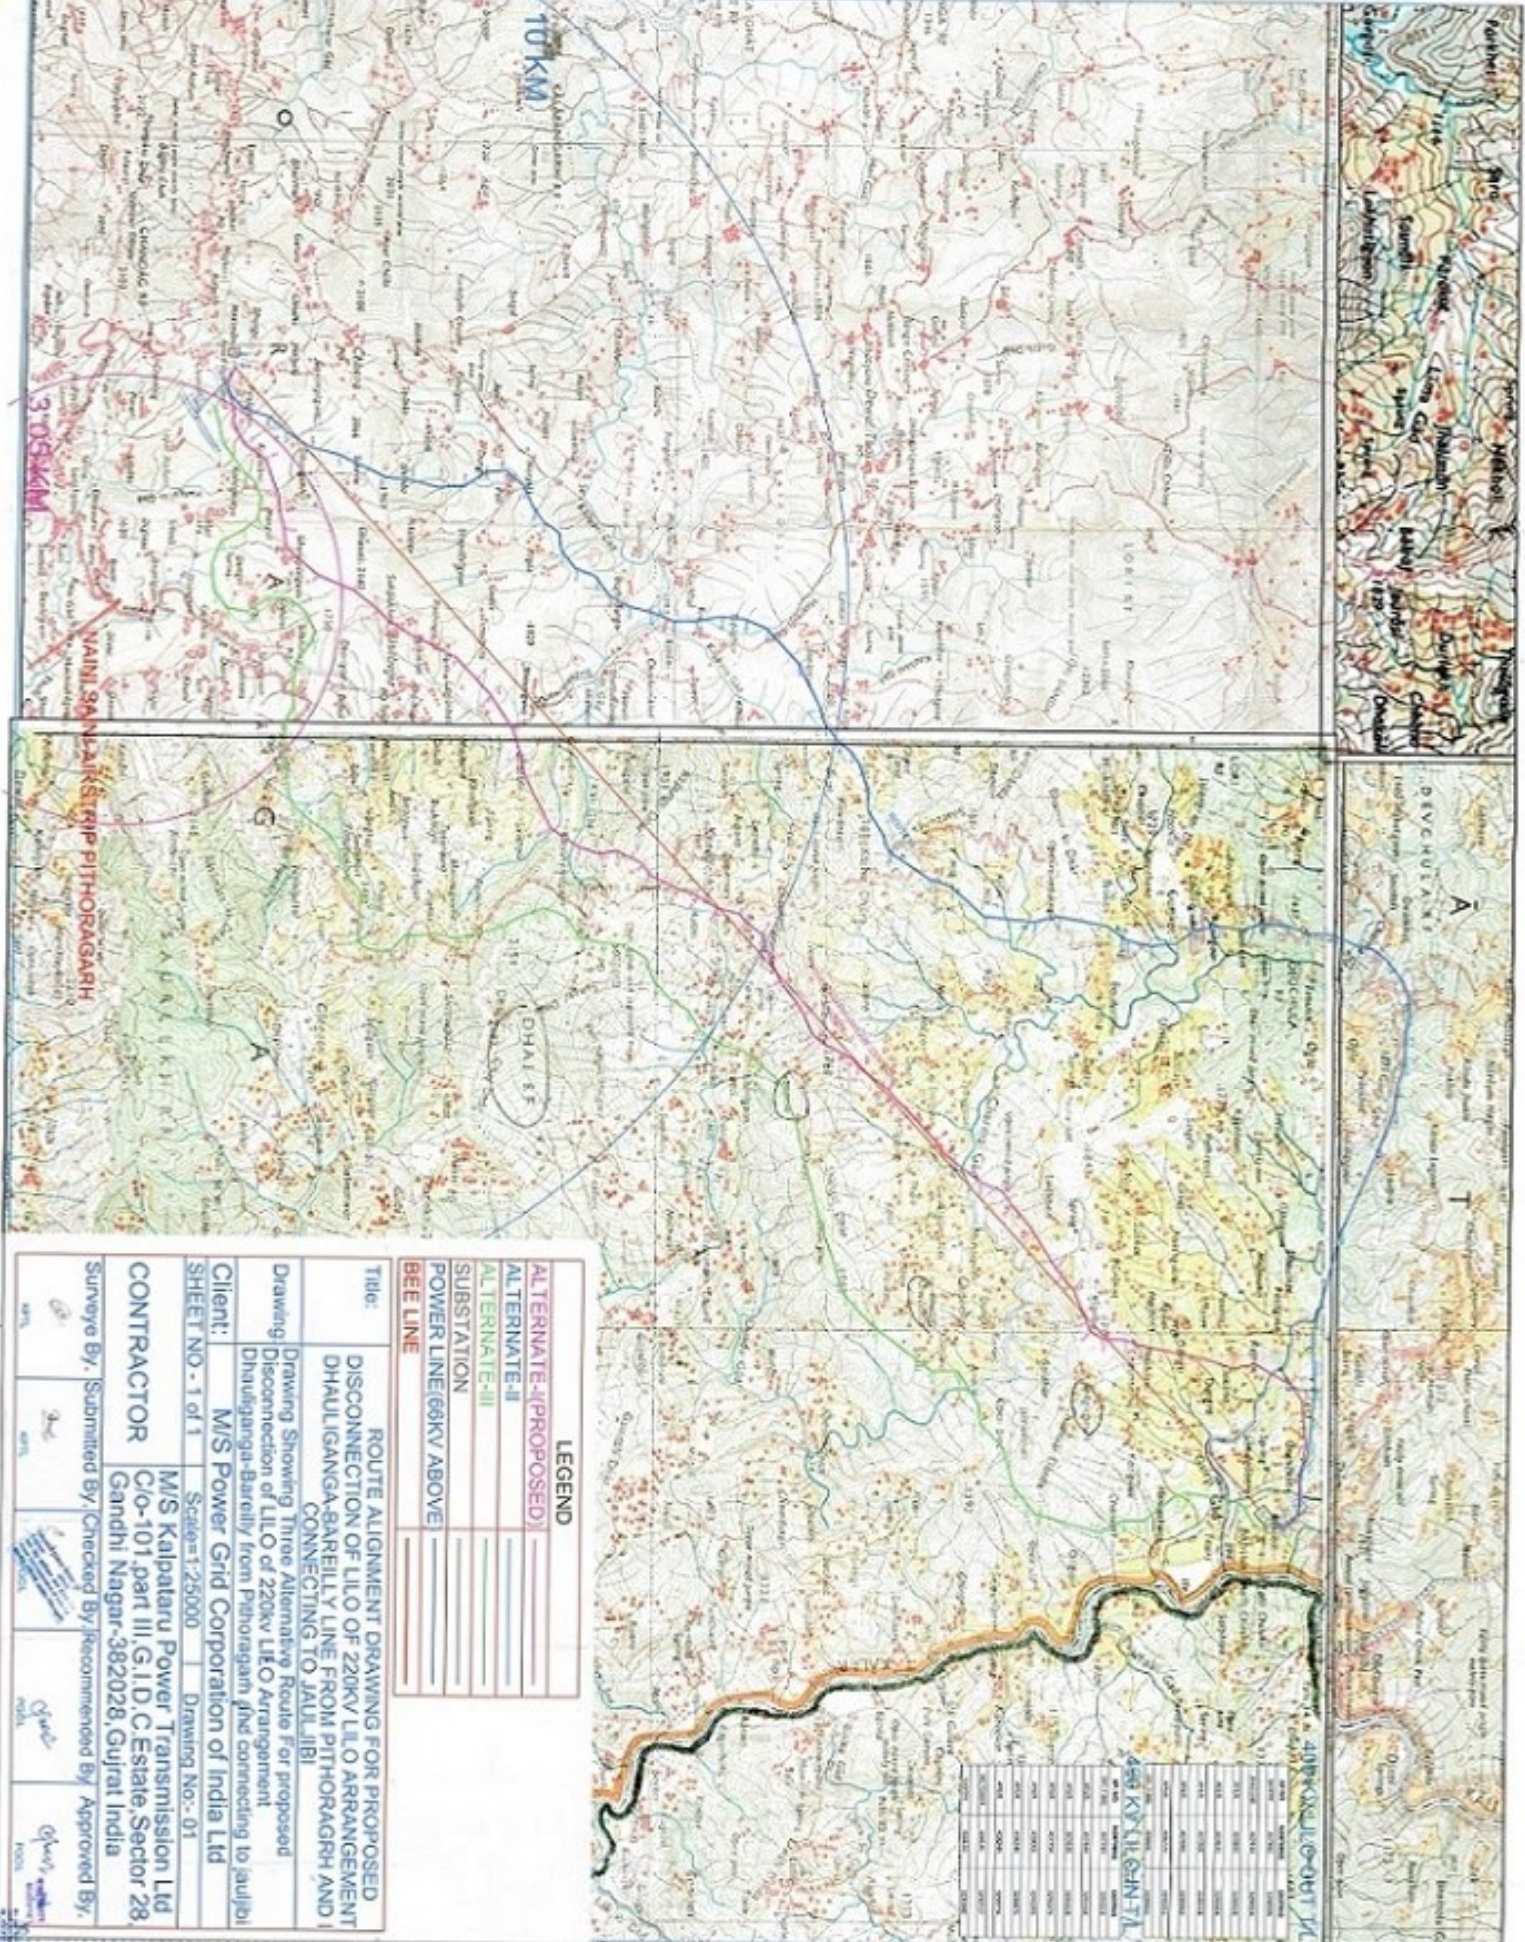

LEGEND	
ALTERNATE-I (PROPOSED)	—
ALTERNATE-II	—
ALTERNATE-III	—
SUBSTATION	—
POWER LINE (66KV ABOVE)	—
BEE LINE	—

TITLE:	ROUTE ALIGNMENT DRAWING FOR PROPOSED DISCONNECTION OF L.I.O. OF 220KV L.I.O. ARRANGEMENT DHAILIGANGA-BAREILLY LINE FROM PITHORAGRAH AND CONNECTING TO JAULJIBI
Drawing:	Drawing Showing Three Alternative Route For proposed Disconnection of L.I.O. of 220KV L.I.O. Arrangement Dhailiganga-Bareilly from Pithoragah gnd connecting to Jauljibi
Client:	M/S Power Grid Corporation of India Ltd
SHEET NO. 1 of 1	Scale: 1:25000 Drawing No.: 01
CONTRACTOR	M/S Kalpataru Power Transmission Ltd C/o-101, part III, G.I.D.C. Estate, Sector 28, Gandhi Nagar-382028, Gujarat India
Surveye By:	Submitted By: Checked By: Recommended By: Approved By:

Station	Altitude	Distance	Remarks
1	1100	0.00	Start of L.I.O. line
2	1050	0.50	
3	1000	1.00	
4	950	1.50	
5	900	2.00	
6	850	2.50	
7	800	3.00	
8	750	3.50	
9	700	4.00	
10	650	4.50	
11	600	5.00	
12	550	5.50	
13	500	6.00	
14	450	6.50	
15	400	7.00	
16	350	7.50	
17	300	8.00	
18	250	8.50	
19	200	9.00	
20	150	9.50	
21	100	10.00	End of L.I.O. line