



**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

O/c

From, Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati - 444 603 Email :- <a href="mailto:ee1620@mahatransco.in">ee1620@mahatransco.in</a> Phone No. 0721 - 2669168	To, Deputy Conservator of Forests Nagpur Forest Division Nagpur
--	--

Ref.: MSETCL/EE/EHV/Project Din./Amravati/Tech/ 604

Date: 24/03/2025

Sub.: Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud  
Transmission Line.  
- Proposal No. FP/MH/TRANS/38296/2019  
- Compliance to conditions at in-principal (Stage- I ) Approval for final approval regarding

- Ref.: 1) In-Principle approval from MoEFCC Nagpur E-Sign letter dated 20/03/2025  
2) T.O.L. No. MSETCL/EE/EHV/Project Din./Amravati/Tech/ No. 450 Dated 07/03/2025, request for demand letter  
3) Y.O.L. No. Desk-17/Conservation/C.R. 487/3963/2024-25 dated 21/03/2025 for demand letter  
4) Demand letter uploaded at PARIVESH and approval thereof on 24/03/2025  
5) Payment to CAMPA as per approved demand letter Rs. 4,64,08,820/- on date 24/03/2025

Dear Sir,

Please find compliance to the conditions stipulated vide order for in principal approval as below.

SN	Conditions	Compliances
i	Legal status of the land shall remain unchanged	Undertaking for Legal status of the land will remain unchanged is enclosed. Encl.: Exhibit-1
ii	The Regional Office, Nagpur shall initiate action under section 3A/3B of Van (SanrakshanEvamSamvardhan) Adhiniyam, 1980 (as applicable).	Undertaking for The Regional Office, Nagpur shall initiate action under section 3A/3B of Van (SanrakshanEvamSamvardhan) Adhiniyam, 1980 (as applicable). Encl.: Exhibit-2
iii	Compensatory Afforestation: a. Compensatory Afforestation over the identified degraded forest land of 12.50 ha on Compartment no. 251, Survey no. 328 of Village Kurhad, Taluka Ghatanji, District Yavatmal. Maharashtra State shall be raised at	As per approved demand letter the payments are deposited to CAMPA as below 1) CA : Rs. 1,10,92,313/- 2) NPV : Rs. 58,19,471/- 3) Penal NPV Rs. 2,22,25,285/- 4) Medicinal Plantation Rs. 53,91,751/-

24/3/2025  
नगपूर येनायक, नगपूर

	<p>the project cost under the supervision of the State Forest Department and afforestation works shall start within two years from the date of final approval and maintained thereafter in accordance with the approved CA scheme in consultation with the State Forest Department;</p>	<p>5) Boundary Pillars Rs. 13,50,000/- 6) Alternative Bird Nests Rs. 5,30,000/-</p> <hr/> <p>Total Rs. 4,64,08,820/-</p> <p>(Four crore sixty four lakh eight thousand eight hundred twenty only) is paid from Bank of Baroda, Amravati vide UTR details as below to Ad-Hoc CAMPA through e-portal(<a href="https://parivesh.nic.in">https://parivesh.nic.in</a>).</p> <p>Bank UTR No. BARBR52025032400974445 dated 24/03/2025. Rs. 4,64,08,820/-</p> <p>Encl.: Exhibit-3A and the screenshot shot of payment made and payment status as per Parivesh portal.</p>
	<p>b. The User Agency shall transfer the cost of raising and maintaining the compensatory afforestation as per the approved CA scheme at the current wage rate in consultation with State Forest Department in the account of CAMPA of the concerned State through online portal;</p>	<p>As per approved demand letter the payments are deposited to CAMPA as below</p> <p>1) CA : Rs. 1,10,92,313/- 2) NPV : Rs. 58,19,471/- 3) Penal NPV Rs. 2,22,25,285/- 4) Medicinal Plantation Rs. 53,91,751/- 5) Boundary Pillars Rs. 13,50,000/- 6) Alternative Bird Nests Rs. 5,30,000/-</p> <hr/> <p>Total Rs. 4,64,08,820/-</p> <p>(Four crore sixty four lakh eight thousand eight hundred twenty only) is paid from Bank of Baroda, Amravati vide UTR details as below to Ad-Hoc CAMPA through e-portal(<a href="https://parivesh.nic.in">https://parivesh.nic.in</a>).</p> <p>Bank UTR No. BARBR52025032400974445 dated 24/03/2025. Rs. 4,64,08,820/-</p> <p>Encl.: Exhibit-3B and the screenshot shot of payment made and payment status as per Parivesh portal</p>
	<p>c) The cost of survey, demarcation and erection of permanent pillars, if required on the identified CA land, shall be deposited in advance with the Forest Department by the user agency. The CA will be maintained for 10 years. The scheme may include afforestation of indigenous species with appropriate provision for anticipated cost increase for works</p>	<p>As per approved demand letter the payments are deposited to CAMPA as below</p> <p>1) CA : Rs. 1,10,92,313/- 2) NPV : Rs. 58,19,471/- 3) Penal NPV Rs. 2,22,25,285/- 4) Medicinal Plantation Rs. 53,91,751/- 5) Boundary Pillars Rs. 13,50,000/- 6) Alternative Bird Nests Rs. 5,30,000/-</p> <hr/> <p>Total Rs. 4,64,08,820/-</p> <p>(Four crore sixty four lakh eight thousand eight</p>

	<p>scheduled for subsequent years;</p>	<p>hundred twenty only) is paid from Bank of Baroda, Amravati vide UTR details as below to Ad-Hoc CAMPAs through e-portal(<a href="https://parivesh.nic.in">https://parivesh.nic.in</a>)</p> <p>Bank UTR No. BARBR52025032400974445 dated 24/03/2025 Rs. 4,64,08,820/-</p> <p>Cost of survey, demarcation and fencing is covered under payment for CA scheme</p> <p>Encl: Exhibit-3C and the screenshot shot of payment made and payment status as per Parivesh portal</p>																
	<p>d) The land identified for the purpose of CA shall be clearly depicted on Survey of India topo sheet map of 1:50,000 scale;</p>	<p>Undertaking for The land identified for the purpose of CA shall be clearly depicted on Survey of India topo sheet map of 1:50,000 scale is attached</p> <p>Encl: Exhibit-3D &amp; Topo sheet Map</p>																
	<p>e) The matter regarding imposition of penal CA is under consideration for the formulation of a uniform policy guideline in the matter. Keeping this in view, the imposition of penal CA (if any) shall be as per the said guideline, if applicable.</p>	<p>Undertaking regarding imposition of penal CA is under consideration is attached</p> <p>Encl: Exhibit-3E</p>																
iv	<p>Net Present Value:-</p> <p>a. The User Agency shall transfer the funds towards the cost of Net Present Value (NPV) of the forest land being diverted under this proposal in accordance with the MoEF&amp;CC's guidelines;</p>	<p>As per approved demand letter the payments are deposited to CAMPAs as below</p> <table border="0"> <tr> <td>1) CA :</td> <td>Rs. 1,10,92,313/-</td> </tr> <tr> <td>2) NPV :</td> <td>Rs. 58,19,471/-</td> </tr> <tr> <td>3) Penal NPV</td> <td>Rs. 2,22,25,285/-</td> </tr> <tr> <td>4) Medicinal Plantation</td> <td>Rs. 53,91,751/-</td> </tr> <tr> <td>5) Boundary Pillars</td> <td>Rs. 13,50,000/-</td> </tr> <tr> <td>6) Alternative Bird Nests</td> <td>Rs. 5,30,000/-</td> </tr> <tr> <td colspan="2"><hr/></td> </tr> <tr> <td>Total</td> <td>Rs. 4,64,08,820/-</td> </tr> </table> <p>(Four crore sixty four lakh eight thousand eight hundred twenty only) is paid from Bank of Baroda, Amravati vide UTR details as below to Ad-Hoc CAMPAs through e-portal(<a href="https://parivesh.nic.in">https://parivesh.nic.in</a>)</p> <p>Bank UTR No. BARBR52025032400974445 dated 24/03/2025. Rs. 4,64,08,820/-</p> <p>Encl.: Exhibit-4(a) and the screenshot shot of payment made and payment status as per Parivesh portal.</p>	1) CA :	Rs. 1,10,92,313/-	2) NPV :	Rs. 58,19,471/-	3) Penal NPV	Rs. 2,22,25,285/-	4) Medicinal Plantation	Rs. 53,91,751/-	5) Boundary Pillars	Rs. 13,50,000/-	6) Alternative Bird Nests	Rs. 5,30,000/-	<hr/>		Total	Rs. 4,64,08,820/-
1) CA :	Rs. 1,10,92,313/-																	
2) NPV :	Rs. 58,19,471/-																	
3) Penal NPV	Rs. 2,22,25,285/-																	
4) Medicinal Plantation	Rs. 53,91,751/-																	
5) Boundary Pillars	Rs. 13,50,000/-																	
6) Alternative Bird Nests	Rs. 5,30,000/-																	
<hr/>																		
Total	Rs. 4,64,08,820/-																	

	<p>b. The penalty for violation shall be equal to NPV of forest land per hectare for each year of violation from the date of actual diversion as reported by the inspecting officer with maximum up to five (5) times the NPV plus 12 percent simple interest from the date of raising of such demand till the deposit is made;</p>	<p>As per approved demand letter the payments are deposited to CAMPA as below</p> <table border="0"> <tr> <td>1) CA</td> <td>Rs 1,10,92,313/-</td> </tr> <tr> <td>2) NPV</td> <td>Rs 58,19,471/-</td> </tr> <tr> <td>3) Penal NPV</td> <td>Rs 2,22,25,285/-</td> </tr> <tr> <td>4) Medicinal Plantation</td> <td>Rs 53,91,751/-</td> </tr> <tr> <td>5) Boundary Pillars</td> <td>Rs 13,50,000/-</td> </tr> <tr> <td>6) Alternative Bird Nests</td> <td>Rs 5,30,000/-</td> </tr> <tr> <td colspan="2"><hr/></td> </tr> <tr> <td>Total</td> <td>Rs 4,64,08,820/-</td> </tr> </table> <p>(Four crore sixty four lakh eight thousand eight hundred twenty only) is paid from Bank of Baroda, Amravati vide UTR details as below to Ad-Hoc CAMPA through e-portal(<a href="https://parivesh.nic.in">https://parivesh.nic.in</a>)</p> <p>Bank UTR No BARBR52025032400974445 dated 24/03/2025 Rs 4,64,08,820/-</p> <p>Encl Exhibit-4(b) and the screenshot shot of payment made and payment status as per Parivesh portal</p>	1) CA	Rs 1,10,92,313/-	2) NPV	Rs 58,19,471/-	3) Penal NPV	Rs 2,22,25,285/-	4) Medicinal Plantation	Rs 53,91,751/-	5) Boundary Pillars	Rs 13,50,000/-	6) Alternative Bird Nests	Rs 5,30,000/-	<hr/>		Total	Rs 4,64,08,820/-
1) CA	Rs 1,10,92,313/-																	
2) NPV	Rs 58,19,471/-																	
3) Penal NPV	Rs 2,22,25,285/-																	
4) Medicinal Plantation	Rs 53,91,751/-																	
5) Boundary Pillars	Rs 13,50,000/-																	
6) Alternative Bird Nests	Rs 5,30,000/-																	
<hr/>																		
Total	Rs 4,64,08,820/-																	
	<p>c. At the time of payment of the Net Present Value (NPV) at the present rate, the User Agency shall furnish an undertaking to pay the additional amount of NPV, if so determined, as per the final decision of the Hon'ble Supreme Court of India;</p>	<p>Undertaking to pay the additional amount of NPV if so determined is attached.</p> <p>Encl.: Exhibit-4 (c).</p>																
v	<p>All the funds received from the user agency under the project shall be transferred /deposited to CAMPA account only through e-portal (<a href="http://parivesh.nic.in">http://parivesh.nic.in</a>). Amount deposited through other mode will not be accepted as compliance of the Stage-I clearance;</p>	<p>Undertaking for all the funds will be transferred/deposited to CAMPA fund through e-portal (<a href="http://parivesh.nic.in">http://parivesh.nic.in</a>), is attached.</p> <p>Encl.: Exhibit-5</p>																
vi	<p>The State Government shall upload the KML files of the area under diversion and the accepted area for raising compensatory afforestation in the e-Green watch portal of FSI, before handing over forest land to the user agency;</p>	<p>Undertaking with request to for the State Government to upload the KML files is attached.</p> <p>Encl.: Exhibit-6</p>																
vii	<p>The User Agency shall obtain the Environment Clearance as per the</p>	<p>Being the project is of transmission line Environment Clearance is not applicable.</p>																

	provisions of the Environmental (Protection) Act, 1986, if required,	Undertaking attached  Encl Exhibit-7
viii	Width of right of way for the transmission line shall be limited to 35 meter	Undertaking for width of right of way for the transmission line shall be limited to 35 meter is attached Encl Exhibit-8
ix	The user agency shall install circuit breakers at suitable places besides maintain necessary ground clearance to prevent electrocution of wild animals,	Undertaking for the user agency shall install circuit breakers at suitable places besides maintain necessary ground clearance to prevent electrocution of wild animals is attached  Encl Exhibit-9
x	No approach road shall be constructed in the forest area for transportation of steel and other material required for the transmission line. As far as possible the User Agency shall use the existing road and the proposed RoW for the transportation of the material and in the event of non-availability of such facilities, the User Agency shall transport material manually without construction of any path,	Undertaking for no approach road shall be constructed in the forest area for transportation of steel and other material required for the transmission line. As far as possible the User Agency shall use the existing road and the proposed RoW for the transportation of the material and in the event of non-availability of such facilities, the User Agency shall transport material manually without construction of any path is attached.  Encl: Exhibit-10
xi	To minimize the felling for construction of transmission line, user agency shall comply with the following guidelines:	
	a. Below each conductor, width clearance of 3 meters would be permitted for carrying the tension stringing equipment. The trees on such strips may be felled but after stringing work is completed, the natural regeneration will be allowed to come up.	Undertaking for below each conductor, width clearance of 3 meters would be permitted for carrying the tension stringing equipment. The trees on such strips may be felled but after stringing work is completed, the natural regeneration will be allowed to come up is attached.  Encl: Exhibit-11A
	b. One outer strip may be left clear to permit maintenance of the transmission line;	Undertaking for One outer strip may be left clear to permit maintenance of the transmission line is attached.  Encl: Exhibit-11B

	<p>c. In the remaining width the right of way felling/pollarding/pruning of trees will be done with the permission of the local forest officer whenever necessary to maintain the electrical clearance, trees shall be allowed to be felled or lopped to the extent required, for preventing electrical hazards by maintaining the minimum 4.6 meter clearance between conductors and trees. The sag and swing of the conductors are to be kept in view while working out the minimum clearance mentioned as above;</p>	<p>Undertaking for In the remaining width the right of way felling/pollarding/pruning of trees will be done with the permission of the local forest officer whenever necessary to maintain the electrical clearance, trees shall be allowed to be felled or lopped to the extent required, for preventing electrical hazards by maintaining the minimum 4.6 meter clearance between conductors and trees. The sag and swing of the conductors are to be kept in view while working out the minimum clearance mentioned as above is attached.</p> <p>Encl.: Exhibit-IIC</p>																
	<p>d. User agency in consultation with the State Forest Department prepare a detailed scheme for creation and maintenance of plantation of dwarf species (preferably medicinal plants) in right of way under the transmission line, and provide funds for execution of the said scheme to the State Forest Department; and</p>	<p>Undertaking with scheme of medicinal plantation is attached herewith.</p> <p>As per approved demand letter the payments are deposited to CAMPA as below</p> <table border="0"> <tr> <td>1) CA :</td> <td>Rs. 1,10,92,313/-</td> </tr> <tr> <td>2) NPV :</td> <td>Rs. 58,19,471/-</td> </tr> <tr> <td>3) Penal NPV</td> <td>Rs. 2,22,25,285/-</td> </tr> <tr> <td>4) Medicinal Plantation</td> <td>Rs. 53,91,751/-</td> </tr> <tr> <td>5) Boundary Pillars</td> <td>Rs. 13,50,000/-</td> </tr> <tr> <td>6) Alternative Bird Nests</td> <td>Rs. 5,30,000/-</td> </tr> <tr> <td colspan="2"><hr/></td> </tr> <tr> <td>Total</td> <td>Rs. 4,64,08,820/-</td> </tr> </table> <p>(Four crore sixty four lakh eight thousand eight hundred twenty only) is paid from Bank of Baroda, Amravati vide UTR details as below to Ad-Hoc CAMPA through e-portal(<a href="https://parivesh.nic.in">https://parivesh.nic.in</a>).</p> <p>Bank UTR No. BARBR52025032400974445 dated 24/03/2025. Rs. 4,64,08,820/-</p> <p>Encl.: Exhibit-IID &amp; Scheme of Medicinal Plantation.</p>	1) CA :	Rs. 1,10,92,313/-	2) NPV :	Rs. 58,19,471/-	3) Penal NPV	Rs. 2,22,25,285/-	4) Medicinal Plantation	Rs. 53,91,751/-	5) Boundary Pillars	Rs. 13,50,000/-	6) Alternative Bird Nests	Rs. 5,30,000/-	<hr/>		Total	Rs. 4,64,08,820/-
1) CA :	Rs. 1,10,92,313/-																	
2) NPV :	Rs. 58,19,471/-																	
3) Penal NPV	Rs. 2,22,25,285/-																	
4) Medicinal Plantation	Rs. 53,91,751/-																	
5) Boundary Pillars	Rs. 13,50,000/-																	
6) Alternative Bird Nests	Rs. 5,30,000/-																	
<hr/>																		
Total	Rs. 4,64,08,820/-																	
	<p>e. In case a portion of the transmission lines to be constructed is located in hilly areas, where adequate clearance is already available, trees shall not be cut;</p>	<p>Undertaking for In case a portion of the transmission lines to be constructed is located in hilly areas, where adequate clearance is already available, trees shall not be cut is attached.</p> <p>Encl.: Exhibit-IIE</p>																

<p>ii</p>	<p>The labour camp shall be established on the forest land and the User Agency shall provide firewood preferably alternative to the labourers and the staff working at the site so as to avoid any damage and pressure on the nearby forest areas;</p>	<p>Undertaking for fire labour camp shall be established on the forest land is attached</p> <p>Encl: Exhibit-12</p>																
<p>iii</p>	<p>The boundary of the diverted forest land shall be demarcated on ground at the project cost, by erecting four feet high reinforced cement concrete pillars, each inscribed with its serial number, forward and back bearing and distance from pillar to pillar;</p>	<p>Undertaking for cost of boundary pillars payment made is attached</p> <p>As per approved demand letter the payments are deposited to CAMPA as below</p> <table border="0" data-bbox="812 546 1347 819"> <tr> <td>1) CA</td> <td>Rs 1,10,92,313/-</td> </tr> <tr> <td>2) HPV</td> <td>Rs 58,19,471/-</td> </tr> <tr> <td>3) Penal HPV</td> <td>Rs 2,22,25,285/-</td> </tr> <tr> <td>4) Medicinal Plantation</td> <td>Rs 53,91,751/-</td> </tr> <tr> <td>5) Boundary Pillars</td> <td>Rs 13,50,000/-</td> </tr> <tr> <td>6) Alternative Bird Nests</td> <td>Rs 5,30,000/-</td> </tr> <tr> <td colspan="2">-----</td> </tr> <tr> <td>Total</td> <td>Rs 4,64,08,820/-</td> </tr> </table> <p>(Four crore sixty four lakh eight thousand eight hundred twenty only) is paid from Bank of Baroda, Amravati vide UIR details as below to Ad-Hoc CAMPA through e-portal(<a href="https://parivesh.nic.in">https://parivesh.nic.in</a>)</p> <p>Bank UIR No. BARBR52025032400974445 dated 24/03/2025. Rs. 4,64,08,820/-</p> <p>Encl: Exhibit-13</p>	1) CA	Rs 1,10,92,313/-	2) HPV	Rs 58,19,471/-	3) Penal HPV	Rs 2,22,25,285/-	4) Medicinal Plantation	Rs 53,91,751/-	5) Boundary Pillars	Rs 13,50,000/-	6) Alternative Bird Nests	Rs 5,30,000/-	-----		Total	Rs 4,64,08,820/-
1) CA	Rs 1,10,92,313/-																	
2) HPV	Rs 58,19,471/-																	
3) Penal HPV	Rs 2,22,25,285/-																	
4) Medicinal Plantation	Rs 53,91,751/-																	
5) Boundary Pillars	Rs 13,50,000/-																	
6) Alternative Bird Nests	Rs 5,30,000/-																	
-----																		
Total	Rs 4,64,08,820/-																	
<p>xiv</p>	<p>The Forest land shall not be used for any purpose other than that specified in the project proposal</p>	<p>Undertaking for not using forest land for any purpose other than that specified in the project proposal is attached.</p> <p>Encl: Exhibit-14</p>																
<p>xv</p>	<p>The User Agency shall ensure that because of this project, no damage is caused to the wildlife available in the area;</p>	<p>Undertaking for the User Agency shall ensure that because of this project, no damage is caused to the wildlife available in the area is attached.</p> <p>Encl: Exhibit-15</p>																
<p>xvi</p>	<p>The user agency shall explore the possibility of translocation of maximum number of trees identified to be felled and shall ensure that any tree felling shall be done only when it is unavoidable and that too under strict supervision of the State Forest Department;</p>	<p>Undertaking for possibility of translocation of maximum number of trees identified to be felled and shall ensure that any tree felling shall be done only when it is unavoidable and that too under strict supervision of the State Forest Department is attached.</p> <p>Encl: Exhibit-16</p>																

xvii	The cost of felling of trees shall be deposited by the User Agency with the State Forest Department;	The payment for cost of felling of trees is being made after receiving demand letter in this regards from your office.  Encl.: Exhibit-17 & Demand Draft.																
xviii	The layout plan of the proposal shall not be changed without prior approval of Central Government.	Undertaking towards layout plan of the proposal shall not be changed without prior approval of Central Government is attached.  Encl.: Exhibit-18																
xix	The Forest land proposed to be diverted shall under no circumstances be transferred to any other agencies, department or person without prior approval of the Central Government.	Undertaking for not transferring forest land proposed to be diverted under no circumstances to any other agencies, department or person without prior approval of the Central Government is attached.  Encl.: Exhibit-19																
xx	The user agency in consultation with the State Government shall create and maintain alternate habitat/home for the avifauna, whose nesting trees are to be cleared in this project. Bird's nests artificially made out of eco-friendly material shall be used in the area, including forest area and human settlements, adjoining the forest area being diverted for the project;	Undertaking for alternative bird nest along with payment deposited is attached. As per approved demand letter the payments are deposited to CAMPA as below  <table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 60%;">1) CA :</td> <td style="text-align: right;">Rs. 1,10,92,313/-</td> </tr> <tr> <td>2) NPV :</td> <td style="text-align: right;">Rs. 58,19,471/-</td> </tr> <tr> <td>3) Penal NPV</td> <td style="text-align: right;">Rs. 2,22,25,285/-</td> </tr> <tr> <td>4) Medicinal Plantation</td> <td style="text-align: right;">Rs. 53,91,751/-</td> </tr> <tr> <td>5) Boundary Pillars</td> <td style="text-align: right;">Rs. 13,50,000/-</td> </tr> <tr> <td>6) Alternative Bird Nests</td> <td style="text-align: right;">Rs. 5,30,000/-</td> </tr> <tr> <td colspan="2" style="border-top: 1px dashed black;"></td> </tr> <tr> <td style="text-align: right;"><b>Total</b></td> <td style="text-align: right;"><b>Rs. 4,64,08,820/-</b></td> </tr> </table> (Four crore sixty four lakh eight thousand eight hundred twenty only) is paid from Bank of Baroda, Amravati vide UTR details as below to Ad-Hoc CAMPA through e-portal( <a href="https://parivesh.nic.in">https://parivesh.nic.in</a> ).  Bank UTR No. BARBR52025032400974445 dated 24/03/2025. Rs. 4,64,08,820/-  Encl.: Exhibit-20	1) CA :	Rs. 1,10,92,313/-	2) NPV :	Rs. 58,19,471/-	3) Penal NPV	Rs. 2,22,25,285/-	4) Medicinal Plantation	Rs. 53,91,751/-	5) Boundary Pillars	Rs. 13,50,000/-	6) Alternative Bird Nests	Rs. 5,30,000/-			<b>Total</b>	<b>Rs. 4,64,08,820/-</b>
1) CA :	Rs. 1,10,92,313/-																	
2) NPV :	Rs. 58,19,471/-																	
3) Penal NPV	Rs. 2,22,25,285/-																	
4) Medicinal Plantation	Rs. 53,91,751/-																	
5) Boundary Pillars	Rs. 13,50,000/-																	
6) Alternative Bird Nests	Rs. 5,30,000/-																	
<b>Total</b>	<b>Rs. 4,64,08,820/-</b>																	
xxi	The User Agency shall implement the R & R Plan, if applicable, as per the R & R Policy of State Government in consonance with National R&R Policy, Government of	Undertaking for non involvement and non applicability of R & R Plan is attached.																

	India before the commencement of the project work and implementation. The said R & R Plan will be monitored by the State Government/Regional Office of MoEF&CC;	Encl.: Exhibit-21
xxii	The User Agency shall submit the annual self-compliance report in respect of the above stated conditions to the State Government, concerned Regional Office and to this Ministry by the end of March every year regularly;	Undertaking for The User Agency shall submit the annual self-compliance report in respect of the above stated conditions to the State Government, concerned Regional Office and to this Ministry by the end of March every year regularly is attached.  Encl.: Exhibit-22
xxiii	Any other condition that the concerned Regional Office of this Ministry may stipulate with the approval of competent authority in the interest of conservation, protection and development of forests & wildlife;	Undertaking for abiding any other condition that the Ministry of Environment, Forests & Climate Change may stipulate from time to time in the interest of conservation, protection and development of forests & wildlife SBWL & NBWL approval is attached.  Encl.: Exhibit-23
xxiv	The user agency shall comply all the provisions of the all Acts, Rules, Regulations, Guidelines, Hon'ble Court Order (s) and NGT Order (s) pertaining to this project, if any, for the time being in force, as applicable to the project;	Undertaking for the user agency shall comply all the provisions of the all Acts, Rules, Regulations, Guidelines, Hon'ble Court Order (s) and NGT Order (s) pertaining to this project, if any, for the time being in force, as applicable to the project  Encl.: Exhibit-24
xxv	Violation of any of these conditions will amount to violation of Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 and action would be taken as prescribed in para 1.16 of Chapter 1 of the Consolidated Guidelines and Clarifications on Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 as issued by this Ministry's letter dated 29.12.2023;	Undertaking for Violation of any of these conditions that will amount to violation of Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 and action would be taken as prescribed in para 1.16 of Chapter 1 of the Consolidated Guidelines and Clarifications on Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 as issued by this Ministry's letter dated 29.12.2023  Encl.: Exhibit-25

xxvi	The compliance report shall be uploaded on e-portal ( <a href="https://parivesh.nic.in/">https://parivesh.nic.in/</a> )	Undertaking for the compliance report to be uploaded on e-portal ( <a href="https://parivesh.nic.in/">https://parivesh.nic.in/</a> ) is attached.  Encl.: Exhibit-26
------	---	--

Kindly forward the compliance to the office of the CCF Nagpur for onward submission and issuance of the working permission and recommendation for final approval.

Thanking you  
Yours Faithfully



(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division,  
MSETCL, Amravati.

- Encl: 1) Copy of letter of In-Principle approval  
2) Copy of Demand letter.  
3) Undertakings for compliances and Annexures as above  
4) Payment screen shots for amounts paid to CAMPA.  
5) Demand draft for amount paid to Deputy Conservator of Forests, Nagpur

- Copy to : 1) Superintending Engineer EHV Project Circle Amravati.  
2) The Addl. Ex. Engineer S & I Sub Division Amravati  
3) The CCF (T) Forest circle Yavatmal.

**Government of India**  
**Ministry of Environment, Forest and Climate Change**  
**(Forest Conservation Division)**

\*\*\*\*\*

**Indira Paryavaran Bhawan,**  
Jor Bag Road, Aliganj,  
New Delhi – 110003  
**Dated: As per E-sign**

To,

**The Principal Secretary (Forests),**  
Government of Maharashtra,  
Mumbai.

**Subject: Proposal for *ex-post facto* approval of the Central Government under section 2 (1) (ii) of the Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 for diversion of 6.0760 ha of reserved forest land for laying of 220 KV Kalmeshwar substation to 220 KV Warud substation transmission line in favour of MSETCL, EHV Project Division, Amravati in Taluka - Katol, District-Nagpur in the State of Maharashtra (Online No. FP/MH/TRANS/38296/2019) -regarding.**

Madam/Sir,

I am directed to refer to the Government of Maharashtra vide letter no. FLD-2022/CR-309/F-10 dated 17.04.2023 on the above subject seeking *ex-post facto* approval of the Central Government under Section 2 (1) (ii) of the Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 and to say that the proposal has been examined by the Advisory Committee constituted by the Central Government under Section-3 of the aforesaid Adhiniyam.

2. After careful examination of the proposal of the State Government and on the basis of the recommendations of the Advisory Committee and with due approval of the competent authority, the Central Government hereby accords '*in-principle*' approval under Section 2 (1) (ii) of the Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 for diversion of 6.0760 ha of reserved forest land for laying of 220 KV Kalmeshwar substation to 220 KV Warud substation transmission line in favour of MSETCL, EHV Project Division, Amravati in Taluka - Katol, District-Nagpur in

the State of Maharashtra subject to fulfilment of the following conditions:

- i. Legal status of the diverted forest land shall remain unchanged;
- ii. *The Regional Office, Nagpur shall initiate action under section 3A/3B of Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 (as applicable).*
- iii. **Compensatory Afforestation (CA)**
  - a. Compensatory Afforestation over the identified degraded forest land of 12.50 ha on Compartment no. 251, Survey no. 328 of Village Kurhad. Taluka Ghatanji, District Yavatmal. Maharashtra State shall be raised at the project cost under the supervision of the State Forest Department and afforestation works shall start within two years from the date of final approval and maintained thereafter in accordance with the approved CA scheme in consultation with the State Forest Department;
  - b. The User Agency shall transfer the cost of raising and maintaining the compensatory afforestation as per the approved CA scheme at the current wage rate in consultation with State Forest Department in the account of CAMPA of the concerned State through online portal;
  - c. The cost of survey, demarcation and erection of permanent pillars, if required on the identified CA land, shall be deposited in advance with the Forest Department by the user agency. The CA will be maintained for 10 years. The scheme may include afforestation of indigenous species with appropriate provision for anticipated cost increase for works scheduled for subsequent years;
  - d. The land identified for the purpose of CA shall be clearly depicted on Survey of India toposheet map of 1:50,000 scale;
  - e. *The matter regarding imposition of penal CA is under consideration for the formulation of a uniform policy guideline in the matter. Keeping this in view, the imposition of penal CA (if any) shall be as per the said guideline, if applicable.*
- iv. **Net Present Value (NPV)**
  - a. The User Agency shall transfer the funds towards the cost of Net Present Value (NPV) of the forest land being diverted under this proposal in accordance with the MoEF&CC's guidelines;
  - b. *The penalty for violation shall be equal to NPV of forest land per hectare for each year of violation from the date of actual diversion as reported by the inspecting officer with maximum up to five (5) times the NPV plus 12 percent simple interest from the date of raising of such demand till the deposit is made;*
  - c. At the time of payment of the Net Present Value (NPV) at the present rate,

the User Agency shall furnish an undertaking to pay the additional amount of NPV, if so determined, as per the final decision of the Hon'ble Supreme Court of India;

- v. All the funds received from the user agency under the proposal shall be transferred/deposited in CAMPA account only through e-portal (<https://parivesh.nic.in/>). Amount deposited through other mode will not be accepted as compliance of the Stage-I clearance;
- vi. The State Government shall upload the KML files of the area under diversion and the accepted area for raising compensatory afforestation in the e-Green watch portal of FSI, before handing over forest land to the user agency;
- vii. The User Agency shall obtain the Environment Clearance as per the provisions of the Environmental (Protection) Act; 1986; if required;
- viii. Width of right of way for the transmission line shall be limited to 35 meter;
- ix. The user agency shall install circuit breakers at suitable places besides maintain necessary ground clearance to prevent electrocution of wild animals;
- x. No approach road shall be constructed in the forest area for transportation of steel and other material required for the transmission line. As far as possible the User Agency shall use the existing road and the proposed RoW for the transportation of the material and in the event of non-availability of such facilities, the User Agency shall transport material manually without construction of any path;
- xi. To minimize the felling for construction of transmission line, user agency shall comply with the following guidelines:
  - a. Below each conductor, width clearance of 3 meters would be permitted for carrying the tension stringing equipment. The trees on such strips may be felled but after stringing work is completed, the natural regeneration will be allowed to come up.
  - b. One outer strip may be left clear to permit maintenance of the transmission line;
  - c. In the remaining width the right of way felling/pollarding/pruning of trees will be done with the permission of the local forest officer whenever necessary to maintain the electrical clearance, trees shall be allowed to be felled or lopped to the extent required, for preventing electrical hazards by maintaining the minimum 4.6 meter clearance between conductors and trees. The sag and swing of the conductors are to be kept in view while working out the minimum clearance mentioned as above;

- d. User agency in consultation with the State Forest Department prepare a detailed scheme for creation and maintenance of plantation of dwarf species (preferably medicinal plants) in right of way under the transmission line, and provide funds for execution of the said scheme to the State Forest Department; and
- e. In case a portion of the transmission lines to be constructed is located in hilly areas, where adequate clearance is already available, trees shall not be cut;
- xii. No labour camp shall be established on the forest land and the User Agency shall provide firewood preferably alternate fuels to the labourers and the staff working at the site so as to avoid any damage and pressure on the nearby forest areas;
- xiii. The boundary of the diverted forest land shall be demarcated on ground at the project cost, by erecting four feet high reinforced cement concrete pillars, each inscribed with its serial number, forward and back bearing and distance from pillar to pillar;
- xiv. The forest land shall not be used for any purpose other than that specified in the proposal;
- xv. The User Agency shall ensure that because of this project, no damage is caused to the wildlife available in the area;
- xvi. The user agency shall explore the possibility of translocation of maximum number of trees identified to be felled and shall ensure that any tree felling shall be done only when it is unavoidable and that too under strict supervision of the State Forest Department;
- xvii. The cost of felling of trees shall be deposited by the User Agency with the State Forest Department;
- xviii. The layout plan of the proposal shall not be changed without the prior approval of the Central Government;
- xix. The forest land proposed to be diverted shall under no circumstances be transferred to any other agency, department or person without prior approval of the Central Government;
- xx. The user agency in consultation with the State Government shall create and maintain alternate habitat/home for the avifauna, whose nesting trees are to be cleared in this project. Bird's nests artificially made out of eco-friendly material shall be used in the area, including forest area and human settlements, adjoining the forest area being diverted for the project;
- xxi. The User Agency shall implement the R & R Plan, if applicable, as per the R & R Policy of State Government in consonance with National R&R Policy, Government of India before the commencement of the project work and

implementation. The said R & R Plan will be monitored by the State Government/Regional Office of MoEF&CC;

- xxii. The User Agency shall submit the annual self -compliance report in respect of the above stated conditions to the State Government, concerned Regional Office and to this Ministry by the end of March every year regularly;
- xxiii. Any other condition that the concerned Regional Office of this Ministry may stipulate with the approval of competent authority in the interest of conservation, protection and development of forests & wildlife;
- xxiv. The user agency shall comply all the provisions of the all Acts, Rules, Regulations, Guidelines, Hon'ble Court Order (s) and NGT Order (s) pertaining to this project, if any, for the time being in force, as applicable to the project;
- xxv. Violation of any of these conditions will amount to violation of Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 and action would be taken as prescribed in para 1.16 of Chapter 1 of the Consolidated Guidelines and Clarifications on Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 as issued by this Ministry's letter dated 29.12.2023;
- xxvi. The compliance report shall be uploaded on e-portal (<https://parivesh.nic.in/>).

After receipt of compliance report on fulfillment of the conditions mentioned above, the proposal shall be considered for final approval under Section-2 (1) (ii) of the Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980. Transfer of forest land shall not be affected till final approval is granted by the Central Government in this regard.

Yours sincerely,

(Suneet Bhardwaj)

**Assistant Inspector General of Forests**

**Copy to:**

1. The PCCF (HoFF), Department of Forest, Government of Maharashtra, Nagpur;
2. The Dy. DGF (Central), Regional Office, MoEF&CC, Nagpur;
3. The Nodal Officer, Department of Forest, Government of Maharashtra, Nagpur;
4. User Agency;

5. Monitoring Cell, FC Division, MoEF&CC, New Delhi for uploading on PARIVESH portal.

# उपवनसंरक्षक, नागपूर वनविभाग, नागपूर यांचे कार्यालय,

(तिसरा माळा, नविन प्रशासकीय ईमारत, वनभवन, शासकीय मद्रणालयाजवळ, झिरो मार्गस समोर, सिव्हील लाईन्स, नागपूर-४४०००१,

दुरध्वनी क्र. ०७१२-२५६५६२४, ईमेल-dycfnagpur@mahaforest.gov.in)

विषय:- Forest Land- Nagpur

Diversion of 6.0760 ha of forest land in favour of MSETCL,EHV Project Division, Amravati for laying of 220 KV Kalmeshwar substation to 220KV Warud substation transmission line in Taluka- Katol, District- Nagpur .

क्रमांक कक्ष-11/वनसंवर्धन/प्र.क्र.487/ 3963 /2024-25

नागपूर दिनांक 21/03/2025.

प्रति,  
कार्यकारी अभियंता,  
ईएचव्ही प्रोजेक्ट डिवीजन एमएसईटीसीएल,  
प्रकाश सरिता, ए-विंग, तळमजला,  
प्रशासकीय बिल्डींग, मोर्शी रोड,  
अमरावती - ४४४६०३.

संदर्भ:- 1. केंद्र शासन, पर्यावरण व वने, फॉरेस्ट कन्झर्वेशन डिवीजन, न्यु दिल्ली यांचेकडील पत्र दिनांक 20/03/2025.

उपरोक्त केंद्र शासन पत्रान्वये, वन (संवर्धन) अधिनियम १९८० चे कलम २ अंतर्गत कार्यकारी अभियंता यांचेकडून प्राप्त झालेला २२० के.व्ही कळमेश्वर ते वरुड लाईन ट्रान्समिशन लाईनकरिता ६.०७६ हे. वनजमिन वळतीकरणाचा प्रस्तावातील १ ते २६ अटीच्या अधिन राहून तत्त्वतः मान्यता प्राप्त झालेली आहे

याअनुषंगाने केंद्र शासनाचे सदरहु पत्रात नमुद अटीची पूर्तता करणेकरीता खालीलप्रमाणे निधीचा भरणा करणेकरीता मागणीपत्र देणेत येत आहे.

Sr. No.	Condition No.	Particulars	Area in ha.	Amount (In Rs.)	Remarks
1	(iii)	<b>Compensatory Afforestation (CA)</b>			
	a	Compensatory Afforestation over the identified degraded forest land of 12.50 ha on Compartment no. 251, Survey no. 328 of Village Kurhad. Taluka Ghatanji, District Yavatmal. Maharashtra State shall be raised at the project cost under the supervision of the State Forest Department and afforestation works shall start within two years from the date of final approval and maintained thereafter in accordance with the approved CA scheme in consultation with the State Forest Department;	12.50	11092313/-	Principal Chief Conservator of Forests (Head of Forest Force) Maharashtra State, Nagpur, Letter No./Section-17/Mule Estimation Letter No./F.No.40/1127/2019-20, Dated: 04/10/2019  As per the Forest Conservation Act, 1980, under the compensatory afforestation scheme, the revised rates applicable from the year 2025-26 onwards will be as per the prescribed format.
	b	The User Agency shall transfer the cost of raising and maintaining the compensatory afforestation as per the approved CA scheme at the current wage rate in consultation with State Forest Department in the account of CAMPA of the concerned State through online portal;			(As per Ready Recknor for the year 2025-26 @ Rs.887385/- per ha. (Model No.5) (1111 trees/ha)
c	The cost of survey, demarcation and erection of permanent pillars, if required on the identified CA land, shall be deposited in advance with the Forest Department by the user agency. The CA will be maintained for 10 years. The scheme may include afforestation of indigenous species with appropriate provision for anticipated cost increase for works scheduled for subsequent years;				
2	iv.	<b>Net Present Value</b>			
	a	The User Agency shall transfer the funds towards the cost of Net Present Value (NPV) of the forest land being diverted under this proposal in accordance with the MoEF&CC's guidelines.	6.076	5819471/-	(Density 0.4 Eco Value Class III & the Forest has been classified as Tropical Dry Deciduous Forest in Eco Class III) @957780/- x 6.076 ha. = 5819471/-

	b	The penalty for violation shall be equal to NPV of forest land per hectare for each year of violation from the date of actual diversion as reported by the inspecting officer with maximum up to five (5) times the NPV plus 12 percent simple interest from the date of raising of such demand till the deposit is made. (Penal 4.641 x 957780 x 5) =22225285/- Rs	4.641	22225285/-	violation area is 4.0641 ha in said proposal.
3	xi (d)	User agency in consultation with the State Forest Department prepare a detailed scheme for creation and maintenance of plantation of dwarf species (preferably medicinal plants) in right of way under the transmission line, and provide funds for execution of the said scheme to the State Forest Department; and	6.076	5391751/-	(As per Ready Reckno r for the year 2025-26 @ Rs.887385/- per ha. (Model No.5)
4	xiii	The boundary of the diverted forest land, shall be demarcated on ground at the project cost, by erecting four feet high reinforced cement concrete pillars, each inscribed with its serial number, forward and back bearing and distance from pillar to pillar.	6.076	1350000/-	(Total Qty 150 nos of Class - I @ Rs. 9000/- per Pillar)
5	xx	The user agency in consultation with the State Government shall create and maintain alternate habitat/home for the avifauna, whose nesting trees are to be cleared in this project. Bird's nests artificially made out of eco-friendly material shall be used in the area, including forest area and human settlements, adjoining the forest area being diverted for the project.	6.076	530000/-	(530 Nests @ Rs 1000/- per nest)
<b>Total</b>				<b>46408820/-</b>	

करीता वरीलप्रमाणे एकुण रक्कम रु. 4,64,08,820/- अक्षरी रुपये चार कोटी चौसष्ट लाख आठ हजार आठशे वीस फक्त) चा भरणा parivesh-portal द्वारे केंद्र शासनाचे Ad-hoc Compensatory Afforestation Fund Management & Planning Agency (Ad-hoc CAMPA) मध्ये भरणा करून सदर निधी जमा केल्याचे 3 दिवसाचे आंत बँकेच्या लेटरहेड वर तपशीलवार माहिती नमुद करुन या कार्यालयास सादर करावी.

त्याचप्रमाणे केंद्र शासनाचे संदर्भिय तत्वतः मान्य प्राप्त पत्रातील नमुद संपुर्ण (1 ते 26) अटीसंदर्भात आवश्यक हमीपत्रासह (Authorised Undertakings) अनुपालन अहवाल 4 प्रतित या कार्यालयास सादर करावा.

  
(डॉ. भारत सिंह हाडा)  
उपवनसंरक्षक,  
नागपूर वनविभाग नागपूर

प्रतिलिपी:- अपर प्रधान मुख्य वनसंरक्षक व केंद्रस्थ अधिकारी, म.रा., नागपूर यांना माहितीस सविनय सादर.

प्रतिलिपी:- वनसंरक्षक (प्रादेशिक), नागपूर यांना माहितीस सविनय सादर.

प्रतिलिपी:- उपवनसंरक्षक, पांढरकवडा वनविभाग, पांढरकवडा यांना माहितीस व आवश्यक कार्यवाहीस अग्रेषित.

प्रतिलिपी:- सहा. वनसंरक्षक (काटोल), नागपूर वनविभाग, नागपूर/वनपरिक्षेत्र अधिकारी,काटोल/कोंढाळी यांना माहिती व आवश्यक कार्यवाहीस अग्रेषित. त्यांनी त्यांचे कार्यक्षेत्रातील प्रकल्पबाधित वनक्षेत्रातील 265 झाडांची तोड करणेकरीता लागणाऱ्या खर्चाचे अंदाजपत्रक तात्काळ या कार्यालयास सादर करावे, जेणे करुन वृक्षतोड करणेकरीता लागणाऱ्या खर्चाची रक्कम प्रकल्प यंत्रणेस मागणीपत्र देणे शक्य होईल.

## उपवनसंरक्षक, नागपूर वनविभाग, नागपूर यांचे कार्यालय,

(तिसरा माळा, नविन प्रशासकीय इमारत, वनभवन, शासकीय मुद्रणालयाजवळ, डियरो माईल्स समोर, सिव्हील लाईन्स, नागपूर-४४०००१,  
दूरध्वनी क्र. ०७१२-२५६५६२४, ईमेल-dycfnagpur@mahaforest.gov.in)

विषय:- Forest Land- Nagpur

Diversion of 6.0760 ha of forest land in favour of MSETCL.EHV Project Division, Amravati for laying of 220 KV Kalmeshwar substation to 220KV Warud substation transmission line in Taluka- Katol, District- Nagpur . Demand Note For Tree Felling Amount Rs. 947005/-

क्रमांक कक्ष-11/वनसंवर्धन/प्र.क्र.487/ 3999 /2024-25.

नागपूर दिनांक - 25/03/2025

प्रति,  
कार्यकारी अभियंता,  
इंफ्रस्ट्रक्चर प्रोजेक्ट डिवीजन एमएसईटीसीएल,  
प्रकाश सरिता, ए-विंग, तळमजला,  
प्रशासकीय बिल्डिंग, मोशी रोड,  
अमरावती - ४४४६०३.

- संदर्भ:- 1. केंद्र शासन, पर्यावरण व वने, फॉरेस्ट कन्झर्वेशन डिवीजन, न्यु दिल्ली यांचेकडील पत्र दिनांक 20/03/2025.  
2. वनपरिक्षेत्र अधिकारी, काटोल यांचेकडील पत्र क्रमांक कक्ष - मुल्यांकन/1222, दिनांक 24/03/2025  
3. वनपरिक्षेत्र अधिकारी, कोंढाळी यांचेकडील पत्र क्रमांक कक्ष - कोंढाळी/1723, दिनांक 24/03/2025

उपरोक्त केंद्र शासन पत्रान्वये, वन (संवर्धन) अधिनियम १९८० चे कलम २ अंतर्गत कार्यकारी अभियंता यांचेकडून प्राप्त झालेला २२० के.व्ही कळमेन्वर ते वरुड लाईन ट्रान्समिशन लाईनकरिता ६.०७६ हे. वनजमिन वळतीकरणगाचा प्रस्तावातील १ ते २६ अटीच्या अधिन राहून तत्त्वतः मान्यता प्राप्त झालेली आहे

याअनुषंगाने केंद्र शासनाचे सदरहु पत्रात नमुद वृक्षतोडीची अटीच्या अनुषंगाने पूर्तता करणेकरिता खालीलप्रमाणे निधीचा भरणा करणेकरिता मागणीपत्र देणेत येत आहे.

तसेच वनपरिक्षेत्र अधिकारी, काटोल तसेच वनपरिक्षेत्र अधिकारी, कोंढाळी यांचेकडील प्राप्त वृक्षगणना अहवालानुसार प्रकल्पाचे कामाकरिता प्रकल्पबाधित क्षेत्रांमध्ये एकूण 265 झाडांचा समावेश असून वृक्षतोडीला लागणाऱ्या खर्चाचे अंदाजपत्रक संदर्भिय पत्र क्र. 2 व 3 अन्वये या कार्यालयास प्राप्त झालेले आहे. प्राप्त वृक्षतोडीच्या खर्चाचे अंदाजपत्रकानुसार खालीलप्रमाणे निधीचा भरणा करणेकरिता मागणीपत्र देण्यात येत आहे.

तरी सदरहु रक्कम रु. 9,47,005/- (अक्षरी रु. नउ लक्ष सत्तेचाळीस हजार पाच फक्त) उपवनसंरक्षक नागपूर वनविभाग यांचे पदनामे "वनटेव" मध्ये घनाकर्ष (Demand Draft) द्वारे भरणा करावा.

अ. क्र.	अट क्र.	विवरण	अंदाजपत्रकीय रक्कम रु.
1	xvi	Cost of removal of 170 trees under the jurisdiction of Nagpur Division, Nagpur as per estimates received from RFO, Katol	769505/-
2		Cost of removal of 94 trees under the jurisdiction of Nagpur Division, Nagpur as per estimates received from RFO, Kondhali	177500/-
Total			947005/-

82  
(डॉ. भारत सिंह हाडा)  
उपवनसंरक्षक,  
नागपूर वनविभाग नागपूर

प्रतिलिपी:- अपर प्रधान मुख्य वनसंरक्षक व केंद्रस्थ अधिकारी म.रा., नागपूर यांना माहितीस सविनय सादर.

प्रतिलिपी:- मा. वनसंरक्षक(प्रादेशिक), नागपूर वनवृत्त, नागपूर यांना माहितीस सविनय सादर.

प्रतिलिपी:- सहाय्यक वनसंरक्षक (काटोल), नागपूर वनविभाग नागपूर यांना माहितीकरिता अग्रेषित.

प्रतिलिपी:- वनपरिक्षेत्र अधिकारी, काटोल/कोंढाळी, नागपूर वनविभाग नागपूर यांना माहिती व आवश्यक कार्यवाहीकरिता अग्रेषित.



**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-1

**UNDERTAKING FOR CONDITION NO. i**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line.

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date: 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

Legal status of the diverted forest land shall remain unchanged;

**Undertaking:-**

We, the user agency agrees and undertakes that the legal status of the diverted forest land will remain unchanged.

Place : Amravati

Date: 24 / 03/ 2025

(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**



**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-2

**UNDERTAKING FOR CONDITION NO. ii**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line.

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date: 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**


The Regional Office, Nagpur shall initiate action under section 3A/3B of Van (Sanrakshan Evam Samvardhan) Adhinyam, 1980 (as applicable).

**Undertaking:-**

We, the user agency agrees and undertakes that the Regional Office, Nagpur may initiate action under section 3A/3B of Van (Sanrakshan Evam Samvardhan) Adhinyam, 1980 (as applicable).

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati,

**Executive Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground  
Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

---

Exhibit-3a

**UNDERTAKING FOR CONDITION NO.iii (a)**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV  
Kalmeshwar - Warud Transmission Line.

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date: 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

**iii Compensatory Afforestation (CA):**

a) Compensatory Afforestation over the identified degraded forest land of 12.50 ha. on Compartment No. 251, Gut No. 328, in village Kurhad, Taluka- Ghatanji, District- Yavatmal Maharashtra State shall be raised at the project cost under the supervision of the State Forest Department and Afforestation work shall within two years from the date of final approval and maintained thereafter in accordance with the approved CA scheme in consultation with the State Forest Department;

**Undertaking:-**

We the user agency agree and undertake for Compensatory Afforestation over the identified degraded forest land of 12.50 ha. on Compartment No. 251, Gut No. 328, in village Kurhad, Taluka- Ghatanji, District- Yavatmal Maharashtra State shall be raised at the project cost under the supervision of the State Forest Department and Afforestation work shall within two years from the date of final approval and maintained thereafter in accordance with the approved CA scheme in consultation with the State Forest Department; Payment of Rs.1,10,92,313/- ( Rupees One crore ten lakh ninety two thousand three hundred thirteen only) is deposited for Compensatory Afforestation to CAMPA. Screen shot from Parivesh for amount paid is attached.

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.  
**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-3b

**UNDERTAKING FOR CONDITION NO.iii (b)**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line.

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date: 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

**Compensatory Afforestation:**

b) The User Agency shall transfer the cost of raising and maintaining the compensatory Afforestation as per the approved CA scheme at the current wage rate in consultation with State Forest Department in the account of CAMPA of the concerned State through online portal;

**Undertaking:-**

With due reference to the above condition, and as per the demand letter for Compensatory Afforestation that to be taken up by the Forest Department over 12.50 ha. degraded Forest land, in Compt. No. 251, Gut No. 328, Beat Rampur, Round Koli, Range-Ghatanji at Village Kurhad, Taluka- Ghatanji, District-Yavatmal, Maharashtra State the Payment of Rs.1,10,92,313/- ( Rupees One crore ten lakh ninety two thousand three hundred thirteen only) is deposited through online portal to CAMPA. Screen shot from Parivesh for amount paid is attached.

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

---

Exhibit-3C

**UNDERTAKING FOR CONDITION NO. iii (c)**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

**Compensatory Afforestation:**

The cost of survey, demarcation and erection of permanent pillars, if required on the identified CA land shall be deposited advance with the Forest Department by the user agency. The CA will be maintained for 10 years. The Scheme may include Afforestation of indigenous species with appropriate provision for anticipated cost increase for works scheduled for subsequent years.

**Undertaking:-**

We undertake that, the cost of survey, demarcation and erection of permanent pillars, on the identified CA land is included in the payment deposited for Compensatory Afforestation. The CA will be maintained for 10 years. The Scheme may include Afforestation of indigenous species with appropriate provision for anticipated cost increase for works scheduled for subsequent years. Payment for Compensatory Afforestation including cost of survey, demarcation and erection of permanent pillars, on the identified CA land, Payment of Rs.1,10,92,313/- ( Rupees One crore ten lakh ninety two thousand three hundred thirteen only) is deposited through online portal to CAMPA. Screen shot from Parivesh for amount paid is attached.

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati



**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-3D

**UNDERTAKING FOR CONDITION NO. iii (d)**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

**Compensatory Afforestation:**

The land identified for the purpose of CA shall be clearly depicted on Survey of India Toposheet map of 1 : 50, 000 scale;

**Undertaking:-**

The land identified for the purpose of CA is clearly depicted on Survey of India Topo sheet map of scale 1 : 50, 000 is attached.

Place : Amravati

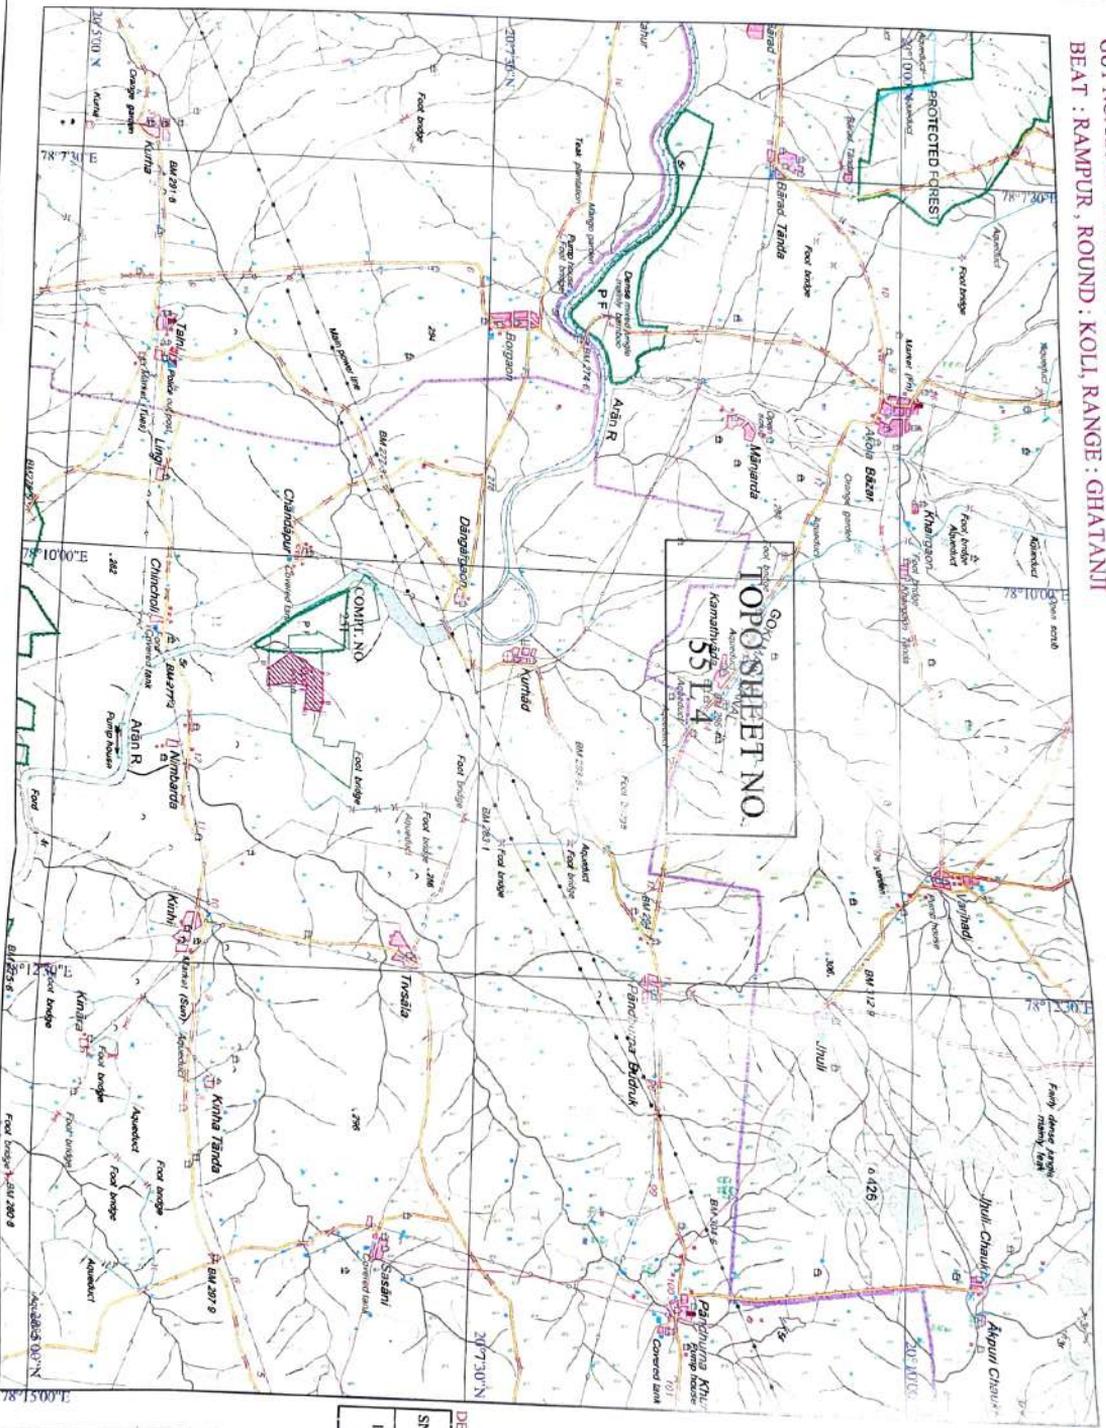
Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**TOPO SHEET MAP**  
 (PROTECTED FOREST LAND) TO BE TAKEN IN COMPARTMENT NO 251,

FOR SHOWING COMPENSATORY AFFORESTATION AND DOUBLE DEGRADED FOREST LAND TO BE TAKEN IN COMPARTMENT NO 251,  
 GUT NO. 328 OF VILLAGE KURHAD, TAL- GHATONJI, DIST-YAVATMAL FOR 220 KV KALMESHWAR-WARUD TRANSMISSION LINE.  
 BEAT : RAMPUR, ROUND : KOLI, RANGE : GHATANJI



C.A AREA VILLAGE KURHAD (18.65 HA)			
COORDINATES OF CALAND			
SN	Point	Latitude	Longitude
1	A	20°033.63'N	78°10'42.91"E
2	B	20°033.99'N	78°10'53.40"E
3	C	20°032.91'N	78°10'56.65"E
4	D	20°037.67'N	78°10'56.09"E
5	E	20°027.95'N	78°10'47.65"E
6	F	20°022.48'N	78°10'46.69"E
7	G	20°014.67'N	78°10'48.27"E
8	H	20°014.48'N	78°10'42.15"E
9	I	20°031.82'N	78°10'36.17"E

वपरिचय अधिकारी (प्रादे.)  
 शाहूरी

Dy Conservator of Forest  
 Yavatmal Dist. Yavatmal

DETAILS OF COMPENSATORY AFFORESTATION LAND			
SN	GUT NO.	AREA AS PER 7/12 ABSTRACT	AFFORESTATION AREA
1	23	82.00-95	C.A. Area 12.50-00 Out of 18.45-00 Working Area

NOTES:-  
 WORKING AREA ( 18.65 Ha. )  
 COMPARTMENT AREA NO 251  
 VILLAGE KURHAD

SCALE 1 : 50,000

DATE

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-3E

**UNDERTAKING FOR CONDITION NO. iii (e)**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -iii (e)**

**Compensatory Afforestation:**

The matter regarding imposition of penal CA is under consideration for the formulation of a uniform policy guideline in the matter. Keeping this in view, the imposition of penal CA (if any) shall be as per the said guideline, if applicable.

**Undertaking:-**

We undertake that the matter regarding imposition of penal CA is under consideration for the formulation of a uniform policy guideline in the matter. Keeping this in view, the imposition of penal CA (if any) may be as per the said guideline, if applicable.

Place : Amravati

Date: 24/ 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.  
**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

# Maharashtra State Electricity Transmission Co. Ltd.

(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-4A

## UNDERTAKING FOR CONDITION NO. iv (a)

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

**iv. Net Present Value (NPV) :-**

a) The User Agency shall transfer the funds towards the cost of Net Present Value (NPV) of the forest land being diverted under this proposal in accordance with the MoEF&CC's guidelines;

**Undertaking:-**

We , the User Agency has transferred the funds towards the cost of Net Present Value (NPV) of the forest land being diverted under this proposal in accordance with the MoEF&CC's guidelines; The payment of Rs. 58,19,471/- (Rs. Fifty eight lac nineteen thousand four hundred seventy one only) is deposited in CAMPA. Screen shot from Parivesh for amount paid is attached.

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.  
Executive Engineer  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-4B

**UNDERTAKING FOR CONDITION NO. iv (b)**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

b. The penalty for violation shall be equal to NPV of forest land per hectare for each year of violation from the date of actual diversion as reported by the inspecting officer with maximum up to five (5) times the NPV plus 12 percent simple interest from the date of raising of such demand till the deposit is made;

**Undertaking:-**

We undertake that, the payment for the penalty for violation shall be equal to NPV of forest land per hectare for each year of violation from the date of actual diversion as reported by the inspecting officer with maximum up to five (5) times the NPV plus 12 percent simple interest from the date of raising of such demand till the deposit is made. As per demand letter received the payment of Rs. 2,22,25,285/- (Rs. Two crore twenty two lac twenty five thousand two hundred eighty five only) is deposited in CAMPA. Screen shot from Parivesh for amount paid is attached.

Place : Amravati

Date: 24/ 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**

**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-4c

**UNDERTAKING FOR CONDITION NO. iv (c)**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

c. At the time of payment of the Net Present Value (NPV) at the present rate, the User Agency shall furnish an undertaking to pay the additional amount of NPV, if so determined, as per the final decision of the Hon'ble Supreme Court of India;

**Undertaking:-**

We the user agency undertake that, we agree to pay the additional amount of NPV, if so determined, as per the final decision of the Hon'ble Supreme Court of India

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

## AGENCY COPY



## NEFT / RTGS CHALLAN for CAMPA Funds

Date : 24-03-2025

Agency Name.	MAHARASHTRA STATE ELECTRICITY TRANSMISSION COMPANY LTD CIN NO U40109MH2005SGC153646
Application No.	6438296993
MoEF/SG File No.	FC-II/MH-216/2023-NGP
Location.	MAHARASHTRA
Address.	EHV Construction Division, M.S.E.T.C.L, Old Power house Campus, Near Duffrin Hospital, AmravatiAmravati
Amount(in Rs)	46408820/-

**Amount in Words** :Four Crore Sixty-Four Lakh Eight Thousand Eight Hundred and Twenty Rupees Only

**NEFT/RTGS to be made as per following details;**

Beneficiary Name:	MAHARASHTRA CAMPA
IFSC Code:	UBIN0996335
Pay to Account No.	150786438296993 Valid only for this challan amount.
Bank Name & Address:	Union Bank Of India FCS Centre,21/1, III Floor, Jelitta Towers, Mission Road, Bengaluru-560027

- This Challan is strictly to be used for making payment to CAMPA by NEFT/RTGS only

## BANK COPY



## NEFT / RTGS CHALLAN for CAMPA Funds

Date : 24-03-2025

Agency Name.	MAHARASHTRA STATE ELECTRICITY TRANSMISSION COMPANY LTD CIN NO U40109MH2005SGC153646
Application No.	6438296993
MoEF/SG File No.	FC-II/MH-216/2023-NGP
Location.	MAHARASHTRA
Address:	EHV Construction Division, M.S.E.T.C.L, Old Power house Campus, Near Duffrin Hospital, Amravati Amravati
Amount(in Rs)	46408820/-

**Amount in Words** :Four Crore Sixty-Four Lakh Eight Thousand Eight Hundred and Twenty Rupees Only


**NEFT/RTGS to be made as per following details;**

Beneficiary Name:	MAHARASHTRA CAMPA
IFSC Code:	UBIN0996335
Pay to Account No.	150786438296993 Valid only for this challan amount.
Bank Name & Address:	Union Bank Of India FCS Centre, 21/1, III Floor, Jelitta Towers, Mission Road, Bengaluru-560027

- This Challan is strictly to be used for making payment to CAMPA by NEFT/RTGS only

**Note:**After making the required payment through challan, if the payment status has not been updated even after 7 working days, then kindly mail a copy of your challan with transaction date and reference id to Email: [fcsblr@unionbankofindia.bank](mailto:fcsblr@unionbankofindia.bank) , [epurse@unionbankofindia.bank](mailto:epurse@unionbankofindia.bank), [ubin0903710@unionbankofindia.bank](mailto:ubin0903710@unionbankofindia.bank)

*Jm*  
**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati



24  
 Universal Banking Solution from Infosys March, | User RK077922 | 0468 | Menu  
 2025 Shortcut:

Account Ledger Inquiry

A/c. ID		D4680200000156 INR 0468 MAHARASHTRA STATE ELECTRICITY TRASMISSION COMPANY LTD						Help
A/c. Status	ACTIVE	A/c. Status Date	24-05-2024					
A/c. Open Date	02-01-2006	A/c. Close Date						
Gl. Subhead	13206	A/c. Type	CUSTOMER ACCOUNT					
Opening Bal.	INR	Available Amt.	INR		8,68,73,823.89	CR		
					13,42,71,048.89	CR		
Closing Bal.	INR	Effective Available Amt.	INR		8,68,73,823.89	CR		
					8,78,62,170.89	CR		
Funds in Ctg.	INR	Float Bal.	INR		0.00	CR		
					0.00	CR		
Page 1 of 1								
Tran. Date	Value Date	Instr. No.	Particulars	CCY	Debit Amt	Credit Amt	Bal	
24-03-2025	24-03-2025	28215	RTGS- BARBR52025032400974445- MAHARASHTRA CAMPA- UNIO	INR	4,64,08,820.00		8,78,62,170.89CR	
24-03-2025	24-03-2025		Charges for PORD Customer Payment 002876166421	INR	58.00		13,42,70,990.89CR	

If You Want To View More Details Then [CLICK HERE](#)

  
 Executive Engineer  
 E.H.V. Projects Division,  
 M.S.E.T.C.L. Amravati



बैंक ऑफ बड़ौदा Bank of Baroda



BOB/AMRAVA/ADV/2024-25/177

Date: 24-03-2025

To,  
The Executive Engineer,  
EHV Project Division,  
Amravati

Madam/ Dear Sir,

**Re: Payment of Rs. 4,64,08,820/- to Maharashtra CAMPA.**

**Your request letter no. : MSETCL/EE/EHV/PROJ/DN/AMT/F&A/No. 603 dated 24/03/2025**

With reference to the above, we write to inform you that, we have processed the transaction as request.


Please find the transaction details as under:


Debit Account Details	Credit Account Details (Beneficiary)
Name: MAHARASHTRA STATE ELECTRICITY TRANSMISSION COMPANY LTD Account No. 04680200000156 Bank: BANK OF BARODA IFSC: BARBOAMRAVA	Name: MAHARASHTRA CAMPA Account No. 150786438296993 Bank: UNION BANK OF INDIA IFSC: UBIN0996335
Mode of Payment	RTGS
Debit Instrument /No.	Cheque / 028215
Transaction Date	24-03-2025
Amount of Transaction	Rs. 4,64,08,820.00
UTR No.	BARBR52025032400974445
Payment Order Id	002676166421

Please find the above information as confirmation of the above transaction.

Please acknowledge the receipt of the same.

Yours faithfully

  
(Rajmohan Kar)  
Chief Manager  
Amravati (Main) Branch

  
**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**MAHARASHTRA STATE ELECTRICITY TRANSMISSION COMPANY LTD**  
 M'EH'CE'V P'OD'E'T D'V' P'A'A'7'H S'R'I'  
 A'M'N B'I'D'N' A W'N' G'O'N' F'O'R 2'0 K'  
 A'A'A  
 M'H'R'S'T'A-4'4'0'  
 I'D'A

Customer Id: 5NA065704

Account No: 046XXXXXXX156

Branch Name: AMRAVATI, MAHARASHTRA

MICR Code: 414012101

IFSC Code: BARB0AMRAVA

Your Account Statement as on 24/03/2025

Statement Period from 21/03/2025 to 24/03/2025

Statement of transactions in Current Account 046XXXXXXX156 in INR for the period 21/03/2025 - 24/03/2025

MAHARASHTRA STATE ELECTRICITY TRANSMISSION COMPANY LTD		Current Account - 046XXXXXXX156				
TRAN DATE	VALUE DATE	NARRATION	CHQ NO.	WITHDRAWAL/CRD	DEPOSIT/CRD	BALANCE
24/03/2025	24/03/2025	HARSH MAHADEVRAO SONTAKE	23328	6,92,307.00		8,68,73,823.89
24/03/2025	24/03/2025	NARENDRA A ASEKAR	27736	1,623.00		8,70,06,130.89
24/03/2025	24/03/2025	M SACHIN NAMDEVRAO TAYA	27502	37,713.00		8,70,67,753.89
24/03/2025	24/03/2025	M CHETAN GHANSHYAM THOM	27890	1,39,104.00		8,70,05,466.89
24/03/2025	24/03/2025	RADSAHEB PATWARDHAN	27777	57,120.00		8,71,44,570.89
24/03/2025	24/03/2025	ASHOK S KATOKE	27773	20,160.00		8,70,01,690.89
24/03/2025	24/03/2025	NARENDRA A ASEKAR	27772	40,320.00		8,78,21,850.89
24/03/2025	24/03/2025	RTGS-BARBR52025032400974445-MAHARASHTRA CAMPA-UNIO	28216	4,64,08,820.00		8,78,62,170.89
24/03/2025	24/03/2025	Charges for PORD Customer Payment 002670166421		58.00		13,42,70,990.89
21/03/2025	21/03/2025	EBANK:WB:1447366411/Thakre P1 Recoup		2,660.00		13,42,71,048.89
21/03/2025	21/03/2025	NEFT-BARBT25080180693-VAIBHAV PRAHLAD DANDGE-BANK O		29,700.00		13,42,73,708.89
21/03/2025	21/03/2025	Charges for PORD Customer Payment 002670959439		5.80		13,43,03,408.89
21/03/2025	21/03/2025	NEFT-BARBT25080177548-SUJATA RAJNISH KAMBLE-BANK O		16,345.00		13,43,03,414.49
21/03/2025	21/03/2025	Charges for PORD Customer Payment 002670957899		5.80		13,43,19,759.49
21/03/2025	21/03/2025	NEFT-BARBT25080164491-ASHISH HEMRAJ DHOTE-HDFC BAN		4,600.00		13,43,19,765.09

**Your safety is in your hands**

Do not share your Account Number / PIN / OTP for extending your EMI  
 Bank will never ask for such details  
 #StaySafeBankSafe

*Jane*  
 Executive Engineer  
 E.H.V. Projects Division,  
 M.S.E.T.C.L. Amravati

Funds to be deposited in Govt. Exchequer

Help

Click on **Generate Challan** to generate challan.

- Paid**: This icon shows that the payment has been deposited.
- To be Paid**: This icon shows that the payment of this yet to be made.
- Challan Generated**: This icon shows that the challan has been generated.

Proposals received on or after 15th July 2014  All Proposals received upto 14th July 2014

Sno.	Proposal No.	Application No	Application No (New)	Proposal Name	Category	Area (ha.)	User Agency Name	Date of IN-PRINCIPLE	Demand Verified Date	Action	Fill Payment Details	Status
1	PP/MH/TRANS/38296/2019	TRANS382962019993	6438296993	construction of 220KV Kalmesliwar - Warud Transmission Line	Transmission Line	6.076	MAHARASHTRA STATE ELECTRICITY TRANSMISSION COMPANY LTD CIN NO U40109MH2005SGCL153646	20-3-2025	24-3-2025		Paid	
2	PP/MH/TRANS/39229/2019	TRANS392292019015	6439229015	220KV Deoli- Ghatoli Line upto LIUD Point	Transmission Line	5.7225	MAHARASHTRA STATE ELECTRICITY TRANSMISSION COMPANY LTD CIN NO U40109MH2005SGCL153646	03-8-2023	08-9-2023		Paid	
3	PP/MH/TRANS/44297/2020	TRANS442972020998	6444297998	Construction of 220KV Wani- Pandharkewade transmission line	Transmission Line	3.57	MAHARASHTRA STATE ELECTRICITY TRANSMISSION COMPANY LTD CIN NO U40109MH2005SGCL153646	10-10-2022	02-12-2022		Paid	
4	PP/MH/TRANS/15367/2015	TRANS153672015229	6415367229	132KV Line for Yavatmal MIDC	Transmission Line	2.385	MAHARASHTRA STATE ELECTRICITY TRANSMISSION COMPANY LTD CIN NO U40109MH2005SGCL153646	03-10-2016	13-9-2019		Paid	
5	PP/MP/TRANS/10687/2015	TRANS106872015502	6410687502	132 KV Dharni-Nepanagar Tr line	Transmission Line	6.775	MAHARASHTRA STATE ELECTRICITY TRANSMISSION COMPANY LTD CIN NO U40109MH2005SGCL153646	02-6-2016	31-8-2018		Paid	
6	PP/MH/TRANS/15367/2015	TRANS153672015219	116153672015219	132KV Line for Yavatmal MIDC	Transmission Line	2.385	MAHARASHTRA STATE ELECTRICITY TRANSMISSION COMPANY LTD CIN NO U40109MH2005SGCL153646	03-10-2016	25-10-2016		Paid	



Online payment history made by User Agency under CAMPA

Ino.	Proposal Detail	Application_No	Application No (New)	Date of IN-PRINCIPLE	Amount to be Paid / Amount Paid (in Rs.)	Payment Status	Payment Detail	Demand Letter
1	PRY/MM/TRANS/38296/2019 construction of 220KV Kalmeshivan - Warud Transmission Line	TRANS382962019993	6438296993	20 Mar 2025	CA: 11092313/- Addl CA : 0/- PCA: 0/- CAT : 0/- Safety Zone: 0/- Addl PA : 0/- NPV: 5819471/- Penal Charges for NPV : 22225285/- Medicinal Plantation : 5391751/- Boundary Pillars : 1350000/- Alternative Bird Nests : 530000/- Total : 46408825/-	Paid	Fund Demand Verified by : 24 Mar 2025 Nodal Officer On : Bank Name : Union Bank Of India Mode of Payment : NEFT/RTGS (Challan) Challan Generated On : 24 Mar 2025 Transaction Date : 24 Mar 2025	Demand Letter Generated Challan

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-5

**UNDERTAKING FOR CONDITION NO. v**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**


- v. All the funds received from the user agency under the proposal shall be transferred/deposited in CAMPA account only through e-portal (<https://parivesh.nic.in/>). Amount deposited through other mode will not be accepted as compliance of the Stage-I clearance;

**Undertaking:-**

We, the user agency have deposited all the funds as per demand letter in CAMPA account through e-portal (<https://parivesh.nic.in/>). Amount deposited through other mode will not be accepted as compliance of the Stage-I clearance;

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**

**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-6

**UNDERTAKING FOR CONDITION NO. vi**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**


vi. The State Government shall upload the KML files of the area under diversion and the accepted area for raising compensatory afforestation in the e-Green watch portal of FSI, before handling over forest land to the user agency;

**Undertaking:-**

We, the user agency request State Government to upload the KML files of the area under diversion and the accepted area for raising compensatory afforestation in the e-Green watch portal of FSI, before handling over forest land to the user agency

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive-Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**



**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahastransco.in, Phone No. 0721 - 2669168

Exhibit-7

**UNDERTAKING FOR CONDITION NO. vii**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

vii. The User Agency shall obtain the Environment Clearance as per the provisions of the Environmental (Protection) Act; 1986; if required;

**Undertaking:-**

Being the project is of Transmission line, the Environment Clearance as per the provisions of the Environmental (Protection) Act; 1986 is not applicable.

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**



**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-8

**UNDERTAKING FOR CONDITION NO. viii**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**


viii. Width of right of way for the transmission line shall be limited to 35 meter;

**Undertaking:-**

We, the user agency undertake that, Width of right of way for the transmission line will be limited to 35 meter

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.  
**Executive Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-9

**UNDERTAKING FOR CONDITION NO. ix**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**


ix. The user agency shall install circuit breakers at suitable places besides maintain necessary ground clearance to prevent electrocution of wild animals;

**Undertaking:-**

We, the user agency undertake that, we shall install circuit breakers at suitable places besides maintain necessary ground clearance to prevent electrocution of wild animals.

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground  
Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-10

**UNDERTAKING FOR CONDITION NO. X**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV  
Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

x. No approach road shall be constructed in the forest area for transportation of steel and other material required for the transmission line. As far as possible the User Agency shall use the existing road and the proposed RoW for the transportation of the material and in the event of non-availability of such facilities, the User Agency shall transport material manually without construction of any path;

**Undertaking:-**

We, the user agency undertake that, No approach road shall be constructed in the forest area for transportation of steel and other material required for the transmission line. As far as possible the User Agency shall use the existing road and the proposed RoW for the transportation of the material and in the event of non-availability of such facilities, the User Agency shall transport material manually without construction of any path;

Place : Amravati

Date: 24 / 03/ 2025



(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-11A

**UNDERTAKING FOR CONDITION NO. xi (a)**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

- xi. To minimize the felling for construction of transmission line, user agency shall comply with the following guidelines:
- a. Below each conductor, width clearance of 3 meters would be permitted for carrying the tension stringing equipment. The trees on such strips may be felled but after stringing work is completed, the natural regeneration will be allowed to come up.

**Undertaking:-**

We, the user agency undertake that, below each conductor, width clearance of 3 meters would be permitted for carrying the tension stringing equipment. The trees on such strips may be felled but after stringing work is completed, the natural regeneration will be allowed to come up

Place : Amravati

Date: 24 / 03/ 2025



(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

Executive Engineer  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-11B

**UNDERTAKING FOR CONDITION NO. xi (b)**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

- xi. To minimize the felling for construction of transmission line, user agency shall comply with the following guidelines:
- b. One outer strip may be left clear to permit maintenance of the transmission line;

**Undertaking:-**

We, the user agency undertake that, One outer strip may be left clear to permit maintenance of the transmission line

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.  
**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-11C

**UNDERTAKING FOR CONDITION NO. xi (c)**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 **Date :** 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

- xi. To minimize the felling for construction of transmission line, user agency shall comply with the following guidelines:
- c. In the remaining width the right of way felling/pollarding/pruning of trees will be done with the permission of the local forest officer whenever necessary to maintain the electrical clearance, trees shall be allowed to be felled or lopped to the extent required, for preventing electrical hazards by maintaining the minimum 4.6 meter clearance between conductors and trees. The sag and swing of the conductors are to be kept in view while working out the minimum clearance mentioned as above;

**Undertaking:-**

We, the user agency undertake that, In the remaining width the right of way felling/pollarding/pruning of trees will be done with the permission of the local forest officer whenever necessary to maintain the electrical clearance, trees shall be allowed to be felled or lopped to the extent required, for preventing electrical hazards by maintaining the minimum 4.6 meter clearance between conductors and trees. The sag and swing of the conductors are to be kept in view while working out the minimum clearance mentioned as above;

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.  
**Executive Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-11D

**UNDERTAKING FOR CONDITION NO. xi (c)**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

- xi. To minimize the felling for construction of transmission line, user agency shall comply with the following guidelines:
- d. User agency in consultation with the State Forest Department prepare a detailed scheme for creation and maintenance of plantation of dwarf species (preferably medicinal plants) in right of way under the transmission line, and provide funds for execution of the said scheme to the State Forest Department; and

**Undertaking:-**

We, the user agency undertake that, in consultation with the State Forest Department have prepared a detailed scheme for creation and maintenance of plantation of dwarf species (preferably medicinal plants) in right of way under the transmission line, and provided funds for execution of the said scheme to the State Forest Department. Copy of scheme for medicinal plantation is attached. As per approved demand letter the payment of Rs. 53,91,751/- (Rs. Fifty three lakh ninety one thousand seven hundred fifty one only) is deposited CAMPA. Screen shot from Parivesh for amount paid is attached.

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

Executive Engineer  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-12

**UNDERTAKING FOR CONDITION NO. xii**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

xii. No labour camp shall be established on the forest land and the User Agency shall provide firewood preferably alternate fuels to the labourers and the staff working at the site so as to avoid any damage and pressure on the nearby forest areas;

**Undertaking:-**

We, the user agency undertake that, No labour camp shall be established on the forest land and the User Agency shall provide firewood preferably alternate fuels to the labourers and the staff working at the site so as to avoid any damage and pressure on the nearby forest areas

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

Executive Engineer  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-13

**UNDERTAKING FOR CONDITION NO. XIII**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**


xiii. The boundary of the diverted forest land shall be demarcated on ground at the project cost, by erecting four feet high reinforced cement concrete pillars, each inscribed with its serial number, forward and back bearing and distance from pillar to pillar;

**Undertaking:-**

We, the user agency undertake that , The boundary of the diverted forest land shall be demarcated on ground at the project cost, by erecting four feet high reinforced cement concrete pillars, each inscribed with its serial number, forward and back bearing and distance from pillar to pillar. As per approved demand letter payment of Rs. 13,50,000/- (Rs. Thirteen lakh fifty thousand only) is deposited in CAMPA. Screen shot from Parivesh for amount paid is attached.

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
E.H.V. Projects Division,  
MSETCL, Amravati



**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-14

**UNDERTAKING FOR CONDITION NO. XIV**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

xiv. The forest land shall not be used for any purpose other than that specified in the proposal;

**Undertaking:-**

We, the user agency undertake that, The forest land shall not be used for any purpose other than that specified in the proposal

Place : Amravati

Date: 24/ 03/ 2025

(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.  
**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati



**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-15

**UNDERTAKING FOR CONDITION NO. XV**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

xv. The User Agency shall ensure that because of this project, no damage is caused to the wildlife available in the area;

**Undertaking:-**

We, the user agency undertake that, the User Agency shall ensure that because of this project, no damage is caused to the wildlife available in the area.

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-16

**UNDERTAKING FOR CONDITION NO. XVI**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

xvi. The user agency shall explore the possibility of translocation of maximum number of trees identified to be felled and shall ensure that any tree felling shall be done only when it is unavoidable and that too under strict supervision of the State Forest Department;

**Undertaking:-**

We, the user agency undertake that, the user agency shall explore the possibility of translocation of maximum number of trees identified to be felled and shall ensure that any tree felling shall be done only when it is unavoidable and that too under strict supervision of the State Forest Department

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.  
Executive Engineer  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-17

**UNDERTAKING FOR CONDITION NO.XVII**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

xvii. The cost of felling of trees shall be deposited by the User Agency with the State Forest Department;

**Undertaking:-**


We, the user agency undertake that, As per demand note, the cost of felling of trees, Rs. 9,47,005 ( Rupees Nine lakh forty seven thousand five only is paid by Demand Draft (Rs. 9,47,005/-) payable to Deputy Conservator of Forest, Forest Division, Nagpur. DD No. dated 25/03/2025.

Place : Amravati

Date: 24/ 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

Executive Engineer  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati



बैंक ऑफ बड़ौदा  
Bank of Baroda

अमरावती - ४४४ ६०१  
AMRAVATI - 444 601  
RTGS/NEFT IFSC CODE BARB0AMRAVA  
04680015181192

डिमांड DEMAND  
ड्राफ्ट DRAFT

जो किंग जने की कटौत के लिए नहीं है एक बैंक VALID FOR THREE MONTHS FROM THE DATE OF ISSUE

25 03 20 25  
D D M M Y Y Y Y

मौजि जाने पर  
On Demand Pay

DY CONSERVATOR OF FOREST NAGPUR DIVISION,  
NAGPUR

या उनके आदेश पर  
Or Order

रुपये  
Rupees

Nine Lakh Forty Seven Thousand Five only

xxx — xx — xxx —

अदा करें

₹ 9,47,005.00

मूल्य प्राप्त हुआ / FOR VALUE RECEIVED

Net Over INR 9,47,005.00  
Purchaser Name: Maharashtra  
State Electricity Transmission  
Company Ltd.

कुते बैंक ऑफ बड़ौदा  
For Bank of Baroda

अदाकर्ता शाखा / Drawee Branch

(SERNA9)  
136325

संयुक्त प्रबंधक / Joint Manager

ह.स.न. / S.S. NO. (17686)

शाखा प्रबंधक / Branch Manager

ह.स.न. / S.S. NO. (K/2276)

DD/2015/WD  
(DD Alpha Prefix)

अल्फा कूट ALPH CODE

A M R A V A

136325 444012101 200468 16

**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-18

**UNDERTAKING FOR CONDITION NO.XVIII**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date: 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**


xviii. The layout plan of the proposal shall not be changed without the prior approval of the Central Government;

**Undertaking:-**

We, the user agency undertake that, the layout plan of the proposal shall not be changed without the prior approval of the Central Government;

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati



**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-19

**UNDERTAKING FOR CONDITION NO. XVIII**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date: 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

xix. The forest land proposed to be diverted shall under no circumstances be transferred to any other agency, department or person without prior approval of the Central Government;

**Undertaking:-**

We, the user agency undertake that, the forest land proposed to be diverted shall under no circumstances be transferred to any other agency, department or person without prior approval of the Central Government.

Place : Amravati

Date: 24/ 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.  
**Executive Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground  
Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

---

Exhibit-20

**UNDERTAKING FOR CONDITION NO. XX**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV  
Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**


- xx. The user agency in consultation with the State Government shall create and maintain alternate habitat/home for the avifauna, whose nesting trees are to be cleared in this project. Bird's nests artificially made out of eco-friendly material shall be used in the area, including forest area and human settlements, adjoining the forest area being diverted for the project;

**Undertaking:-**

We, the user agency undertake that, the user agency in consultation with the State Government shall create and maintain alternate habitat/home for the avifauna, whose nesting trees are to be cleared in this project. Bird's nests artificially made out of eco-friendly material shall be used in the area, including forest area and human settlements, adjoining the forest area being diverted for the project. As per approved demand letter the payment of Rs. 5,30,000/- (Rs. Five lakh thirty thousand only) is deposited to CAMPA for alternative bird nests. Screen shot from Parivesh for amount paid is attached.

Place : Amravati

Date: 24 / 03 / 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-21

**UNDERTAKING FOR CONDITION NO. XXI**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 **Date :** 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**


xxi. The User Agency shall implement the R & R Plan, if applicable, as per the R & R Policy of State Government in consonance with National R&R Policy, Government of India before the commencement of the project work and implementation. The said R & R Plan will be monitored by the State Government/Regional Office of MoEF&CC;

**Undertaking:-**

We, the user agency undertake that the R & R Plan is not involved and hence its implementation is not applicable.

Place : Amravati

Date: 24/ 03/ 2025



(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.  
**Executive Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-22

**UNDERTAKING FOR CONDITION NO. XXII**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**


xxii. The User Agency shall submit the annual self -compliance report in respect of the above stated conditions to the State Government, concerned Regional Office and to this Ministry by the end of March every year regularly;

**Undertaking:-**

We, the user agency undertake that, the User Agency shall submit the annual self -compliance report in respect of the above stated conditions to the State Government, concerned Regional Office and to this Ministry by the end of March every year regularly.

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.  
**Executive Engineer**  
**E.H.V. Projects Division,**  
**M.S.E.T.C.L. Amravati**

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground  
Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

---

Exhibit-23

**UNDERTAKING FOR CONDITION NO. XXIII**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV  
Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

xxiii. Any other condition that the concerned Regional Office of this Ministry may stipulate with the approval of competent authority in the interest of conservation, protection and development of forests & wildlife;

**Undertaking:-**

We, the user agency undertake that, the Wildlife proposal No. WL/MH/Trans/ 450298/2023 is recommended for approved by NBWL in 79<sup>th</sup> and 81<sup>st</sup> meeting dated 31/07/2024 and dated 21/12/2024 respectively.

As per SBWL condition Rs. 0.15 Crore (Rs. Fifteen lakh only) has been deposited for wildlife conservation.

The copy of the wildlife clearance is attached herewith.

Place : Amravati

Date: 24 / 03 / 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

Executive Engineer  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati



महाराष्ट्र शासन  
महसूल व वन विभाग

प्रधान मुख्य वनसंरक्षक(वनबल प्रमुख), महाराष्ट्र राज्य, नागपूर यांचे कार्यालय.  
O/o Principal Chief Conservator of Forests (HoFF), Maharashtra State



Phone - 0712-2549563

E-mail - pccfwlmgp@mahaforest.gov.in

Website - www.mahaforest.gov.in

Principal Chief Conservator of Forests (Wildlife), Maharashtra State

"Van Bhavan" 3<sup>rd</sup> Floor, Rangiri Road, Civil Lines, Nagpur 440 001

पत्र-ईमेल क्रमांक:-कक्ष-२३(२)/वजी/सर्व्हे/प्र.क्र. १९०/५८६६ /२०२४-२५, दिनांक:- २५/०३/२०२५

प्रति,

कार्यकारी अभियंता, EHV प्रकल्प विभाग,  
प्रकाश सरिता, प्रशासकीय इमारत, ए-विंग,  
तळमजला, २२० के.व्ही. उपकेंद्र परिसर,  
मोर्शी रोड, अमरावती (Email- ee1620@mahatransco.in )

विषय:- बोर- पेंच व्याघ्र भ्रमणमार्गात २२० के.व्ही. कळमेश्वर ते वरूड दरम्यान वीज वाहिनी  
टाकण्यासाठी नागपूर जिल्ह्यातील ३०.६८४ हे. वन आणि वनेत्तर जमीनबाबत वन्यजीव  
मान्यतेचा प्रस्ताव. (बोर- पेंच व्याघ्र भ्रमणमार्ग)

- संदर्भ - १. या कार्यालयाचे पत्र क्रमांक कक्ष-२३(२)/वजी/सर्व्हे/प्र.क्र १९०/२१५४, दि. १३/१०/२०२३  
२. केंद्र शासन, पर्यावरण वने व हवामान बदल मंत्रालय (वन्यजीव विभाग), नवी दिल्ली  
यांचेकडील पत्र क्रमांक F.No. WL-6/88/2024-WL, दिनांक २३/०८/२०२४.  
(राष्ट्रीय वन्यजीव मंडळाच्या स्थायी समितीची ७९ वी बैठक, दिनांक ३१/०७/२०२४)  
३. या कार्यालयाचे पत्र क्रमांक कक्ष-२३(२)/वजी/सर्व्हे/प्र.क्र.१९०/२१६७, दि. ०७/१०/२०२४.  
४. केंद्र शासन, पर्यावरण वने व हवामान बदल मंत्रालय (वन्यजीव विभाग), नवी दिल्ली  
यांचेकडील पत्र क्रमांक F.No. WL-6/134/2024-WL, दिनांक 09/01/2025.  
(राष्ट्रीय वन्यजीव मंडळाच्या स्थायी समितीची ८१ वी बैठक, दिनांक २१/१२/२०२४)  
५. या कार्यालयाचे पत्र क्रमांक कक्ष-२३(२)/वजी/सर्व्हे/प्र.क्र.१९०/५५०७, दि. ०३/०३/२०२५.  
६. प्रकल्प यंत्रणेचे पत्र क्र. काअ/EE/EHV/Proj.DN/Amravati/Tech/598, दि. २०/०३/२०२५.

संदर्भाय पत्र १ अन्वये विषयांकित प्रकरणीचा प्रस्ताव राज्य वन्यजीव मंडळाचे निर्णयार्थ ठेवण्यासाठी  
राज्य शासनास सादर करण्यात आलेला होता. राज्य वन्यजीव मंडळाची २२ वी बैठक दिनांक  
१६/१०/२०२३ रोजी संपन्न झाली. सदर बैठकीमध्ये प्रस्तुत प्रस्तावावर मंडळाने चर्चा करून, प्रस्तुत  
प्रस्तावाचे अनुषंगाने, मंडळाने मुख्य वन्यजीव रक्षक, महाराष्ट्र राज्य यांनी घालून दिलेल्या अटी व शर्तीच्या  
अधिन राहून सदर प्रस्ताव राष्ट्रीय वन्यजीव मंडळाकडे सादर करण्याची मंडळाने शिफारस केली असून,  
सदर बैठकीचे कार्यवृत्तांत दिनांक ०७/११/२०२३ अन्वये शासनाने निर्गमित केले होते.


राज्य वन्यजीव मंडळाने घालून दिलेल्या अटीनुसार प्रकल्प यंत्रणेने मुद्रांकावर (Stamp Paper) लिखित हमीपत्र सादर केले असून, व्याघ्र भ्रमणगांतील प्रकल्प किंमतीच्या ५००.०० लक्षाचे २ % रक्कम रु. १०.०० लक्ष आणि १% दंडाची रक्कम रु. ०५.०० लक्ष असे एकुण रु. १५.०० लक्ष रक्कमेचा भरणा महाराष्ट्र राज्यातील वन्यजीव अभयारण्याच्या संवर्धन आणि संरक्षणासाठी वनसंरक्षक तथा क्षेत्र संचालक, पेंच व्याघ्र प्रकल्प, नागपूर यांच्याकडील व्याघ्र संवर्धन प्रतिष्ठान मध्ये भरणा करण्यात आलेली आहे. त्याबाबतचा अहवाल वनसंरक्षक तथा क्षेत्र संचालक, पेंच व्याघ्र प्रकल्प, नागपूर दिनांक ३१/१०/२०२३ रोजी या कार्यालयास सादर केले होते.

राष्ट्रीय वन्यजीव मंडळाच्या स्थायी समितीचे दिनांक ३१/०७/२०२४ रोजीचे ७९ व्या बैठकीमध्ये प्रस्तुत प्रस्तावास मान्यता प्रदान केली असून, मंडळाने घालून दिलेल्या अतिरीक्त अटीबाबत या कार्यालयाचे संदर्भ पत्र ३ अन्वये प्रकल्प यंत्रणेस मुद्रांकावर (Stamp Paper) हमीपत्र सादर करण्याबाबत कळविण्यात आलेले होते. तदनंतर राष्ट्रीय वन्यजीव मंडळाच्या स्थायी समितीचे दिनांक २१/१२/२०२४ रोजीचे ८१ व्या बैठकीमध्ये प्रस्तुत प्रस्तावावर चर्चा करून अतिरीक्त अट घालून मंजुरी प्रदान केलेली आहे. त्याअनुषंगाने या कार्यालयाचे संदर्भ पत्र ५ अन्वये अतिरीक्त अटीबाबत मुद्रांकावर (Stamp Paper) हमीपत्र सादर करण्याबाबत प्रकल्प यंत्रणेस कळविण्यात आलेले होते.

आता, प्रकल्प यंत्रणेचे संदर्भ पत्र ६ अन्वये केंद्र शासनाचे मार्गदर्शक सुचनेनुसार वन (संवर्धन व संरक्षण) अधिनियम १९८० अंतर्गत In Principal approval तसेच अतिरीक्त अटी बाबतचे दस्तावेज मुद्रांकावर या कार्यालयास सादर केलेले आहे. त्यामुळे प्रकल्प यंत्रणेने वन्यजीव मान्यतेची प्रक्रिया पूर्ण केलेली आहे. त्या अनुषंगाने प्रकल्प यंत्रणेने इतर प्राधिकरणाकडून काही परवानग्या घेणे आवश्यक असल्यास, त्या घेऊन कामे सुरू करण्याची मान्यता प्रदान करण्यात येत आहे.

सदर बाबीचे अनुषंगाने, भारतीय वन अधिनियम - १९२७, वन्यजीव (संरक्षण) कायदा १९७२, वन (संवर्धन व संरक्षण) कायदा १९८० व इतर प्रचलित नियमांचे भंग न होता प्रस्तावित कामे केली जातील ह्याची दक्षता घ्यावी.

सहपत्र :- वरील प्रमाणे.

  
(एम. श्रीनिवास राव)  
मुख्य वन्यजीव रक्षक तथा  
प्रधान मुख्य वनसंरक्षक (वन्यजीव),  
महाराष्ट्र राज्य

प्रतिलिपी:- अपर प्रधान मुख्य वनसंरक्षक तथा केंद्रस्थ अधिकारी यांना माहिती व योग्य त्या कार्यवाहीस अग्रेषित.

- प्रतिलिपी:- अपर प्रधान मुख्य वनसंरक्षक (वन्यजीव) पूर्व, नागपूर यांना माहिती व योग्य त्या कार्यवाहीस अग्रेषित.
- प्रतिलिपी:- वनसंरक्षक (प्रादेशिक), नागपूर यांना माहिती व योग्य त्या कार्यवाहीस अग्रेषित.
- प्रतिलिपी :- मुख्य वनसंरक्षक तथा क्षेत्र संचालक, पेंच व्याघ्र प्रकल्प, नागपूर यांना माहिती व योग्य त्या कार्यवाहीस अग्रेषित.
- प्रतिलिपी :- उपवनसंरक्षक (प्रादेशिक), नागपूर यांना माहिती व योग्य त्या कार्यवाहीस अग्रेषित. प्रकल्प यंत्रणेस घालून दिलेल्या अटींचे पालन करण्यात येत आहे, याची मौक्यावर जावून वेळोवेळी शाहनिशा करून त्याबाबतचा अहवाल विहित मार्गाने या कार्यालयास सादर करावा.

\*English Translation\*

Government of Maharashtra

Office of the Principle Chief Forest Conservator (Wild Life), Government of Maharashtra, Nagpur

Phone-0712-2549563, Van Bhavan, 3<sup>rd</sup> Floor, Ramgiri Road, Civil Lines, Nagpur- 440001  
E-Mail: pccfwlngp@mahaforest.gov.in,  
web : www.mahaforest.gov.in

Ltr.Email.No: Kaksh-23(2)/WL/Survey/P.No./190/5867/2024-25

Date:25/03/2025

To,  
Executive engineer,  
Praksh Sarita, Administrative Building, A-Wing,  
Ground Floor, 220 kV Sub-station Campus,  
Morshi Road, Amrawati ( Email- ee1620@mahatransco.in)

Subject: Proposal for 30.684 ha forest and non forest land for Laying of 220 kv Kalameshwar-Warud Tr. Line through Bor-Pench Tiger corridor ( Bor-Pench Tiger Corridor)

- Reference: 1) T.O.L. No. Kaksh-23(2)/WL/Survey/P.No./190/2154 dtd. 13/10/2023.  
2) Central Government/, MoEF&CC (Wild Life Division) New Delhi,  
Ltr. No. F.No.WL-6/88/2024-WL, dtd 23/08/2024.  
(79<sup>th</sup> Standing Committee meeting of NBWL dated 31/07/2024).  
3) T.O.L. No. Kaksh-23(2)/WL/Survey/P.No./190/2167 dtd. 07/10/2024.  
4) Central Government/, MoEF&CC (Wild Life Division) New Delhi,  
Ltr. No. F.No.WL-6/134/2024-WL, dtd 09/01/2025.  
(81<sup>th</sup> Standing Committee meeting of NBWL dated 21/12/2024).  
5) T.O.L. No. Kaksh-23(2)/WL/Survey/P.No./190/5507 dtd. 03/03/2025.  
6) User Agency letter no. EE/EHV/Proj.DN/Amravati/Tech/598 dtd. 20/03/2025.

The proposal as per ref letter 1 above was submitted to State Government. 22<sup>nd</sup> meeting of SBWL was held on 16/10/2023. The proposal was discussed in said meeting, accordingly, the board has recommended the proposal to submit to NBWL subject to conditions laid by Chief Wildlife Warden, Govt. Of Maharashtra. The minutes of said meeting were published by Government on 07/11/2023.

User Agency have submitted written undertaking on stamp duty (Stamp Paper) asper conditions laid by SBWL. Total amount of Rs. 15 lakh with breakup of Rs. 10 lakh for 2% of Project cost in Tiger Corridor and Rs. 5 lakh for 1% penal amount is paid by user agency to Pench Tiger Project for wild life conservation and protection within Maharashtra State. The report regarding the same was submitted by Forest Conservator and Area Director, Pench Tiger Project , Nagpur to this office on 31/10/2023.

NBWL has approved the proposal in 79<sup>th</sup> meeting dated 31/07/2024. Project proponent was asked to submit undertaking on ( stamp Paper) as per additional conditions laid down by board referred in reference 3 above. Accordingly in the 81<sup>st</sup> meeting dated 21/12/2024 the proposal was discussed and approval is given with additional condition as per letter under reference 5 above for undertaking on stamp paper was communicated to project proponent.

Contd..2.

: 2 :

Now, project proponent have submitted the documents as per reference letter 6, for the Central Government's (Conservation & Protection) under the Central Government's Guide Act, 1980, and In principal approval. Accordingly project proponent have completed the process of wildlife approval. In accordance with the above the working permission is issued herewith subject to other approvals to be taken that are needed.

With due reference to above it is to be observed that works will be carried out without violation of the Indian Forest Act-1927, Wildlife (Protection) Act 1972, Forest (Conservation and Protection) Act 1980 and other prevailing rules will be taken without breaking the proposed work.

Encl : As above.

(sd/-)  
( M Srinivas Rao)  
Chief Wildlife warden and  
Principle chief Conservator  
of Forest (Wildlife)  
Govt. of Maharashtra.

- CC. Additional Principle Chief Conservator of Forest and Nodal Officer, for information and necessary action.
- CC. Additional Principle Chief Conservator of Forest (Wildlife) East, Nagpur for information and necessary action.
- CC. Forest Conservator (T) , Nagpur, for information and necessary action.
- CC. Chief Forest Conservator and Area Director, Pench Tiger Project, Nagpur for information and necessary action.
- CC. Deputy Conservator of Forest Nagpur for information and necessary action. Report regarding observing of conditions laid to user agency shall be verified by field site visits time to time and report shall be submitted to this office through proper channel.

**F.No.WL-6/134/2024-WL**  
Government of India  
Ministry of Environment, Forest and Climate Change  
(Wildlife Division)

2<sup>nd</sup> Floor, Vayu Wing,  
Indira Paryavaran Bhawan,  
Jor Bagh Road, New Delhi 110003.

**Date:** 9<sup>th</sup> January, 2025

**To,**

**All Members  
Standing Committee of NBWL**

**Sub:** Minutes of 81<sup>st</sup> Meeting of the Standing Committee of National Board for Wild Life-reg.

Sir/Madam,

Kindly find enclosed a copy of the Minutes of 8<sup>th</sup> Meeting of the Standing Committee of National Board for Wild Life held on 21<sup>st</sup> December, 2024 under the Chairmanship of Hon'ble Minister of Environment, Forest and Climate Change, Government of India.

Yours faithfully,

Signed by

Rakesh Kumar Jagenia

Date: 09-01-2025 10:04:53

**(Rakesh Kumar Jagenia)**

Deputy Inspector General of Forests (WL)

**Email:** digwl-mefcc@gov.in

**Distribution:**

1. Secretary, MoEF & CC
2. DGF&SS, MoEF&CC
3. ADGF (WL), MOEF&CC
4. ADGF (FC), MoEF&CC
5. Member Secretary, NTCA
6. Director/IGF, PE Division, MoEF&CC
7. Director, WII, Dehradun
8. Director, GEER Foundation, Gandhinagar
9. Dr. R. Sukumar, Member, NBWL
10. Dr. H.S. Singh, Member, NBWL
11. Secretary, Environment, Forest, Science and Technology Department, Govt. of Andhra Pradesh.

**Copy to:**

1. PS to Hon'ble MoEF&CC
2. PS to Hon'ble MoS, EF&CC
3. PPS to Secretary, MoEF & CC
4. PPS to DGF&SS, MoEF&CC
5. PSO to Addl. DGF (WL)/PPS to IGF (WL).
6. **The Additional Chief Secretary/Principal Secretary/Secretary Forest Department, The PCCF and HoFF,** Andhra Pradesh/ Arunachal Pradesh/ Assam/ Gujarat/ Haryana / Himachal Pradesh/ Ladakh/ Karnataka/ Kerala / Madhya Pradesh/ Maharashtra/ Manipur/ Mizoram/ Odisha/ Rajasthan/ Tamil Nadu/ Uttarakhand/ Uttar Pradesh/ West Bengal.
7. **The PCCF and HoFF,** Andhra Pradesh/ Arunachal Pradesh/ Assam/ Gujarat/ Haryana / Himachal Pradesh/ Ladakh/ Karnataka/ Kerala / Madhya Pradesh/ Maharashtra/ Manipur/ Mizoram/ Odisha/ Rajasthan/ Tamil Nadu/ Uttarakhand/ Uttar Pradesh/ West Bengal.
8. **The Chief Wild Life Warden,** Andhra Pradesh/ Arunachal Pradesh/ Assam/ Gujarat/ Haryana / Himachal Pradesh/ Ladakh/ Karnataka/ Kerala / Madhya Pradesh/ Maharashtra/ Manipur/ Mizoram/ Odisha/ Rajasthan/ Tamil Nadu/ Uttarakhand/ Uttar Pradesh/ West Bengal.

**Copy also to:** Sr. Technical Director, NIC with a request to upload the minutes of the meeting on PARIVESH Portal.

7. No adverse impact shall be caused to the wild animals and their habitat.
8. The User Agency shall take adequate measures against all kinds of pollution likely to be caused by implementation of the project including disasters like oil & gas leakage or explosion of the well.
9. An amount equivalent to the cost of implementing the measures to mitigate impact of the activities proposed in the project in the ESZ shall be deposited by the User Agency to be utilized by the Chief Wild Life Warden in consonance with the guidelines issued by the Ministry vide F. No. 6-30/2019-WL dated 13.12.2023.
10. An annual compliance certificate on the stipulated conditions shall be submitted by the User Agency to the State Chief Wild Life Warden and an annual compliance certificate shall be submitted by the State Chief Wild Life Warden to Government.

### **AGENDA ITEM No. 3**

#### **81.3 AMENDMENT IN THE MINUTES OF THE MEETINGS**

##### **81.3.1 Amendment in the minutes of the 79<sup>th</sup> meeting of the Standing Committee**

Following three proposals for transmission lines by the Maharashtra State Electricity Corporation Limited were approved by the Standing Committee with certain conditions in the 79th meeting held on 31st July, 2024:

- a. 79.2.12 Proposal for use of 131.1255 ha (44.0937 ha forest land and 87.0858 ha non forestland) from tiger corridor connecting Tadoba Andheri Tiger Reserve and Indravati Tiger Reserve and tiger corridor land scape in between Tadoba Andheri Tiger Reserve and Tipeswar Wildlife Sanctuary and Kawal Tiger Reserve for the purpose of 132 KV DC Mul-SICOM Chandrapur Transmission line. **WL/MH/TRANS/419749/2023**
- b. 79.2.13 Proposal for use of 3.064 ha of forest land from the tiger corridor connecting Tadoba Andhari Tiger Reserve and Navegaon Nagzira Tiger Reserve for laying of 220 KV D/C Transmission Line from existing Umred Sub Station to proposed Nagbhid Sub Station Under MSETCL. **FP/MH/TRANS/44469/2020**
- c. 79.4.74 Proposal for use of 1.2005 ha of forest land & 29.484 ha of Non-forest land from Bor-Pench Tiger Corridor in Eastern Vidharba Landscape for laying of 220 KV Kalmeshwar to Warud EHV Transmission line in Nagpur district, Maharashtra. **WL/MH/TRANS/450298/2023**

The Standing Committee was informed that the present proposal is for amendment of one of the conditions imposed based on the advice given by the National Tiger Conservation Authority. The User Agency has

requested to review the conditions that 'Insulated cables shall be used along the entire stretch of the proposed transmission line so as to avoid electrocution to avifauna and other arboreal species as well as avoid poaching using electricity.'

The User Agency through the State Forest Department, Maharashtra has informed that the lines are air insulated and have sufficient safety measures with respect to the wildlife/avifauna and have requested the stipulated condition.

The Ministry sought comments from the NTCA on the request made by the User Agency. The NTCA has concurred that the said condition may be reviewed subject to the condition that the User Agency will ensure use of best available technology for the project to prevent electrocution of avifauna and other arboreal species, as well as poaching of animals using electricity.

The Standing Committee was informed that the gap between the conductors acts 'as insulation. In case of such high voltage transmission lines, insulated cables are not technically feasible.

Dr. H. S. Singh suggested that the transmission line companies shall invest in research on installation of insulated cables of high voltage lines.

**Decision Taken:** After discussions, the Standing Committee decided that in the approvals given for these proposals, the condition that 'The User Agency shall ensure use of best available technology for the project to prevent electrocution of avifauna and other arboreal species, as well as poaching of animals using electricity' shall be substituted in place of the condition that 'Insulated cables shall be used along the entire stretch of the proposed transmission line so as to avoid electrocution to avifauna and other arboreal species as well as avoid poaching using electricity'.

**81.3.2** Proposal for use of 24281 ha from Karakoram Wildlife Sanctuary for artillery firing and practice at Mandalthang field firing ranges (MTFFR), UT of Ladakh.

The Standing Committee was informed that the proposal from UT of Ladakh for use of 24281 ha of forest land from Karakoram Wildlife Sanctuary for artillery firing and practice at Mandalthang field firing ranges (MTFFR) was considered and recommended with certain conditions in the 73rd meeting of the Standing Committee of the National Board for Wild Life held on 17.07.2023.

One of the conditions imposed was that the User Agency shall pay Net Present Value (NPV) and other charges in accordance with the orders of the Hon'ble Supreme Court and the MoEF&CC guidelines.

The Army Hq. has requested for charging of NPV for Impact Zone of the

firing range as per Ministry guidelines dated 6th January, 2022.

The Chief Wild Life Warden Administration of UT of Ladakh has mentioned that fresh inspection was conducted on 28th-29th May, 2024 and the referred area demarcated (23796.78 ha) into (a) Impact Zone (9818.18 ha) (b) safety zone ( 13,978.60 ha) was verified. This issue was discussed in 10th SBWL meeting held on 20th September, 2024 and the SBWL approved the same for consideration of SC-NBWL.

The Forest Conservation Division, MoEFCC has clarified that the NPV in respect of forest land falling in a Wildlife Sanctuary is to be charged for the actual impact zone which will be five times the normal NPV applicable to such forest land.

**Decision Taken:** After discussions, the Standing Committee directed that the Ministry may clarify to the UT of Administration of Ladakh that the NPV in respect of forest land falling in a Wildlife Sanctuary is to be charged for the actual impact zone which will be five times the normal NPV applicable to such forest land as per Ministry guidelines dated 6th January, 2022.

#### **AGENDA ITEM No. 4**

##### **81.4 POLICY MATTERS**

The Inspector General of Forests (WL), MoEFCC made a brief presentation on the issues for discussion.

##### **81.4.1 Monitoring the Implementation of Terms & conditions**

The Inspector General of Forests (WL) informed that SC-NBWL plays pivotal role in review & approval of projects impacting wildlife areas and that there was a need to establish robust mechanism to monitor implementation of terms & conditions of approved projects. Following was suggested:

- User Agency to submit compliance of terms and conditions on a six-monthly basis
- Field verification to be carried out by concerned DFO every six months
- CF/CCF level officer to check 50% of the projects and submit report to CWLW
- IRO to verify 10% of the projects
- Field visits and field reports can be uploaded in the PARIVESH Portal, updated on DSS

Dr. H.S Singh was of the opinion that the SC-NBWL shall seek information from the Chief Wildlife Warden regarding the compliance.



महाराष्ट्र शासन

महसूल व वन विभाग

प्रधान मुख्य वनसंरक्षक(वनबल प्रमुख), महाराष्ट्र राज्य, नागपूर यांचे कार्यालय,

O/o Principal Chief Conservator of Forests) HoFF(, Maharashtra State

प्रधान मुख्य वनसंरक्षक (वन्यजीव), महाराष्ट्र राज्य

Phone - 0712-2549563

E-mail - pccfwngpp@mahaforest.gov.in

Website - www.mahaforest.gov.in

Principal Chief Conservator of Forests (Wildlife), Maharashtra State

"Van Bhavan" 3<sup>rd</sup> Floor, Ramgiri Road, Civil Lines, Nagpur 440 001

पत्र ईमेल- क्रमांक:-कक्ष-२३(२)/वजी/सर्व्हे/प्र.क्र. १९०/२१६६/२०२४-२५, दिनांक:- ६/१०/२०२४

प्रति,

कार्यकारी अभियंता, EHV प्रकल्प विभाग,  
प्रकाश सरिता, प्रशासकीय इमारत, ए-विंग,  
तळमजला, २२० के.व्ही. उपकेंद्र परिसर,  
मोर्शी रोड, अमरावती (Email- ee1620@mahatransco.in )

विषय:- बोर- पेंच व्याघ्र भ्रमणमार्गात २२० के.व्ही. कळमेश्वर ते वरूड दरम्यान वीज वाहिनी  
टाकण्यासाठी नागपूर जिल्ह्यातील ३०.६८४ हे. वन आणि वनेत्तर जमीनबाबत वन्यजीव  
मान्यतेचा प्रस्ताव. (बोर- पेंच व्याघ्र भ्रमणमार्ग)

संदर्भ - १. या कार्यालयाचे पत्र क्रमांक कक्ष-२३(२)/वजी/सर्व्हे/प्र.क्र १९०/२१५४, दि. १३/१०/२०२३

२. केंद्र शासन, पर्यावरण वने व हवामान बदल मंत्रालय (वन्यजीव विभाग), नवी दिल्ली  
यांचेकडील पत्र क्रमांक F.No. WL-6/88/2024-WL, दिनांक २३/०८/२०२४.

(राष्ट्रीय वन्यजीव मंडळाच्या स्थायी समितीची ७९ वी बैठक, दिनांक ३१/०७/२०२४)

संदर्भाय पत्र १ अन्वये विषयांकित प्रकरणाचा प्रस्ताव राज्य वन्यजीव मंडळाचे निर्णयार्थ ठेवण्यासाठी  
राज्य शासनास सादर करण्यात आलेला होता. राज्य वन्यजीव मंडळाची २२ वी बैठक दिनांक  
१६/१०/२०२३ रोजी संपन्न झाली. सदर बैठकीमध्ये प्रस्तुत प्रस्तावावर मंडळाने चर्चा करून, प्रस्तुत  
प्रस्तावाचे अनुषंगाने, मंडळाने मुख्य वन्यजीव रक्षक, महाराष्ट्र राज्य यांनी घालून दिलेल्या अटी व शर्तीच्या  
अधिन राहून सदर प्रस्ताव राष्ट्रीय वन्यजीव मंडळाकडे सादर करण्याची मंडळाने शिफारस केली असून,  
सदर बैठकीचे कार्यवृत्तांत दिनांक ०७/११/२०२३ अन्वये शासनाने निर्गमित केले होते.

राज्य वन्यजीव मंडळाने घालून दिलेल्या अटीनुसार प्रकल्प यंत्रणेने मुद्रांकावर (Stamp Paper)  
लिखित हमीपत्र सादर केले असून, व्याघ्र भ्रमणमार्गातील प्रकल्प किंमतीच्या ५.०० कोटीचे २ % रक्कम  
रु. ०.०१ कोटी आणि दंडाची रक्कम रु. ०.०५ कोटी असे एकूण रु. ०.१५ कोटी रक्कमेचा भरणा महाराष्ट्र  
राज्यातील वन्यजीव अभयारण्याच्या संवर्धन आणि संरक्षणासाठी वनसंरक्षक तथा क्षेत्र संचालक, पेंच व्याघ्र  
प्रकल्प, नागपूर यांच्याकडील व्याघ्र संवर्धन प्रतिष्ठान मध्ये भरणा करण्यात आलेली आहे. त्याबाबतचा

अहवाल वनसंरक्षक तथा क्षेत्र संचालक, पेंच व्याघ्र प्रकल्प, नागपूर दिनांक ३१/१०/२०२३ रोजी या कार्यालयास सादर केले होते.

राष्ट्रीय वन्यजीव मंडळाच्या स्थायी समितीचे दिनांक ३१/०७/२०२४ रोजीचे ७९ व्या बैठकीमध्ये प्रस्तुत प्रस्तावास खालील अटीनुसार मान्यता प्रदान केलेली आहे. (प्रत सहपत्रीत)

1. As per Indian Electricity rule, minimum ground clearance of about 7 meters (for 220 KV transmission line) shall be maintained.
2. To avoid electrocution impact on birds, about 4.9 m of vertical distance shall be maintained between two conductors. This may reduce risk of electrocution of birds having large wing span.
3. To prevent accidental collisions of birds with the conductor, appropriate mitigation measures will be installed at appropriate locations as per the specification/suggestions by CEA/MOEF&CC.
4. In addition to above proposed mitigation measures, the mitigation measures as stipulated by Forest dept. and the statutory authorities for conservation and protection of biodiversity shall be implemented by the company.
5. Height raising of existing lattice structure towers within technical limitations based on bird flight behavior.
6. Other specific measures, if any as suggested by Forest dept. Considering the public utility of project, the proposed project is recommended on following additional conditions:
  - i. 2% amount of project cost be made available as conservation and protection fund for conservation and protection of wildlife.
  - ii. The User Agency shall bear the cost of mitigation measures that are suggested by the WII.
  - iii. Project personnel, engaged in the project work shall observe the provisions of all the existing laws especially the Environment Protection Act, 1986, Wild Life (Protection) Act, 1972 Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 and rules made there under & also take all precautionary measures for conservation & protection of flora, fauna in the vicinity of the project.
  - iv. The proposed project require to cut 386 trees. User Agency shall bear cost of planting trees.
  - v. Provision of barricading the work site of tower erection to avoid any human or wildlife mishaps should be undertaken.
  - vi. No dumping of debris on wet lands and forest area will be done by User Agency.

- vii. The laying of transmission line and its ancillary works should be carried out with utmost care so to cause least impact on the corridor.
- viii. All the other mandatory permissions from different statutory authorities should be obtained prior to commencement of work.
- ix. It shall be ensured that no damage or disturbance is caused to the Wildlife and its habitat.
7. Insulated cables should be used along the entire stretch of the proposed transmission line so as to avoid electrocution to avifauna and other arboreal species as well as avoid poaching using electricity.
8. Width of the right of the way for the 220 kV DC transmission line on forest land should not be over 35 m (vide MoEFCC Guidelines F. No. 7-25/2012-FC dated May 5, 2014).
9. The alignment of the power line should be made such that minimum numbers of trees are felled. Vegetation clearance along forest stretches should be avoided or minimized to the largest extent possible by increasing height of towers structure to maintain safe vertical clearance. Any felling/pollarding/pruning of trees for allowing electrical clearance/maintenance will be done with the permission of competent authority of Maharashtra Forest Department. Only those trees that are of sufficient height to compromise the requirements of minimal vertical and horizontal clearance from the conductor wires at maximum sag point should be lopped.
10. Periodic clearing of vegetation along the powerline may bring up invasive species. Integrated vegetation management with the plantation of native, palatable species should be actively promoted by the User Agency in collaboration with Maharashtra Forest Department below the power line. This will not only prevent growth of invasive unpalatable species like but also will provide excellent food for wild ungulates in form of its leaves and fruits.
11. No construction/maintenance work shall be permitted within forest and wildlife areas at night. Labor camps should be at least 1 km away from the tiger corridors.
12. No construction material (including soil, stones etc.) should be collected from the forest. Construction debris should not be dumped inside the forest or wetland areas and they should be transported by the User Agency to suitable dumping sites outside the forests and wetlands.
13. The User Agency shall implement animal passage plan prepared in consultation with the Forest Department and there should be implemented a management plan for the area below transmission lines.

14. CWLW, Maharashtra should develop appropriate mechanism to monitor the compliance of the conditions stipulated herein at various phases of project implementation.

15. An annual compliance certificate on the stipulated conditions shall be submitted by the User Agency to the State Chief Wild Life Warden and an annual compliance certificate shall be submitted by the State Chief Wild Life Warden to Government

वरील अटीचे अनुषंगाने, अट क्र. ६ (i) ची पूर्तता प्रकल्प यंत्रणेने पूर्ण केली असून, अट क्र. १ ते ६ (ii ते ix) व ७ ते १५ बाबत मुद्रांकावर हमीपत्र विहित मार्गाने या कार्यालयास सादर करण्यात यावे. तसेच केंद्र शासनाचे माहे मार्च-२०२४ मधील मार्गदर्शक सुचनेनुसार वन (संरक्षण व संवर्धन) अधिनियम १९८० अंतर्गत In Principal approval प्राप्त झाल्याबाबचे दस्ताऐवज सादर करावे. त्यानंतरच ईकडील कार्यालयाकडून कामे सुरु करण्याची मान्यता प्रदान करण्यात येईल.

सहपत्र :- वरील प्रमाणे.



(विवेक खडकेकर)

मुख्य वन्यजीव रक्षक तथा  
अपर प्रधान मुख्य वनसंरक्षक (वन्यजीव),  
महाराष्ट्र राज्य

प्रतिलिपी :- अपर प्रधान मुख्य वनसंरक्षक तथा केंद्रस्थ अधिकारी यांना माहिती व योग्य त्या कार्यवाहीस अग्रेषित.

प्रतिलिपी :- अपर प्रधान मुख्य वनसंरक्षक (वन्यजीव) पूर्व, नागपूर यांना माहिती व योग्य त्या कार्यवाहीस अग्रेषित.

प्रतिलिपी :- मुख्य वनसंरक्षक (प्रादेशिक), नागपूर यांना माहिती व योग्य त्या कार्यवाहीस अग्रेषित.

प्रतिलिपी :- उपवनसंरक्षक (प्रादेशिक), नागपूर यांना माहिती व योग्य त्या कार्यवाहीस अग्रेषित.

112

**F.No.WL-6/88/2024-WL**  
Government of India  
Ministry of Environment, Forests and Climate Change  
(Wildlife Division)

2<sup>nd</sup> Floor, Vayu Wing,  
Indira Paryavaran Bhawan,  
Jor Bagh Road, New Delhi 110003.

**Date:** 23<sup>rd</sup> August, 2024

To,

All Members  
Standing Committee of NBWL

**Sub:** Minutes of 79<sup>th</sup> Meeting of the Standing Committee of National Board for Wild Life-reg.

Sir/Madam,

Kindly find enclosed copy of the Minutes of 79<sup>th</sup> Meeting of the Standing Committee of National Board for Wild Life held on 31<sup>st</sup> July, 2024 under the Chairmanship of Hon'ble Minister of Environment, Forest and Climate Change, Government of India.

Yours faithfully,

  
(Dr. Sudheer Chintalapati)  
Scientist 'E'  
**Email:** adwl-mefcc@gov.in

**Encl:** As above

**Distribution:**

1. Secretary, MoEF & CC
2. DGF&SS, MoEF&CC
3. ADGF (WL), MOEF&CC
4. ADGF (FC), MoEF&CC
5. Member Secretary, NTCA
6. Director/IGF, PE Division, MoEF&CC
7. Director, WII, Dehradun
8. Director, GEER Foundation, Gandhinagar
9. Dr. R. Sukumar, Member, NBWL
10. Dr. H.S. Singh, Member, NBWL
11. Secretary, Environment, Forest, Science and Technology Department, Govt. of Andhra Pradesh.

**Copy to:**

1. PS to Hon'ble MoEF&CC
2. PS to Hon'ble MoS, EF&CC
3. PPS to Secretary, MoEF & CC
4. PPS to DGF&SS, MoEF&CC
5. PSO to Addi. DGF (WL)/PPS to IGF (WL)
6. **The Additional Chief Secretary/Principal Secretary/Secretary Forest Department,** Andhra Pradesh/ Arunachal Pradesh/ Bihar/Assam/Goa/ Gujarat/ Haryana/ Himachal Pradesh/ UT of Jammu & Kashmir /Karnataka/ Madhya Pradesh/ Maharashtra/ Manipur/Rajasthan/Telangana/ Uttarakhand / Uttar Pradesh/ West Bengal.
7. **The Chief Wild Life Warden,** Andhra Pradesh/ Arunachal Pradesh/ Bihar/Assam/Goa/ Gujarat/ Haryana/ Himachal Pradesh/ UT of Jammu & Kashmir /Karnataka/ Madhya Pradesh/ Maharashtra/ Manipur/Rajasthan/Telangana/ Uttarakhand / Uttar Pradesh/ West Bengal.
8. **The PCCF and HoFF,** Government of Andhra Pradesh/ Arunachal Pradesh Bihar/Assam/Goa/ Gujarat/ Haryana/ Himachal Pradesh/ UT of Jammu & Kashmir /Karnataka/ Madhya Pradesh/ Maharashtra/ Manipur/Rajasthan/Telangana/ Uttarakhand / Uttar Pradesh/ West Bengal.

**Copy also to:** Sr. Technical Director, NIC with a request to upload the minutes of the meeting on PARIVESH Portal.

by the Standing Committee. Now the Chief Wild Life Warden has provided the Part III filled by the Bhandara and Gondia Divisions.

Comments were again sought from the NTCA on the proposal of the PCCF (WL), Maharashtra. NTCA has mentioned that the proposed gas pipeline will pass through crucial parts of the Kanha-Navegaon-Tadoba and Pench-Navegaon Nagzira tiger reserve corridors. The current tiger density in Navegaon Tiger Reserve is low and relies on the spillover population from neighbouring 'source' tiger reserves, namely Kanha, Tadoba, and Pench. Therefore, the gas pipe line along with optical fibre may be permitted with certain conditions.

**Decision Taken:** After discussions, the Standing Committee decided to approve the proposal WL/MH/Pipeline/434672/2023 with revision in area as 103.5036 ha in place of 82.7387 ha subject to the conditions already prescribed and the following additional conditions:

1. No bio resources should be used from the neighbouring forests.
2. Labourers should strictly be prohibited from hunting. The User Agency should be held responsible if poaching is reported by its labourer and personnel.
3. No labour settlements should be allowed in the forest.

#### AGENDA ITEM No.4

##### 79.4 (Fresh Proposals falling inside / Outside the Protected Area)

- 79.4.1 Proposal for use of 1.6 ha of forest land from Dibang Wildlife Sanctuary for establishment of New Ammunition Shelters & Gun Position- Bruni, Anni, Arunachal Pradesh.

##### WL/AR/Others/441582/2023

The Standing Committee was informed that the proposal is for use of 1.6 ha of forest land from Dibang Wildlife Sanctuary for establishment of New Ammunition Shelters & Gun Position- Bruni, Anni, Arunachal Pradesh.

The proposal has been recommended by Chief Wild Life Warden, the State Board for Wild Life and the State Government.

**Decision Taken:** After discussions, the Standing Committee decided to recommend the proposal subject to the following conditions:

1. The User Agency shall adhere to the provisions of the Wild Life (Protection) Act, 1972.
2. The User Agency shall not harm or destroy wildlife habitat including fauna and flora of the Sanctuary.
3. The User Agency shall not use the area for any work other than proposed use.

4. Care should be taken that no natural drainage gets obstructed by implementation of the project. Adequate water passageways need to be provided wherever applicable.
5. Construction materials (including top soil) should be procured from outside the forest area. The debris should be appropriately dumped outside the forest by User Agency taking due care of air/dust pollution.
6. User Agency should construct 12 feet high fencing on both sides of the bridge so as to avoid dumping of garbage in the water by pedestrians/vehicles passing over the bridge.
7. The CWLW, Maharashtra should have appropriate mechanism in place for compliance of the conditions laid in this report during various phases of project implementation.
8. An annual compliance certificate on the stipulated conditions shall be submitted by the User Agency to the State Chief Wild Life Warden and an annual compliance certificate shall be submitted by the State Chief Wild Life Warden to Government.

79.4.74

Proposal for use of 1.2005 ha of forest land & 29.484 ha of Non-forest land from Bor-Pench Tiger Corridor in Eastern Vidharba Landscape for laying of 220 KV Kalmeshwar to Warud EHV Transmission line in Nagpur district, Maharashtra.

**WL/MH/TRANS/450298/2023**

The Standing Committee was informed that the proposal is for use of 1.2005 ha of forest land & 29.484 ha of Non-forest land from Bor- Pench Tiger Corridor in Eastern Vidharba Landscape for laying of 220 KV Kalmeshwar to Warud EHV Transmission line in Nagpur district, Maharashtra.

The proposal has been recommended by Chief Wild Life Warden, the State Board for Wild Life and the State Government. The NTCA has recommended the project proposal for approval subject to certain conditions.

**Decision Taken:** After discussions, the Standing Committee decided to approve the proposal subject to the following conditions:

1. As per Indian Electricity rule, minimum ground clearance of about 7 meters (for 220 KV transmission line) shall be maintained.
2. To avoid electrocution impact on birds, about 4.9 m of vertical distance shall be maintained between two conductors. This may reduce risk of electrocution of birds having large wing span.
3. To prevent accidental collisions of birds with the conductor, appropriate mitigation measures will be installed at appropriate locations as per the specification/suggestions by CEA/MOEF&CC.
4. In addition to above proposed mitigation measures, the mitigation measures as stipulated by Forest dept. and the statutory authorities for conservation and protection of biodiversity shall be implemented by the company.
5. Height raising of existing lattice structure towers within technical limitations based on bird flight behavior.

6. Other specific measures, if any as suggested by Forest dept. Considering the public utility of project, the proposed project is recommended on following additional conditions:
  - i. 2% amount of project cost be made available as conservation and protection fund for conservation and protection of wildlife.
  - ii. The User Agency shall bear the cost of mitigation measures that are suggested by the WII.
  - iii. Project personnel, engaged in the project work shall observe the provisions of all the existing laws especially the Environment Protection Act, 1986, Wild Life (Protection) Act, 1972 Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 and rules made there under & also take all precautionary measures for conservation & protection of flora, fauna in the vicinity of the project.
  - iv. The proposed project require to cut 386 trees. User Agency shall bear cost of planting trees.
  - v. Provision of barricading the work site of tower erection to avoid any human or wildlife mishaps should be undertaken.
  - vi. No dumping of debris on wet lands and forest area will be done by User Agency.
  - vii. The laying of transmission line and its ancillary works should be carried out with utmost care so to cause least impact on the corridor.
  - viii. All the other mandatory permissions from different statutory authorities should be obtained prior to commencement of work.
  - ix. It shall be ensured that no damage or disturbance is caused to the Wildlife and its habitat.
7. Insulated cables should be used along the entire stretch of the proposed transmission line so as to avoid electrocution to avifauna and other arboreal species as well as avoid poaching using electricity.
8. Width of the right of the way for the 220 kV DC transmission line on forest land should not be over 35 m (vide MoEFCC Guidelines F. No. 7-25/2012-FC dated May 5, 2014).
9. The alignment of the powerline should be made such that minimum numbers of trees are felled. Vegetation clearance along forest stretches should be avoided or minimized to the largest extent possible by increasing height of towers structure to maintain safe vertical clearance. Any felling/pollarding/pruning of trees for allowing electrical clearance/maintenance will be done with the permission of competent authority of Maharashtra Forest Department. Only those trees that are of sufficient height to compromise the requirements of minimal vertical and horizontal clearance from the conductor wires at maximum sag point should be lopped.
10. Periodic clearing of vegetation along the powerline may bring up invasive species. Integrated vegetation management with the plantation of native, palatable species should be actively promoted by the User Agency in collaboration with Maharashtra Forest Department below the powerline. This will not only prevent growth of invasive unpalatable species like but also will provide excellent food for wild ungulates in form of its leaves and fruits.

11. No construction/maintenance work shall be permitted within forest and wildlife areas at night. Labor camps should be at least 1 km away from the tiger corridors.
12. No construction material (including soil, stones etc.) should be collected from the forest. Construction debris should not be dumped inside the forest or wetland areas and they should be transported by the User Agency to suitable dumping sites outside the forests and wetlands.
13. The User Agency shall implement animal passage plan prepared in consultation with the Forest Department and there should be implemented a management plan for the area below transmission lines.
14. CWLW, Maharashtra should develop appropriate mechanism to monitor the compliance of the conditions stipulated herein at various phases of project implementation.
15. An annual compliance certificate on the stipulated conditions shall be submitted by the User Agency to the State Chief Wild Life Warden and an annual compliance certificate shall be submitted by the State Chief Wild Life Warden to Government.

79.4.75

Proposal for use of 0.02 ha of forest land from buffer area of Melghat Tiger Reserve for Installation of 4G Mobile Tower under 4G Saturation Project at Rohinkhidki (Kamod), in Buldhana District of Maharashtra

**WL/MH/CommPost/454248/2023**

The Standing Committee was informed that the proposal is for use of 0.02 ha of forest land from buffer area of Melghat Tiger Reserve for Installation of 4G Mobile Tower under 4G Saturation Project at Rohinkhidki (Kamod), in Buldhana District of Maharashtra

The proposal has been recommended by Chief Wild Life Warden, the State Board for Wild Life and the State Government.

**Decision Taken:** After discussions, the Standing Committee decided to approve the proposal subject to the following conditions:

1. The User Agency shall erect mobile tower near the forest boundary.
2. The User Agency shall submit the following to the Chief Wild Life Warden for issuance of permit for executing the project:
  - a. An undertaking from the concerned District Magistrate indicating non-availability of alternate revenue/private lands;
  - b. Drawings/sketch indicating the location of various components of the proposals within the required land;
  - c. A plan for the movement of equipments and men for erection of towers and their maintenance;
  - d. Plan for usage of solar power for operation of mobile towers; and
  - e. Undertaking from the User Agency that the call data records of suspected persons for contravention of the Wild Life (Protection) Act, 1972 shall be provided when requested by the officer not below the rank of Deputy Conservator Forests having jurisdiction over the area as per the procedure.

\*English Translate\*

Government of Maharashtra  
Revenue and Forest Department  
O/o Principal Chief Conservator of Forest (HoFF) Maharashtra State, Nagpur

Phone – 0712-2549563

E-mail – [pccfwlngp@mahaforest.gov.in](mailto:pccfwlngp@mahaforest.gov.in)

Website – [www.mahaforest.gov.in](http://www.mahaforest.gov.in)

Principal Chief Conservator of Forest (Wildlife),

Maharashtra State, “Van Bhavan” 3<sup>rd</sup> Floor,

Ramgiri Road, Civil line, Nagpur -440 001

No. Desk-23 (2)/Wildlife/Survey/C.No. 190/2167/2024-25,

Date : - 07/10/2024

To,  
The Executive Engineer,  
EHV Project Division,  
Prakash Sarita, Administrative Building,  
A-Wing, Ground floor, 220 KV Substation  
Area, Morshi Road, Amravati (Email- [ee1620@mahatransco.in](mailto:ee1620@mahatransco.in))

Sub: Approval for Wildlife proposal of 30.684 ha Forest and Non-Forest land under Bor-Pench Tiger corridor for 220KV Kalameshwar to Warud transmission line in Nagpur District (Bor - Pench Tiger Corridor)

Ref. : 1. This office letter No. Desk-23(2)/wL/Survey/C.N.190/2154, dated 13/10/2023  
2. Center Government MoEFCC(WL), New Delhi letter No. F.No. WL-6/88/2024-WL, Dated 23/08/2024. (NBWL Standing Committee meeting 79<sup>th</sup> dated 31/07/2024)

The subject proposal was submitted vide letter under ref. (1) to State Government for NBWL decision. SBWL 22<sup>nd</sup> meeting was conducted on 16/10/2023. In the said meeting said proposal was discussed and accordingly it is recommended to submit said proposal to NBWL subject to terms and conditions laid by Chief Wildlife Warden, Government of Maharashtra. The Minutes of meeting of said meeting was published by Government on 07/11/2023.

Project Authority have submitted under taking on Stamp Paper for conditions laid by SBWL and amount of rupees of 0.10 Crore for 2% of project cost of rupees 5.00 Crore in Tiger Corridor and penalty amount rupees 0.05 Crore accordingly total rupees 0.15 Crore is paid to Tiger Conservation Center of Conservator of Forest and Regional Director Pen Tiger Project Nagpur for Conservation and security of Wildlife Sanctuary in Maharashtra State. Report regarding this was submitted by Conservator of Forest and Regional Director Pen Tiger Project Nagpur to this office on 31/10/2023.

The said proposal is recommended by NBWL in 79<sup>th</sup> meeting dated 31/07/2024 subject to conditions as below. (copy enclosed)

1. As per Indian Electricity rule, minimum ground clearance of about 7 meters (for 220 KV transmission line) shall be maintained.
2. To avoid electrocution impact on birds, about 4.9 m of vertical distance shall be maintained between two conductors. This may reduce risk of electrocution of birds having large wing span.
3. To prevent accidental collision of birds with the conductor, appropriate mitigation measures will be installed at appropriate locations as per the specification/suggestions by CEA/MOEF&CC.
4. In addition to above proposed mitigation measures, the mitigation measures as stipulated by Forest dept. and the statutory authorities for conservation and protection of biodiversity shall be implemented by the company.

  
Executive Engineer  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

5. Height raising of existing lattice structure towers within technical limitations based on bird flight behavior.
6. Other specific measures, if any as suggested by Forest dept. Considering the public utility of project, the proposed project is recommended on following additional conditions:
  - i. 2% amount of project cost be made available as conservation and protection fund for conservation and protection of wildlife.
  - ii. The User Agency shall bear the cost of mitigation measures that are suggested by the WII.
  - iii. Project personnel, engaged in the project work shall observe the provisions of all the existing laws especially the Environment Protection Act, 1986, Wild Life (Protection) Act, 1972 Van (Sanrakshan Evam Samvardhan) Adhiniyam, 1980 and rules made there under & also take all precautionary measures for conservation & protection of flora, fauna in the vicinity of the project.
  - iv. The proposed project require to cut 386 trees. User Agency shall bear cost of planting trees.
  - v. Provision of barricading the work site of tower erection to avoid any human or wildlife mishaps should be undertaken.
  - vi. No dumping of debris on wet lands and forest area will be done by User Agency.
  - vii. The laying of transmission line and its ancillary works should be carried out with utmost care so to cause least impact on the corridor.
  - viii. All the other mandatory permissions from different statutory authorities should be obtained prior to commencement of work.
  - ix. It shall be ensured that no damage or disturbance is caused to the Wildlife and its habitat.
7. Insulated cables should be used along the entire stretch of the proposed transmission line so as to avoid electrocution to avifauna and other arboreal species as well as avoid poaching using electricity.
8. Width of the right of the way for the 220KV DC transmission line on forest land should not be over 35 m (vide MoEFCC Guidelines F.No. 7-25/2012-FC dated May 5, 2014).
9. The alignment of the power line should be made such that minimum numbers of trees are felled. Vegetation clearance along forest stretches should be avoided or minimized to the largest extent possible by increasing height of towers structure to maintain safe vertical clearance. Any felling/pollarding/pruning of trees for allowing electrical clearance/maintenance will be done with the permission of competent authority of Maharashtra Forest Department. Only those trees that are of sufficient height to compromise the requirements of minimal vertical and horizontal clearance from the conductor wires at maximum sag point should be lapped.
10. Periodic clearing of vegetation along the power line may bring up invasive species. Integrated vegetation management with the plantation of native, palatable species should be actively promoted by the User Agency in collaboration with Maharashtra Forest Department below the power line. This will not only prevent growth of invasive unpalatable species like but also will provide excellent food for wild ungulates in forms of its leaves and fruits.

  
Executive Engineer  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

11. No construction/maintenance work shall be permitted within forest and wildlife areas at night. Labor camps should be at least 1 km away from the tiger corridors.
12. No construction material (including soil, stones etc.) should be collected from the forest. Construction debris should not be dumped inside the forest or wetland areas and they should be transported by the User Agency to suitable dumping sites outside the forests and wetlands.
13. The User Agency shall implement animal passage plan prepared in consultation with Forest Department and there should be implemented a management plan for the area below transmission lines.
14. CWLW, Maharashtra should develop appropriate mechanism to monitor the compliance of the conditions stipulated herein at various phases of project implementation.
15. An annual compliance certificate on the stipulated conditions shall be submitted by the User Agency to the State Chief Wild Life Warden and an annual compliance certificate shall be submitted by the State Chief Wild Life Warden to Government.

According to above conditions project authority have complied condition No. 6 (i) and under taking on stamp paper shall be submitted to this office through proper channel for condition No. 1 to 6 (ii to ix) and 7 to 15.

As per Central Government guide lines of March 2024 documents for In-principle approval to the proposal under FCA 1980 shall be submitted to this office. Only after that the approval to commence the work will be issued by this office

Encl.: as above.

(Vivek Khandekar)  
Chief Wildlife Warden and  
APCCF (WL)  
Maharashtra State

Copy to : APCCF and Nodal officer Nagpur for information and necessary action.

Copy to : APCCF (WL) East, Nagpur for information and necessary action.

Copy to : CCF (T) Nagpur for information and necessary action.

Copy to : DCF (T) Nagpur for information and necessary action.

  
Executive Engineer  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**Maharashtra State Electricity Transmission Co. Ltd.**  
**(CIN No.U40109MH2005SGC153646)**

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-24

**UNDERTAKING FOR CONDITION NO. XXIV**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**

xxiv. The user agency shall comply all the provisions of the all Acts, Rules, Regulations, Guidelines, Hon'ble Court Order (s) and NGT Order (s) pertaining to this project, if any, for the time being in force, as applicable to the project;

**Undertaking:-**

We, the user agency undertake that, the user agency shall comply all the provisions of the all Acts, Rules, Regulations, Guidelines, Hon'ble Court Order (s) and NGT Order (s) pertaining to this project, if any, for the time being in force, as applicable to the project;

Place : Amravati

Date: 24/ 03/ 2025



(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

Executive Engineer  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

# Maharashtra State Electricity Transmission Co. Ltd.

(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-25

## UNDERTAKING FOR CONDITION NO. XXV

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

### **Condition: -**


xxv. Violation of any of these conditions will amount to violation of Van (SanrakshanEvamSamvardhan) Adhiniyam, 1980 and action would be taken as prescribed in para 1.16 of Chapter 1 of the Consolidated Guidelines and Clarifications on Van (SanrakshanEvamSamvardhan) Adhiniyam, 1980 as issued by this Ministry's letter dated 29.12.2023;

### **Undertaking:-**

We, the user agency undertake that, Violation of any of these conditions will amount to violation of Van (SanrakshanEvamSamvardhan) Adhiniyam, 1980 and action would be taken as prescribed in para 1.16 of Chapter 1 of the Consolidated Guidelines and Clarifications on Van (SanrakshanEvamSamvardhan) Adhiniyam, 1980 as issued by this Ministry's letter dated 29.12.2023;

Place : Amravati

Date: 24 / 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati

**Maharashtra State Electricity Transmission Co. Ltd.**  
(CIN No.U40109MH2005SGC153646)

Office Of the Executive Engineer, EHV Project Division, Prakash Sarita, Administrative Building, A-Wing, Ground Floor, 220KV substation, Morshi road, Amravati – 444 603  
email :- ee1620@mahatransco.in, Phone No. 0721 - 2669168

Exhibit-26

**UNDERTAKING FOR CONDITION NO. XXVI**

**Name of the Project :** Diversion of 6.0760 Ha Forest land for Construction of 220KV Kalmeshwar - Warud Transmission Line .

**Forest Area to be diverted :** 6.0760 ha.

**File No. :** FP/MH/TRANS/38296/2019 Date : 04/02/2019

**Reference :** Government of India, MoEFCC, In principle approval  
E-Sign letter dated 20/03/2025

**Condition: -**


xxvi. The compliance report shall be uploaded on e-portal (<https://parivesh.nic.in/>).

**Undertaking:-**

We, the user agency undertake that, the compliance report shall be uploaded on e-portal (<https://parivesh.nic.in/>).

Place : Amravati

Date: 24/ 03/ 2025

  
(Jayant M. Waghmare)  
Executive Engineer  
EHV Project Division  
MSETCL, Amravati.

**Executive Engineer**  
E.H.V. Projects Division,  
M.S.E.T.C.L. Amravati